



**LAKE HAVASU CITY, ARIZONA**  
**ADDENDUM NO. 2**

**Booster Sta 4 Improvements Project**  
**Project 108029**

**DATED: NOVEMBER 15, 2023**

This Addendum No. 1 forms a part of the contract described above.

**Item No. 1:**

Changes have been made to the scope of the project in that the planned installation of the PRV station on Cherry Tree Blvd has been removed. Please replace all of the project plans with the revised plan set attached to this addendum that reflects those changes.

**Item No. 2:**

With the removal of the scope of work for installation of the PRV Station on Cherry Tree Blvd, Bid Item 5 description changes so it only relates to the connection work on Cherry Tree Lane. Please replace project specifications page 00310-02 of the original bid package with the page 00310-02 attached to this addendum.

**Item No. 3:**

The bid opening date of November 29<sup>th</sup>, 2023, as stated on the NIB and where appropriate in the specs, has been changed to December 13<sup>th</sup>, 2023. Contractor is notified of this change via this addendum.

**Item No. 4:**

There is now a **non-mandatory pre-bid meeting** to be held onsite on Thursday, November 30<sup>th</sup> at 1:30 pm. Contractor is notified of this change via this addendum.

**Item No. 5:**

The deadline for questions of November 17<sup>th</sup>, 2023, by 3:00 pm, as stated on the NIB and where appropriate in the specs, has been changed to December 1<sup>st</sup>, 2023. Contractor is notified of this change via this addendum.



# LAKE HAVASU CITY, ARIZONA

PROJECT NO. 108029

## BOOSTER STATION 4 IMPROVEMENTS


### FINAL DESIGN DRAWINGS

NOVEMBER 2023




#### DRAWING INDEX

GENERAL		
1	G-01	COVER SHEET
2	G-02	GENERAL NOTES
3	G-03	ABBREVIATIONS AND SYMBOLS
CIVIL		
4	C-01	CIVIL NOTES AND LEGEND
5	C-02	DEMOLITION SITE PLAN
6	C-03	NEW FACILITIES SITE PLAN
7	C-04	CHERRY TREE BLVD PRV ADDITION
8	C-05	CHERRY TREE PL PIPING MODIFICATION PLAN AND DETAIL
MECHANICAL		
9	M-01	FACILITY SCHEMATIC
10	M-02	BOOSTER PUMP STATION DEMOLITION PLAN
11	M-03	BOOSTER PUMP STATION IMPROVEMENTS PLAN
12	M-04	BOOSTER PUMP STATION SECTIONS
13	M-05	PRV STATION PLANS
14	M-06	PRV STATION SECTION AND DETAILS
15	M-07	TYPICAL MECHANICAL DETAILS-1
16	M-08	TYPICAL MECHANICAL DETAILS-2
ELECTRICAL		
17	E-01	ELECTRICAL NOTES, SYMBOLS AND LEGEND
18	E-02	SINGLE LINE DIAGRAM
19	E-03	ELECTRICAL SCHEDULES
20	E-04	ELECTRICAL SITE PLAN
21	E-05	SCHEMATIC & CONNECTION DIAGRAMS
22	E-06	CONDUIT BLOCK DIAGRAM
INSTRUMENTATION		
23	I-01	P&ID SYMBOLS AND LEGEND
24	I-02	P&ID

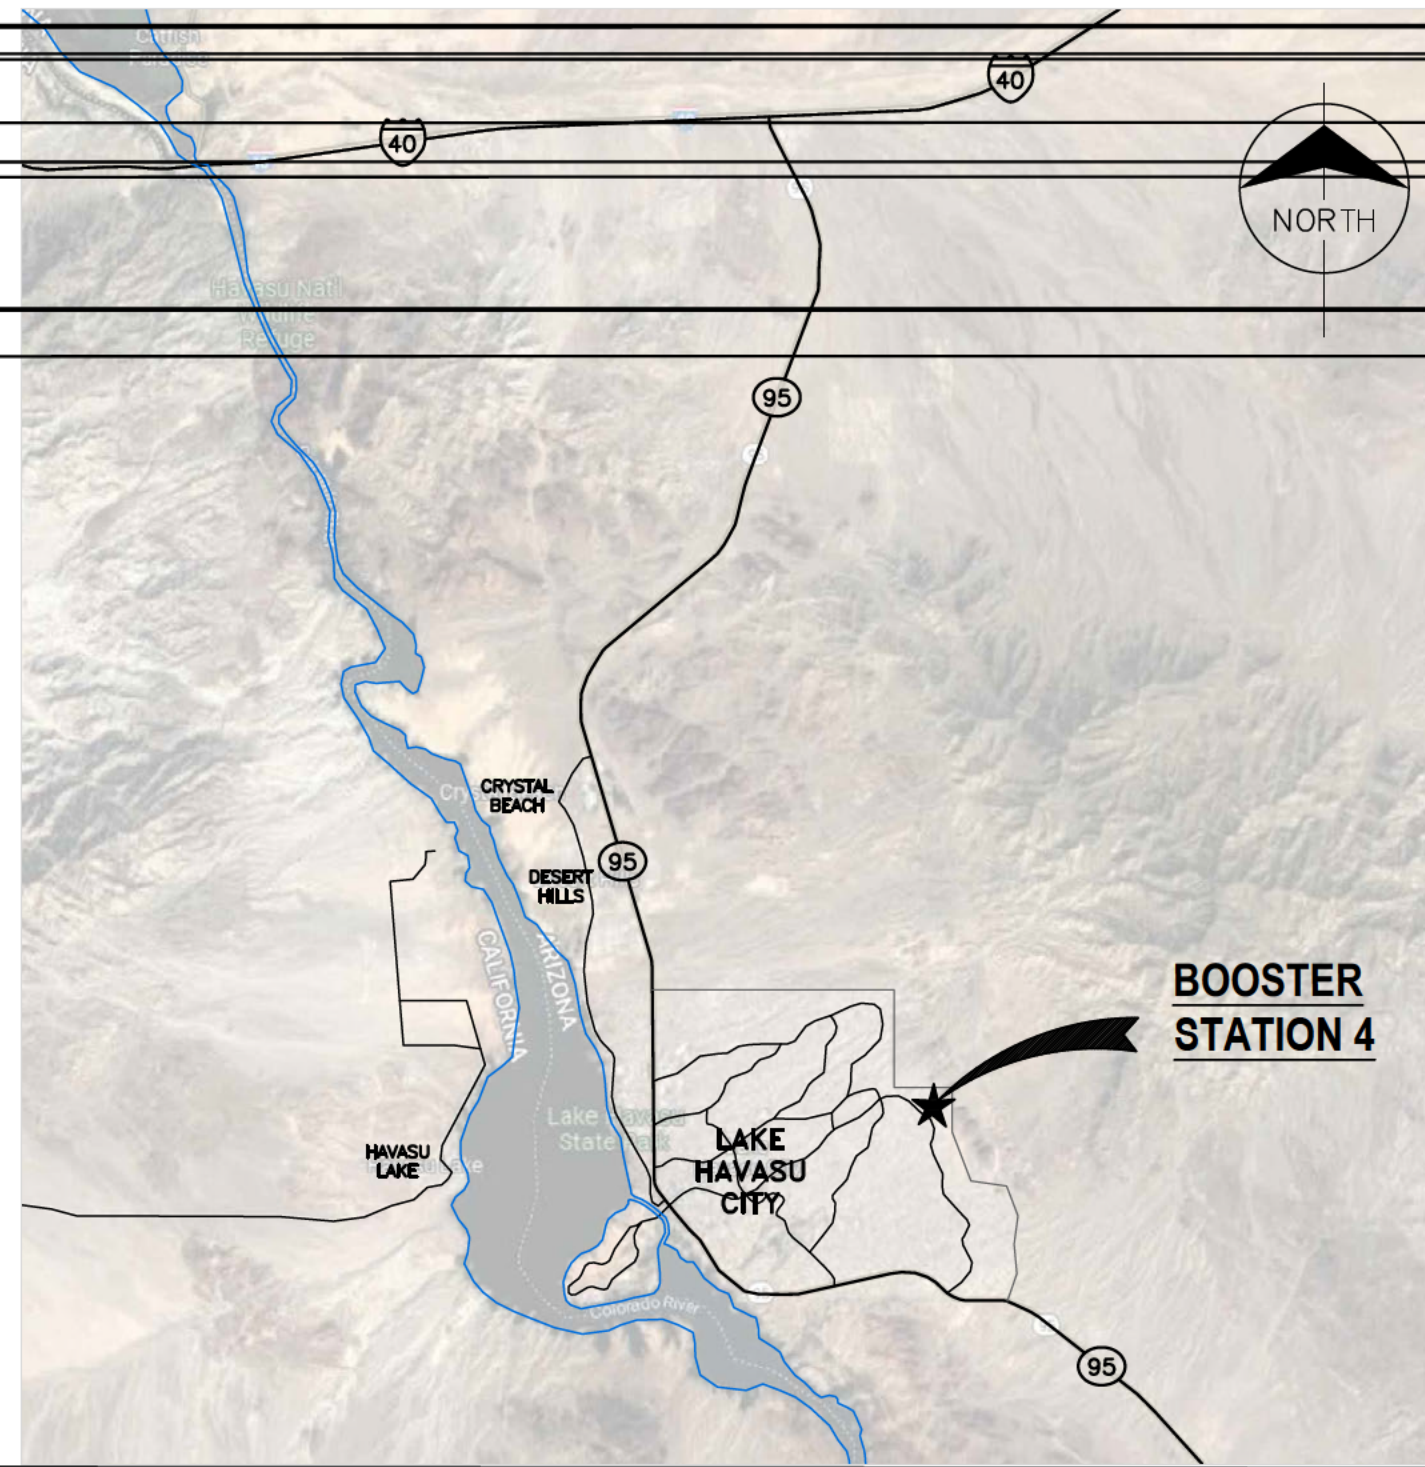

LOCATION MAP

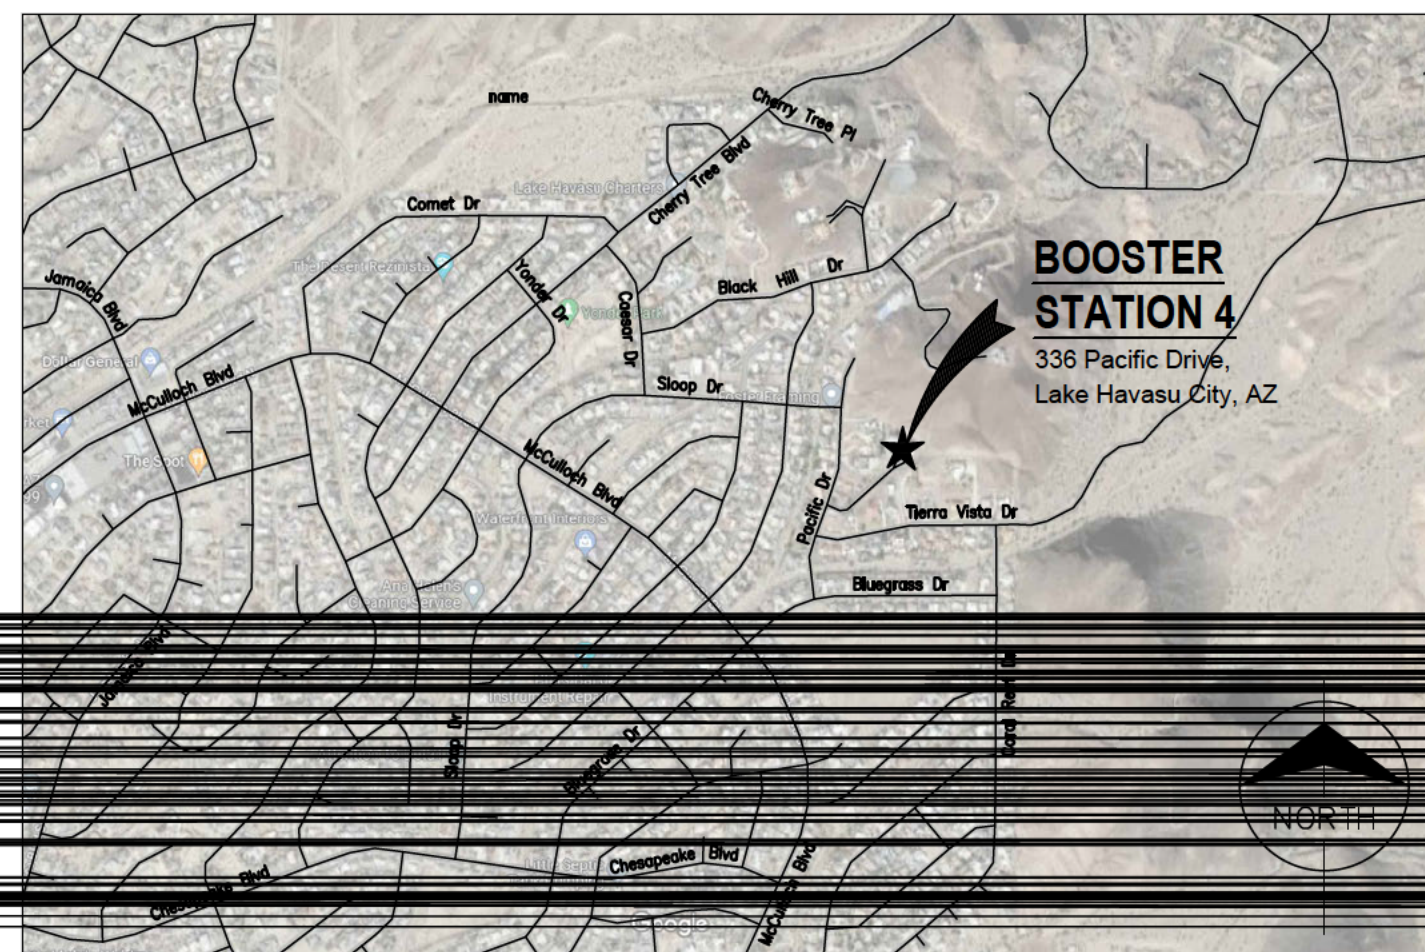

VICINITY MAP

#### CITY COUNCIL

CAL SHEEHY	MAYOR
DAVID LANE	VICE MAYOR
JIM DOLAN	COUNCIL MEMBER
JENI COKE	COUNCIL MEMBER
NANCY CAMPBELL	COUNCIL MEMBER
MICHELE LIN	COUNCIL MEMBER
CAMERON MOSES	COUNCIL MEMBER

#### CITY MANAGER

JESS KNUDSON

#### CITY ENGINEER

GREG FROSLIE, P.E.

#### PROJECT MANAGER

JASON HART

#### UTILITY CONTACTS


LAKE HAVASU CITY (WASTEWATER)	(928) 855-3999
LAKE HAVASU CITY (WATER)	(928) 855-2618
SUDDEN LINK	(928) 855-9855
FRONTIER COMMUNICATION	928) 453-0541
UNISOURCE ENERGY SERVICES (GAS)	928) 505-7025
UNISOURCE ENERGY SERVICES (ELECTRIC)	928) 505-7031

DATE	REVISION	INDEX	INDEX	INDEX

LAKE HAVASU CITY  
BOOSTER STATION 4 IMPROVEMENTS


D sign d by: GB	Drawn by: KWB	h ck d by: RN	Date: 07-07-23	Dwg sect: AS NOTED
-----------------	---------------	---------------	----------------	--------------------

COVER SHEET

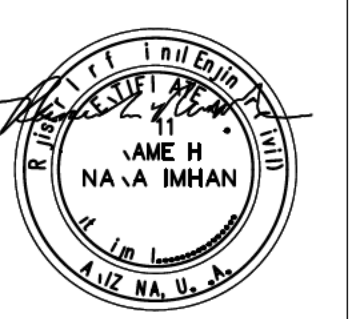

EX I-ATI N-ATE: / / 4  
h t Numl r:

G-01  
h t 1 f

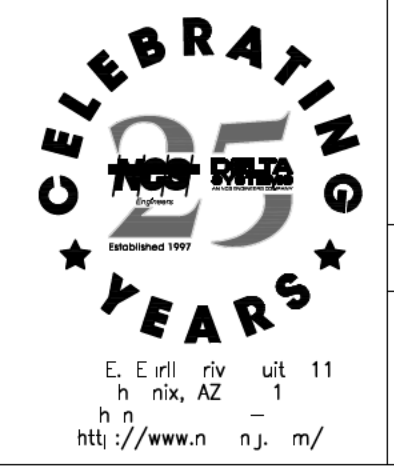

E. E. mll riv uit 11  
h nix, AZ - 1  
h n  
http://www.n nj. m/



**GENERAL NOTES**

**GENERAL**

1. THE CONTRACTOR SHALL BE RESPONSIBLE TO ENSURE THAT ALL IMPROVEMENTS ARE BUILT, CONSTRUCTED, AND/OR INSTALLED IN ACCORDANCE WITH THESE PROJECT PLANS AND THE TECHNICAL SPECIFICATIONS FOR THE WORK.
2. THE CONTRACTOR IS RESPONSIBLE FOR THE SURVEY, LAYOUT, AND STAKING OF THE PROPOSED IMPROVEMENTS FOR CONSTRUCTION PURPOSES.
3. IF THERE ARE ANY QUESTIONS REGARDING THE PLANS OR THE INTENT OF THE DESIGN, THE CONTRACTOR SHALL CONTACT THE ENGINEER AND DISCUSS THE ISSUE SO THAT IT IS CLARIFIED OR RESOLVED PRIOR TO THE START OF CONSTRUCTION.
4. THE CONTRACTOR SHALL TAKE THE NECESSARY STEPS AND PRECAUTIONS TO PROTECT AND SAFEGUARD ADJACENT IMPROVEMENTS AND PROPERTY FROM DAMAGE DUE TO CONSTRUCTION ACTIVITIES ASSOCIATED WITH THIS PROJECT.
5. THE CONTRACTOR SHALL BE RESPONSIBLE FOR IDENTIFYING AND OBTAINING ANY PERMITS NEEDED TO COMPLETE THE PROJECT, POTENTIALLY INCLUDING AN AGENCY BUSINESS LICENSE, RIGHT OF WAY WORK PERMIT, WATER USAGE AGREEMENT, ETC., AND INCLUDE THE COSTS FOR THE SAME, IF ANY, IN THE PROJECT BID PRICES.
6. ALL PROJECT IMPROVEMENTS INCLUDING BUT NOT LIMITED TO MANHOLE FRAMES, VALVE BOXES, VAULTS, HANDHOLES, FIRE HYDRANTS, ETC., SHALL BE SET OR RESET TO FINISHED GRADE OF THE SURROUNDING GROUND OR PAVEMENT SURFACE WHETHER OR NOT SPECIFICALLY CALLED OUT ON THE PLANS OR IN THE SPECIFICATIONS.

22. ELEVATIONS GIVEN ARE TO FINISH GRADE UNLESS OTHERWISE SHOWN. SLOPE UNIFORMLY BETWEEN CONTOURS AND SPOT ELEVATIONS SHOWN.
23. UNLESS SHOWN ON THE DRAWINGS, ALL DISTURBED AREAS NOT RECEIVING A HARD SURFACE OR GRAVEL SURFACE SHALL BE GRADED SMOOTH AND COMPACTED AS SPECIFIED.
24. CONTRACTOR SHALL BE RESPONSIBLE FOR IMPLEMENTING AND MAINTAINING EROSION CONTROL DEVICES DURING CONSTRUCTION. EROSION CONTROL DEVICES, SILT FENCING, RUNOFF CONTAINMENT BERMS, AND STRAW BALES ARE THE MINIMUM REQUIRED.
25. CONTRACTOR SHALL TAKE ALL OTHER MEASURES TO POSITIVELY PRECLUDE EROSION MATERIALS FROM LEAVING THE SITE.
26. WHERE ALUMINUM IS TO BE EMBEDDED IN CONCRETE, THE ALUMINUM SHALL FIRST BE COATED WITH COAL TAR EPOXY.
27. BACKFILLING OF PIPING AND STRUCTURES SHALL NOT BE STARTED UNTIL INSTALLATION IS APPROVED BY THE OWNER.
28. UNLESS OTHERWISE NOTED, ALL PVC INSTALLED ABOVE GROUND SHALL BE PAINTED PER SPECIFICATION SECTION 09800.
29. THE CONTRACTOR SHALL ADJUST ALL EXISTING MANHOLES, VALVE BOXES, CLEANOUTS, BLIND FLANGED PIPING, AND FIRE HYDRANTS WITHIN WORK LIMITS REQUIRED TO MATCH PROPOSED FINAL GRADE.

GOVERNING BUILDING CODES:  
 2018 INTERNATIONAL BUILDING CODE  
 2017 NATIONAL ELECTRICAL CODE  
 2018 INTERNATIONAL PLUMBING CODE  
 2018 INTERNATIONAL FIRE CODE

**UTILITIES**

1. THE EXISTENCE AND LOCATION OF UNDERGROUND UTILITIES OR UTILITY STRUCTURES SHOWN ON THESE PLANS SHOULD BE VERIFIED BASED ON AN AZ 811 UTILITY MAPPING REQUEST.
2. THE LOCATION OF THE UTILITIES MAY OR MAY NOT BE ACCURATELY SHOWN ON THE UTILITY MAPPING PROVIDED AND ON THE PROJECT PLANS.
3. THERE MAY BE OTHER UTILITY LINES AND FACILITIES PRESENT THAT ARE IN SERVICE OR HAVE BEEN ABANDONED WITHIN THE PROJECT CORRIDOR OR AREA THAT ARE NOT SHOWN ON THE MAPPING AND ON THE PLANS.
4. THE CONTRACTOR IS RESPONSIBLE FOR CONTACTING AZ811 (BLUE STAKE) PRIOR TO COMMENCING ANY DIGGING ACTIVITIES TO HAVE THE LOCATIONS OF THE UTILITIES MARKED IN THE FIELD AT THE PROJECT SITE. EXISTING PIPING, ELECTRICAL, AND UTILITIES ARE BASED ON EXISTING RECORDS. CONTRACTOR IS RESPONSIBLE FOR VERIFYING LOCATIONS OF ALL EXISTING PIPING, ELECTRICAL, AND UTILITIES AND AVOIDING DAMAGE TO THE SAME.
5. THE CONTRACTOR IS ALSO RESPONSIBLE FOR VISUALLY INSPECTING THE MARKED UTILITIES AT THE PROJECT SITE TO ASCERTAIN IF ANY POTENTIAL CONFLICTS EXIST BETWEEN THE PROPOSED IMPROVEMENTS UNDER THIS PROJECT AND THE EXISTING UTILITY FACILITIES.
6. THE CONTRACTOR SHALL 'POTHOLE' TO DETERMINE THE EXACT LOCATION AND DEPTH OF EXISTING UTILITY FACILITIES TO IDENTIFY ANY POTENTIAL CONFLICTS BETWEEN UTILITY FACILITIES AND THE PROPOSED IMPROVEMENTS AND, IF NEEDED, REVIEW THE INFORMATION WITH THE OWNER AND THE ENGINEER TO RESOLVE ANY POTENTIAL CONFLICT PRIOR TO CONSTRUCTION.
7. THE CONTRACTOR SHALL OBSERVE ALL POSSIBLE PRECAUTIONS WHEN WORKING IN CLOSE PROXIMITY TO EXISTING UTILITY LINES AND/OR STRUCTURES TO PROTECT THE SAME AND AVOID ANY DAMAGE TO THE UTILITY FACILITIES.
8. SHOULD ANY UTILITY FACILITY BE DAMAGED BY THE CONTRACTOR'S ACTIVITIES, THE CONTRACTOR SHALL CONTACT AND COORDINATE WITH THE UTILITY OWNER FOR THE REPAIR OF THE FACILITY AT NO ADDITIONAL COST TO THE PROJECT.

**ADEQ NOTES**

1. CONTRACTOR SHALL BE RESPONSIBLE FOR DISINFECTION PER THE REQUIREMENTS OF BULLETIN NO. 10, CHAPTER 7.L.3 CONTRACTOR SHALL PROVIDE COPIES OF DISINFECTION TESTING RESULTS FROM AN ARIZONA STATE ACCREDITED LABORATORY TO SHOW THAT DISINFECTION HAS BEEN COMPLETED IN COMPLIANCE WITH ADEQ REQUIREMENTS.
2. NEW WATER SYSTEM COMPONENTS, INCLUDING PIPE, VALVES, FITTINGS, AND EQUIPMENT SHALL NOT BE PUT INTO SERVICE UNTIL DISINFECTION HAS BEEN COMPLETED IN ACCORDANCE WITH ENGINEERING BULLETIN NO. 8, AAC R9-8-266.B OR AWWA C652-92.
3. CONTRACTOR SHALL BE RESPONSIBLE FOR PRESSURE AND LEAKAGE TESTING PER THE REQUIREMENTS OF BULLETIN NO. 10, CHAPTER 7.L.2, PRESSURE AND LEAKAGE TESTING. TESTS SHALL BE WITNESSED BY THE ENGINEER AND/OR OWNER AND COPIES OF THE TESTING RESULTS SHALL BE PROVIDED TO THE ENGINEER.
4. IN ACCORDANCE WITH ARIZONA ADMINISTRATIVE CODE 0618 (A.A.C.) R18-5-504, ALL CONSTRUCTION MATERIALS SHALL BE LEAD FREE.

**CONSTRUCTION JOBSITE SAFETY**


1. THE CONTRACTOR ASSUMES SOLE AND COMPLETE RESPONSIBILITY FOR JOBSITE CONDITIONS DURING THE COURSE OF CONSTRUCTION OF THIS PROJECT INCLUDING SAFETY OF ALL PERSONS AND PROPERTY.
2. THIS SAFETY REQUIREMENT SHALL APPLY CONTINUOUSLY AND NOT BE LIMITED TO NORMAL WORKING HOURS.
3. NEITHER THE OWNER NOR THE ENGINEER WILL ENFORCE SAFETY MEASURES OR REGULATIONS.
4. THE CONTRACTOR IS SOLELY RESPONSIBLE FOR THE DESIGN, CONSTRUCTION, AND MAINTENANCE OF ALL SAFETY DEVICES INCLUDING SHORING.
5. THE CONTRACTOR SHALL BE SOLELY RESPONSIBLE FOR CONFORMING TO ALL LOCAL, STATE, AND FEDERAL SAFETY AND HEALTH STANDARDS, LAWS, AND REGULATIONS.
6. THE CONTRACTOR SHALL FOLLOW THE GUIDELINES AND REGULATIONS AS SET FORTH BY OSHA CONCERNING THE PROJECT WORK AND JOBSITE ACTIVITIES.
7. CONTRACTOR IS RESPONSIBLE FOR REVIEWING ALL PLANS FOR DEMOLITION ITEMS.
8. PROVIDE TEMPORARY THRUST RESTRAINT FOR EXISTING PIPING WHENEVER THE WORK REQUIRES CONTRACTOR SHALL REPLACE OR RESTORE THE EXISTING RESTRAINT SYSTEM TO LIKE-NEW CONDITION.
9. DIMENSIONS AND ELEVATIONS FOR EQUIPMENT INSTALLATION TO BE DETERMINED BASED UPON EQUIPMENT MANUFACTURER SELECTED.
10. WHERE INDICATED, DIMENSIONS AND ELEVATIONS SHALL BE FIELD VERIFIED.
11. EXISTING EQUIPMENT TO BE REMOVED AND SALVAGED SHALL BE MARKED BY ENGINEER OR OWNER PRIOR TO WORK, UNLESS OTHERWISE NOTED ON THE CONTRACT DOCUMENTS.
12. ALTHOUGH SUCH WORK MAY NOT BE SPECIFICALLY INDICATED, FURNISH AND INSTALL SUPPLEMENTARY OR MISCELLANEOUS ITEMS, APPURTENANCES AND DEVICES INCIDENTAL TO, OR NECESSARY FOR A SOUND, SECURE AND COMPLETE INSTALLATION.
13. CONTRACTOR TO MAINTAIN ACCESS FOR EMERGENCY RESPONSE VEHICLES DURING CONSTRUCTION.
14. CONTRACTOR SHALL PROVIDE TEMPORARY SAFETY AND SECURITY FENCING AND SITE IMPROVEMENTS AS NEEDED AT NO EXTRA COST.
15. CONSTRUCTION DEBRIS SHALL BE REMOVED FROM THE SITE AND LEGALLY DISPOSED OF AT LEAST WEEKLY BY THE CONTRACTOR. KEEP SITE AREA CLEAN.
16. EXCAVATED SOIL IS TO BE USED TO FILL IN LOW SPOTS PRIOR TO BEING HAULED OFF SITE. CONTRACTOR SHALL ESTABLISH A SUITABLE STAGING AREA FOR STORAGE OF EXCAVATED SOIL.
17. THE CONTRACTOR SHALL BE RESPONSIBLE FOR SECURITY AT THE SITE WHILE CONSTRUCTION IS IN PROGRESS. CONTRACTOR SHALL BE RESPONSIBLE FOR PROTECTING THE PUBLIC FROM ANY HAZARDOUS MATERIALS, CONSTRUCTION OPERATIONS AND DEBRIS FROM EXISTING AND NEW IMPROVEMENTS FROM DAMAGE DUE TO ACCIDENT OR WINDBLAST.
18. ALL MATERIALS WHICH MAY COME IN CONTACT WITH DRINKING WATER SHALL CONFORM TO NSF INTERNATIONAL STANDARD 61 AND 61.
19. REFER TO PROJECT SPECIFICATION FOR ANY SUPPLEMENT DETAILS REFERRED TO IN THE DRAWINGS.
20. EXISTING MONUMENTS, DELETED OR DELETED FOR THE PURPOSES OF THIS PROJECT, SHALL BE RELOCATED AND MARKED WITHIN THE DISTURBED OR DESTROYED. PERFORM THE WORK TO PRODUCE THE SAME LEVEL OF ACCURACY AS THE ORIGINAL MONUMENT(S) IN A TIMELY MANNER, AND AT THE CONTRACTOR'S EXPENSE.
21. COORDINATES AND DIMENSIONS SHOWN FOR ROADWAY IMPROVEMENTS ARE TO FACE OF CURB OR EDGE OF PAVEMENT.



**LAKE HAVASU CITY**  
**BOOSTER STATION 4 IMPROVEMENTS**


Design by: B  
 Drawn by: KWB  
 Checked by: RW  
 Date: -1-  
 Dwg. No.: A N TED

**GENERAL NOTES**

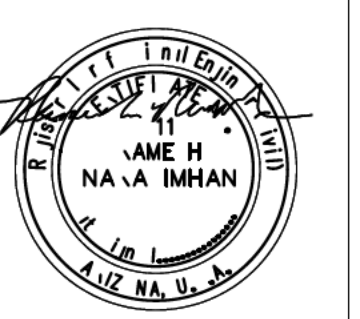

EX I (A) N A T E: / / 4  
 h t Numl r:

**G-02**  
 h t f

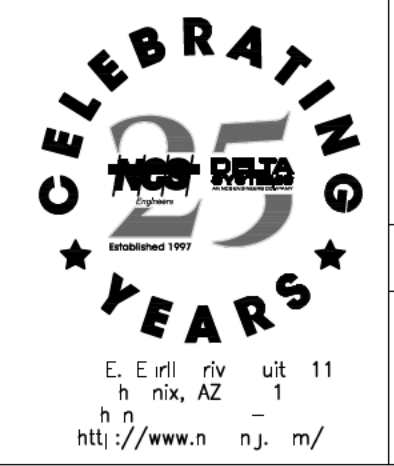

E. E. m. l. r. v. u. t. 11  
 h. n. x. AZ 1  
 h. n. -  
 http://www.n. n. j. m/




ABBREVIATION	DESCRIPTION	ABBREVIATION	DESCRIPTION	SYMBOLS	
&	AND	LCP	LOCAL CONTROL PANEL		
@	AT	LF	LINEAR FEET		
⊖	CENTERLINE	LHC	LAKE HAVASU CITY		
∅	DIAMETER	LL	LOW LEVEL		
ABC	AGGREGATE BASE COURSE	LEV	LONG LEG VERTICAL	ELBOWS / FLANGED	ELBOWS / WELDED
AC	ASBESTOS CEMENT	LOC	LOCATION (S)		
ADD	ADDITION OR ADDITIONAL	LPHH	LEVEL PROBE HIGH HIGH		
ADQ	ARIZONA DEPARTMENT OF ENVIRONMENTAL QUALITY	LS	LAND SURVEYOR	PLAN	PLAN
ADJ	ADJUST OR ADJUSTABLE	LT	LEFT OF LEVEL - TRANSMITTER		
AE	ANALYZER ELEMENT	MAX	MAXIMUM	REDUCERS / FLANGED	REDUCERS / WELDED
AGGR	AGGREGATE	MCJ	MASONRY CONTROL JOINT		
AL	ALIGNMENT	MFR	MANUFACTURER	TEES / FLANGED	TEES / WELDED
ALUM	ALUMINUM	MG	MILLION GALLONS		
ARV	AIR/VACUUM RELEASE VALVE	MGD	MILLION GALLONS PER DAY		
ASL	AIR SUPPLY LINE	MN	MANHOLE	VALVES / FLANGED	RESTRAINED EXPANSION JOINT (BELLOWS TYPE)
ASPH	ASPHALT	MIN	MINIMUM	BUTTERFLY	DISMANTLING JOINT WITH RESTRAINING RODS
ASTM	AMERICAN SOCIETY OF TESTING MATERIALS	MILS	MILLIMETER	CHECK	FLANGED COUPLING ADAPTER WITH RESTRAINTS
AUTO	AUTOMATIC	MCF	MANUAL CLEANING FILTER	GATE	DIAPHRAGM VALVE, PROFILE
AUX	AUXILIARY	MJ	MECHANICAL JOINT	PLUG	PRESSURE SUSTAINING VALVE, PROFILE
AVG	AVERAGE	MOV	MOTOR OPERATED VALVE	BALL VALVE	DIAPHRAGM VALVE, PLAN
AWS	AMERICAN WELDING SOCIETY	MS	MECHANICAL STRAINER		MAGNETIC FLOW METER
		MSD	MECHANICAL STRAINER DRAIN		MECHANICAL JOINT
BDL	BOOSTER PUMP DISCHARGE LINE				PRESSURE RELIEF VALVE
BF	BLIND FLANGE	NG	NATURAL GRADE		AIR RELIEF VALVE
BFP	BACKFLOW PREVENTER	NO.	NUMBER		SAFETY POST (BOLLARD)
BFV	BUTTERFLY VALVE	NTS	NOT TO SCALE		SAMPLE TAP
BLV	BALL CHECK VALVE			90 DEGREE BENDS / PVC	PRESSURE SWITCH LOW
BM	BENCH MARK	OC	ON CENTER		PRESSURE SWITCH HIGH
BOF	BOTTOM OF FOOTING	OD	OUTSIDE DIAMETER		FLOW SWITCH
BP	BOOSTER PUMP	OF	OVERFLOW		PRESSURE GAUGE
BSL	BOOSTER PUMP SUCTION LINE	OS&Y	OUTSIDE SCREW & YOKE		EMERGENCY EYEWASH AND SHOWER
CCP	CONSTRUCTION CONTROL POINT	PE	POLYETHYLENE		OBJECT LINE, EXISTING
CFM	CUBIC FEET PER MINUTE	PDL	PREFILTER DRAIN LINE		OBJECT LINES, NEW OR RELOCATED
CFS	CUBIC FEET PER SECOND	PF	PREFILTER		FUTURE
CJ	CONSTRUCTION JOINT	PI	PRESSURE INDICATOR		CENTER LINE
CL	CENTER LINE	PIL	PREFILTER INLET LINE		HIDDEN LINE
CLR	CLEAR	PLC	PROCESS LOGIC CONTROLLER		SURFACE BREAK LINE
CLSM	CONCRETE LOW STRENGTH MATERIAL	PLT	PRESSURE LEVEL TRANSMITTER		MATCH LINE
CMU	CONCRETE MASONRY UNIT	PMP	PUMP		BASE LINE OR DATUM LINE
CND	CONDUIT	PR	PIPE RESTRAINT		DIAMETER OR ROUND
CONC	CONCRETE	PRLV	PRESSURE RELIEF VALVE		EXISTING OBJECT TO BE REMOVED
CONT	CONTINUOUS	PRV	PRESSURE REDUCING VALVE		WATER SURFACE
CONST	CONSTRUCTION	PSH	HIGH PRESSURE SWITCH		EARTH
CU	CUBIC	PSI	POUNDS PER SQUARE INCH		CONCRETE
CV	CHECK VALVE	PSV	PRESSURE SUSTAINING VALVE		
CY	CUBIC YARD	PUE	PUBLIC UTILITY EASEMENT		
		PVC	POLYVINYL CHLORIDE		
		PWS	POTABLE WATER SUPPLY		
D	DEEP				
DET	DETAIL	RCP	REINFORCED CONCRETE PIPE		
DIA	DIAMETER	RED	REDUCER		
DIM	DIMENSION	REINF	REINFORCEMENT		
DI	DUCTILE IRON	RIO	REMOTE INPUT OUTPUT		
DIP	DUCTILE IRON PIPE	RMJ	RESTRAINED MECHANICAL JOINT		
DISCH	DISCHARGE	RMJ	RESTRAINED MECHANICAL JOINT		
DPS	DIFFERENTIAL PRESSURE SWITCH	RPP	REDUCED PRESSURE PRINCIPLE		
D/S	DOWNSTREAM	REQD	REQUIRED		
		RRP	REGENERATION AND RINSE PUMP		
EA	EACH	RT	RIGHT		
EJ	EXPANSION JOINT	RW	RIGHT-OF-WAY		
EL	ELEVATION				
ELEC	ELECTRONIC	S	SLOPE		
EP	EDGE OF PAVEMENT	SCH	SCHEDULE		
EQ	EQUALIZATION	SD	SANITARY DRAIN		
EST	ESTIMATE	SHT	SHEET		
EW	EACH WAY	SJ	SHRINKAGE JOINT		
EXST	EXISTING	SPECS	SPECIFICATIONS		
		SQ	SQUARE		
F	EDGE OF FILL AREA	SS	STAINLESS STEEL		
FAB	FABRICATED	ST	STREET		
FCA	FLANGED COUPLING ADAPTER	STA	STATION		
FST	FLOW CONTROL VALVE	STD	STANDARD		
FD	FLOOR DRAIN	STL	STEEL		
FE	FLOW ELEMENT	SV	SOLENOID VALVE		
FF	FINISH FLOOR	SWI	SEWER WATER LINE		
FG	FINISH GRADE				
FIN	FINISH	T	THICKNESS		
FL	FLANGED	T&B	TOP AND BOTTOM		
FRP	FIBERGLASS REINFORCED PLASTIC	TBD	TO BE DETERMINED		
FT	FEET	TBM	TEMPORARY BENCH MARK		
FTG	FOOTING	TCE	TEMPORARY CONSTRUCTION EASEMENT		
		THRU	THROUGH		
GAL	GALLON	TOC	TOP OF CURB		
GALV	GALVANIZED	TOCS	TOP OF CONCRETE SLAB		
GND EL	GROUND ELEVATION	TOF	TOP OF FOOTING		
GPM	GALLONS PER MINUTE	TOP	TOP OF PIPE		
GSN	GENERAL STRUCTURAL NOTES				
GV	GATE VALVE	TOS	TOP OF SLAB		
		TOW	TOP OF WALL		
H	HEIGHT	TS	TUBE STEEL		
HDPE	HIGH DENSITY POLYETHYLENE	TYP	TYPICAL		
HORIZ	HORIZONTAL	UGND	UNDERGROUND		
HP	HORSE POWER	UNO	UNLESS NOTED OTHERWISE		
HPT	HYDROPNEUMATIC TANK	US	UPSTREAM		
HWL	HIGH WATER LEVEL	UV	UNDERVALVE		
I	MOMENT OF INERTIA	YD	YARDS		
IBC	INTERNATIONAL BUILDING CODE				
ICBO	INTERNATIONAL CONFERENCE OF BUILDING OFFICIALS				
ID	INSIDE DIAMETER				
IE	INVERT ELEVATION				
IOP	INDEPENDENT OPERATING PRESSURE				
INV	INVERT				
IV	ISOLATION VALVE				
KW	KILOWATT				





LAKE HAVASU CITY  
BOOSTER STATION 4 IMPROVEMENTS

D sign d by: B  
Drawn by: KWB  
h ck d by: RN  
Dot: -1-  
Dwg sec: A N TED

ABBREVIATIONS  
AND SYMBOLS

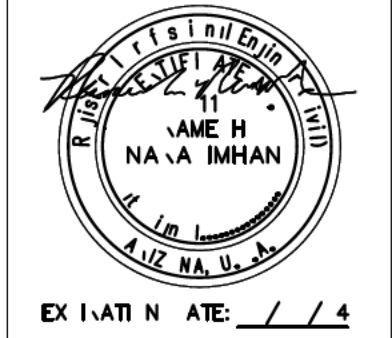

EX I AT I N A T E: / / 4  
h t Numl r:  
G-03  
h t f

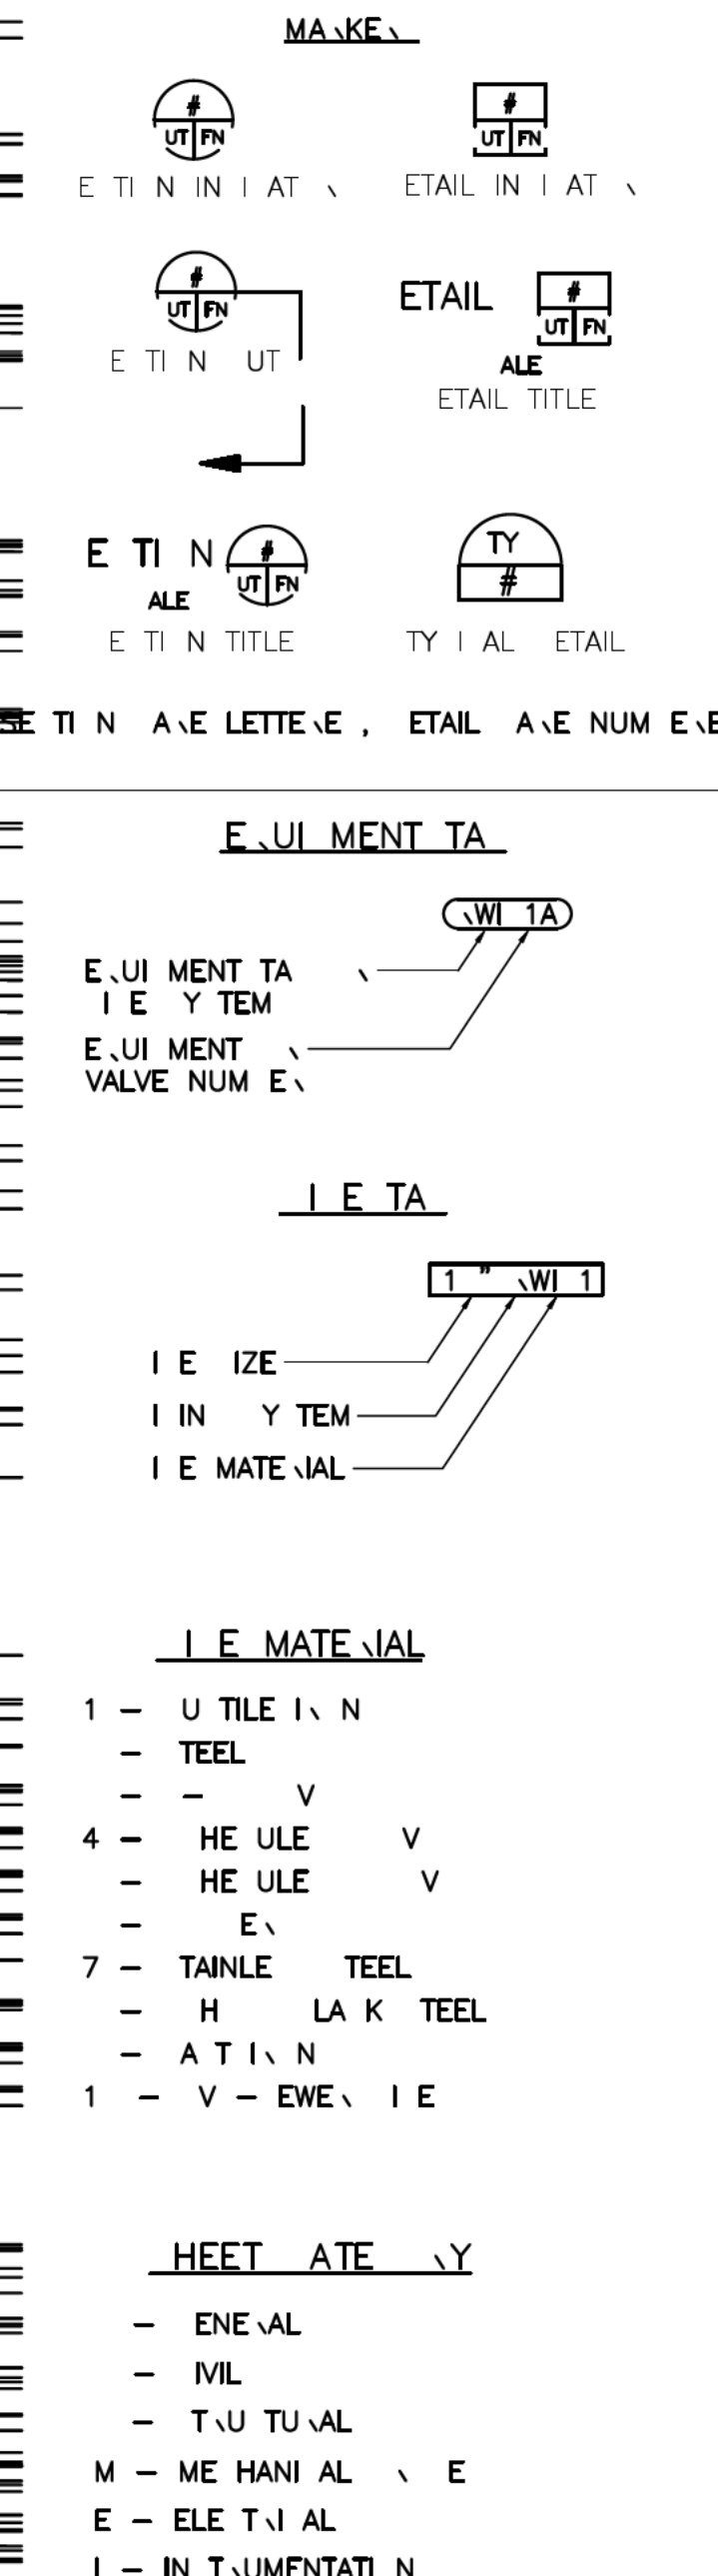

E. E. m. l. r. v. u. t. 11  
h. n. k. a. z. - 1  
http://www.n. j. m. /



## GENERAL SITE NOTES:

1. SOURCE OF TOPOGRAPHY SHOWN ON THE CIVIL PLANS IS A BASE MAP FROM RECORD DRAWINGS. EXISTING CONDITIONS MAY VARY FROM THOSE SHOWN ON THESE PLANS. THE CONTRACTOR SHALL VERIFY EXISTING CONDITIONS AND ADJUST WORK PLAN ACCORDINGLY PRIOR TO BEGINNING CONSTRUCTION.
2. EXISTING TOPOGRAPHY, STRUCTURES, AND SITE FEATURES ARE SHOWN SCREENED AND/OR LIGHT-LINED. NEW FINISH GRADE, STRUCTURES, AND SITE FEATURES ARE SHOWN HEAVY-LINED.
3. HORIZONTAL DATUM: NAD 83, ARIZONA CENTRAL ZONE  
VERTICAL DATUM: NGVD 29
4. MAINTAIN, RELOCATE, OR REPLACE EXISTING SURVEY MONUMENTS, CONTROL POINTS, AND STAKES WHICH ARE DISTURBED OR DESTROYED. PERFORM THE WORK TO PRODUCE THE SAME LEVEL OF ACCURACY AS THE ORIGINAL MONUMENT(S) IN A TIMELY MANNER, AND AT THE CONTRACTOR'S EXPENSE.
5. COORDINATES AND DIMENSIONS SHOWN FOR ROADWAY IMPROVEMENTS ARE TO FACE OF CURB OR EDGE OF PAVEMENT.
6. ELEVATIONS GIVEN ARE TO FINISH GRADE UNLESS OTHERWISE SHOWN. SLOPE UNIFORMLY BETWEEN CONTOURS AND SPOT ELEVATIONS SHOWN.
7. UNLESS SHOWN ON THE GRADING & DRAINAGE DRAWINGS, ALL DISTURBED AREAS NOT RECEIVING A HARD SURFACE OR GRAVEL SURFACE SHALL BE GRADED SMOOTH AND COMPACTED AS SPECIFIED.
8. CONTRACTOR SHALL BE RESPONSIBLE FOR IMPLEMENTING AND MAINTAINING EROSION CONTROL DEVICES DURING CONSTRUCTION. EROSION CONTROL INCLUDING DEVICES SILT FENCING, RUNOFF CONTAINMENT BERMS, AND STRAW BALES ARE THE MINIMUM REQUIRED.
9. CONTRACTOR SHALL TAKE ALL OTHER MEASURES TO POSITIVELY PRECLUDE EROSION MATERIALS FROM LEAVING THE SITE.

## YARD PIPING LEGEND

	PIPING – SEE PIPE TAG DESCRIPTION ON SHT 3
	HIDDEN PIPING THROUGH WALLS AND UNDER SLABS
	PIPING ≥ 24"Ø WHEN DRAWING SCALE IS 1" = 20' 12"Ø WHEN DRAWING SCALE IS 1" = 10'
	FLEXIBLE COUPLING
	90° ELBOW UP
	90° ELBOW DOWN
	CONCENTRIC REDUCER
	CAP OR PLUG

## CIVIL LEGEND

	WATER MANHOLE
	WATER METER
	WATER VALVE
	EASEMENT
	PROPERTY LINE
	PROPERTY LINE
	RIGHT-OF-WAY LINE
	SECTION LINE
	CURB AND GUTTER
	CHAINLINK FENCE
	CONTOUR
	UNDERGROUND ELECTRIC
	WATER (18" OR SMALLER)
	WATER (20" OR LARGER)

## GENERAL YARD PIPING AND UTILITIES NOTES:

1. EXISTING UNDERGROUND UTILITIES OBTAINED FROM AS-BUILTS AND DRAWINGS PROVIDED BY CITY, UTILITIES MAPS, AND FROM FIELD SURVEY. CONTRACTOR SHALL FIELD VERIFY DEPTH AND LOCATION PRIOR TO EXCAVATION. PROTECT ALL EXISTING UTILITIES DURING CONSTRUCTION.
2. FOR PIPING FLOW STREAM IDENTIFICATION, SEE PIPING SCHEDULE.
3. EXISTING PIPING AND EQUIPMENT ARE SHOWN SCREENED AND/OR LIGHT-LINED. NEW PIPING AND EQUIPMENT ARE SHOWN HEAVY-LINED.
4. UNLESS OTHERWISE SHOWN, ALL PIPING SHALL HAVE A MINIMUM OF 4' COVER.
5. ALL PIPES SHALL HAVE A CONSTANT SLOPE BETWEEN INVERT ELEVATIONS UNLESS A FITTING IS SHOWN.
6. ALL NEW WATER PIPES MUST BE PROPERLY FLUSHED, PRESSURE TESTED, CHLORINATED AND BACTERIOLOGICALLY TESTED, AS SPECIFIED.
7. RESTORE DIRT AND/OR GRAVEL ROADS TO CONDITIONS THAT EXISTED BEFORE START OF CONSTRUCTION.
8. CONTRACTOR TO PROVIDE PIPE WARNING TAPE AND TRACER WIRE ON PVC PIPING ON THE SITE. SEE SPECS. TRACER WIRE SHALL BE TERMINATED IN THREADED PVC PIPE ADJACENT TO STRUCTURES. SEE TYPICAL DETAIL.




						DATE

**LAKE HAVASU CITY**  
BOOSTER STATION 4 IMPROVEMENTS


D sign d by: B	Drawn by: KWB	h ck d by: RN	Dot: -1	Dwg sect: A N TED
----------------	---------------	---------------	---------	-------------------

## CIVIL NOTES AND LEGEND

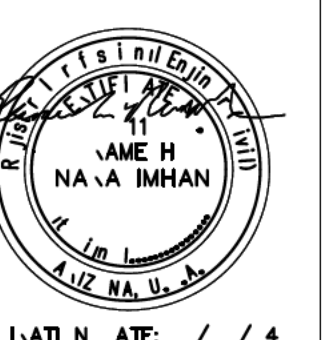


EX I V A T I N A T E: / / 4  
h t Numl r:

C-01  
h t 4 f


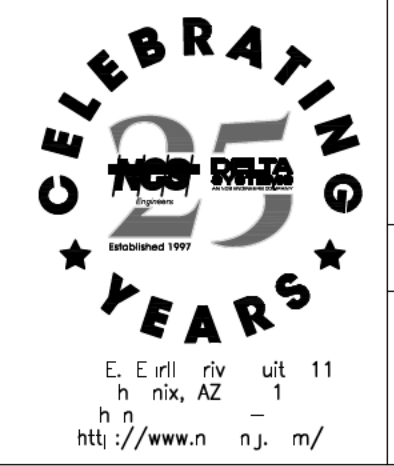


E. E. rlv ut 11  
h nix, AZ 1  
n -  
http://www.n nj. m/



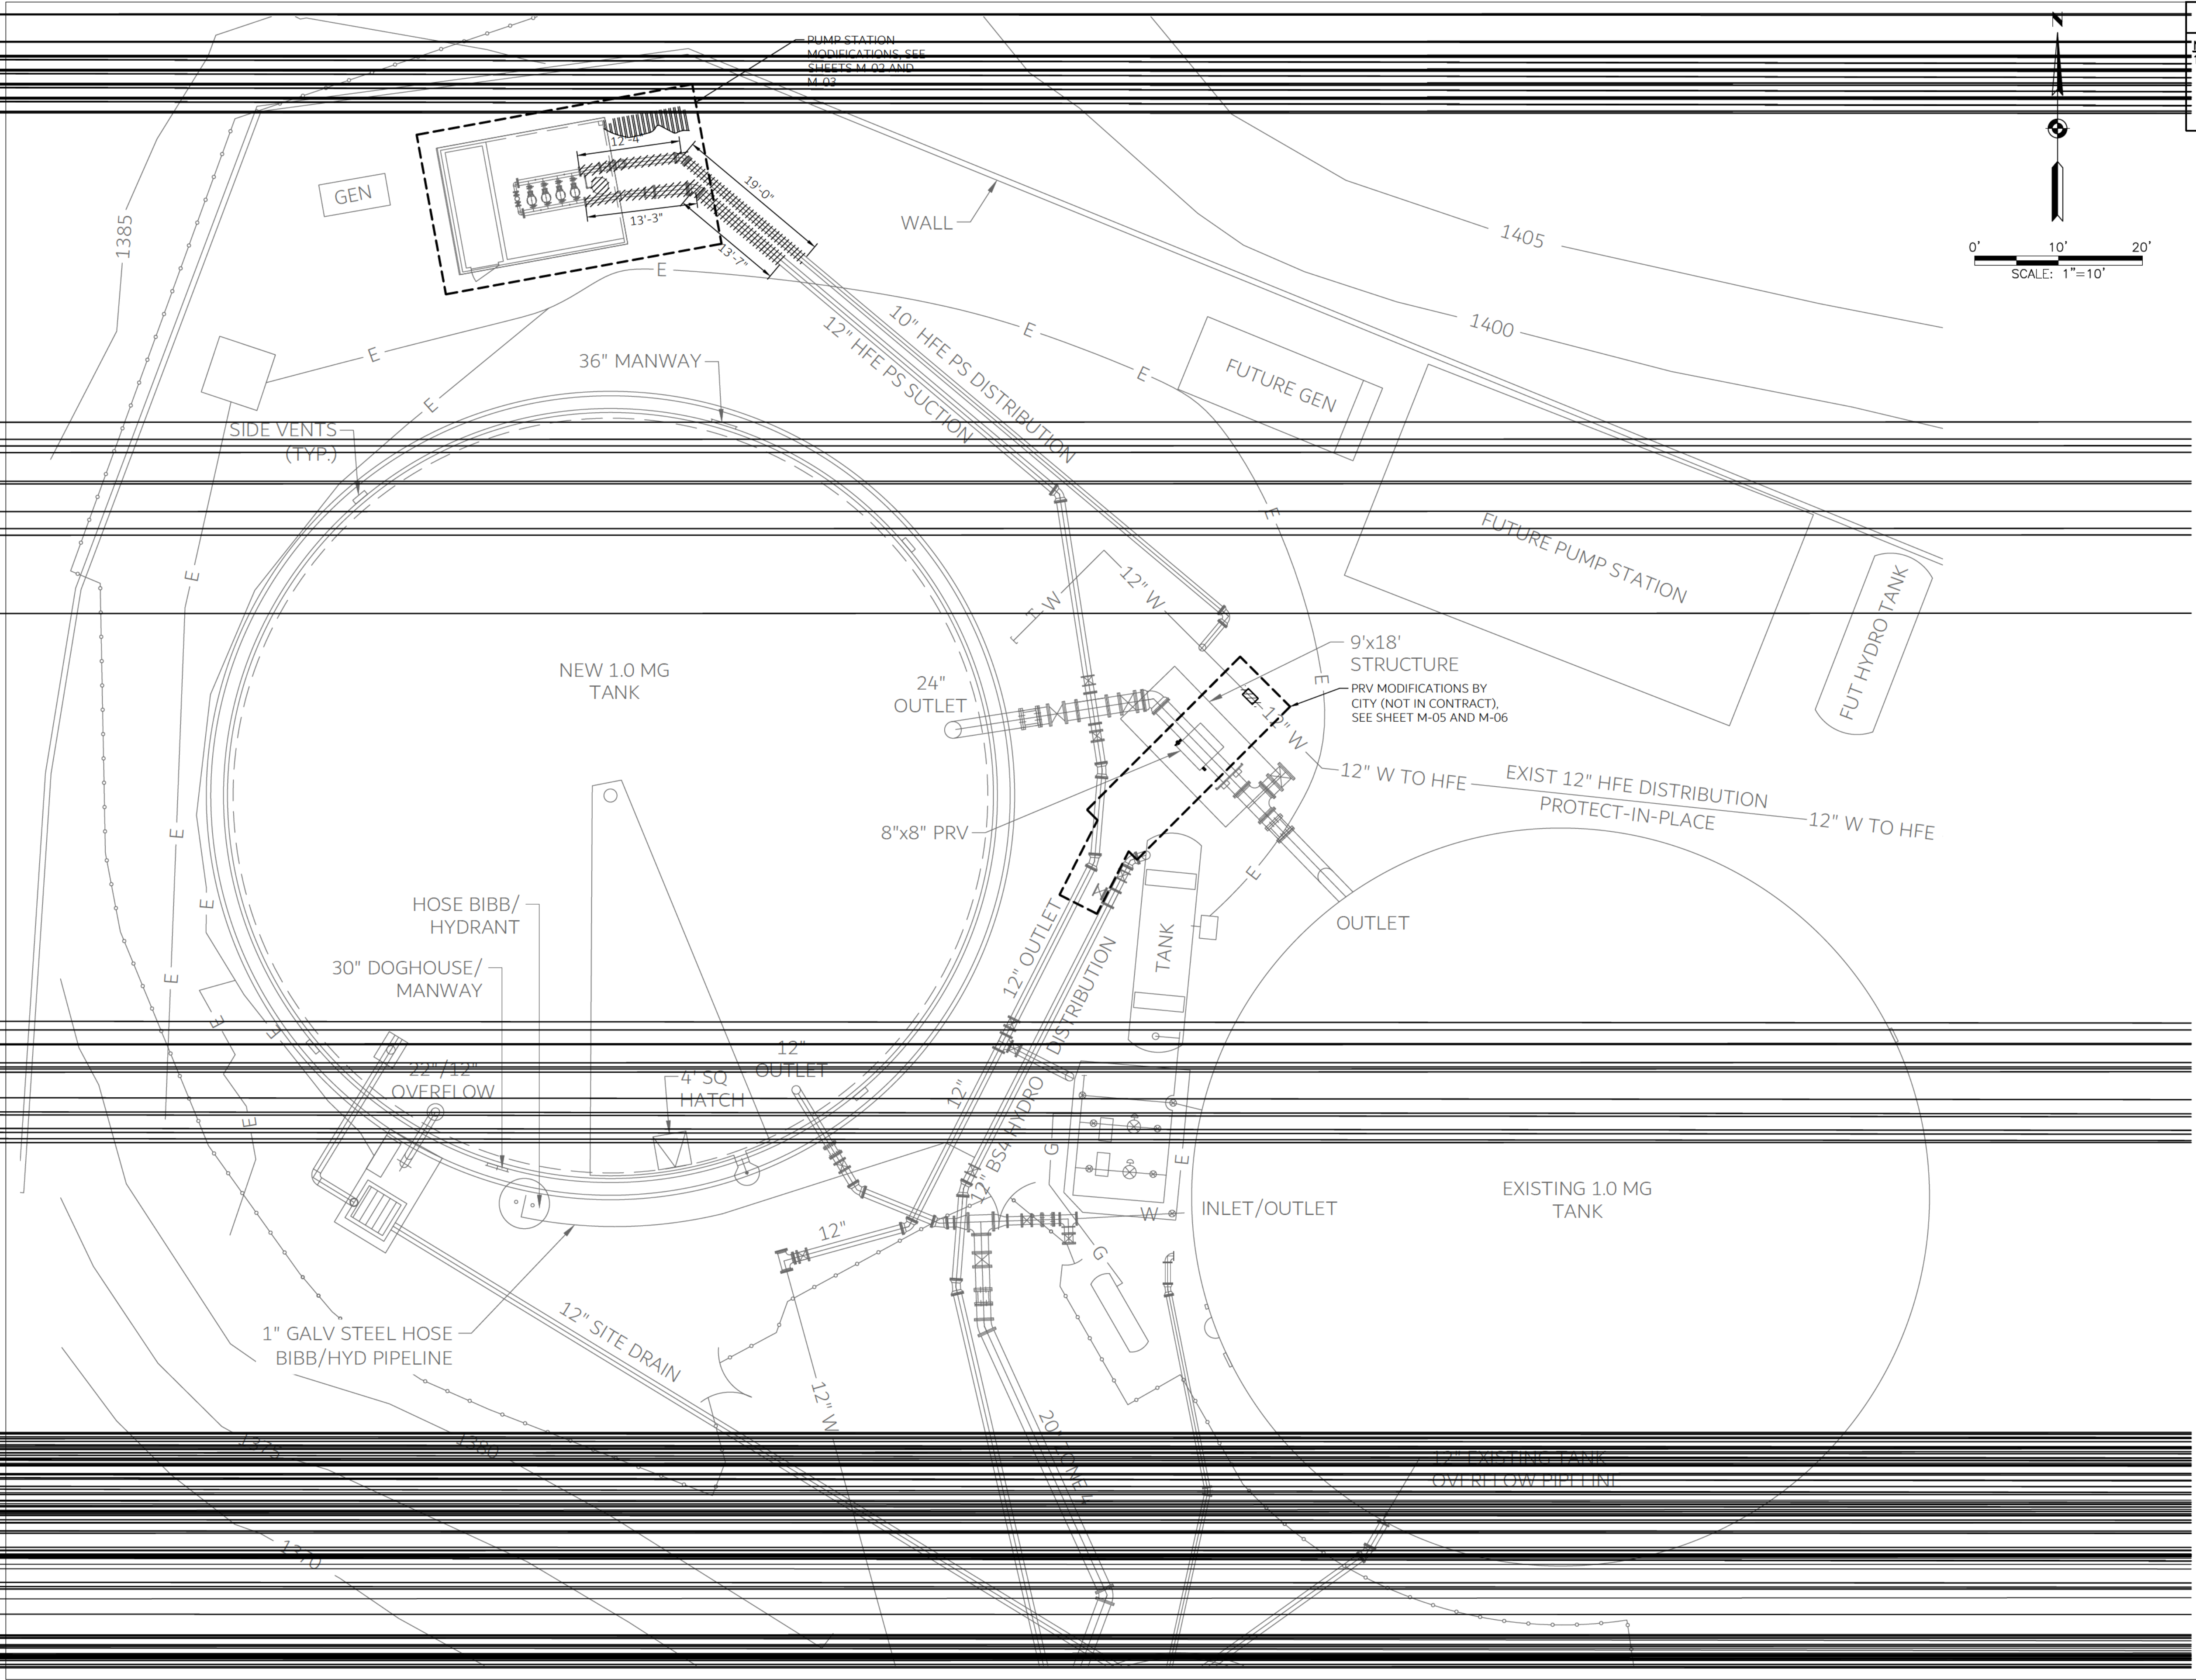

NOTE:  
 1. WHEN NEW FACILITIES ARE EVAPORATED, THE EXISTING UTILITIES SHALL BE REMOVED IN ACCORDANCE WITH THE NEXT JOINT AGREEMENT.

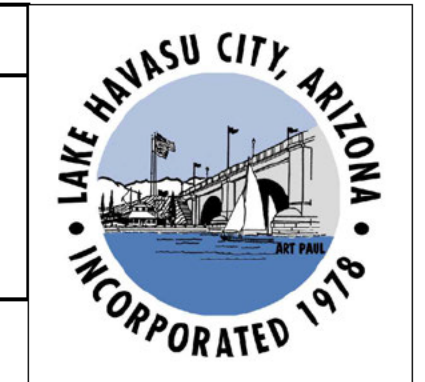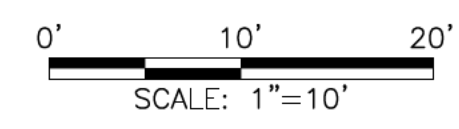

NO.	REVISION /	DATE

**LAKE HAVASU CITY**  
**BOOSTER STATION 4 IMPROVEMENTS**

Designed by: B  
 Drawn by: KWB  
 Checked by: RN  
 Date: -1-  
 Drawing scale: A - N.T.D.

**DEMOLITION SITE PLAN**


CELEBRATING 75 YEARS

EXISTING DATE: / / 4  
 Sheet Number: C-02  
 of



CELEBRATING 75 YEARS

Professional Engineer Seal for James H. Nauman, License No. 1174, State of Arizona.



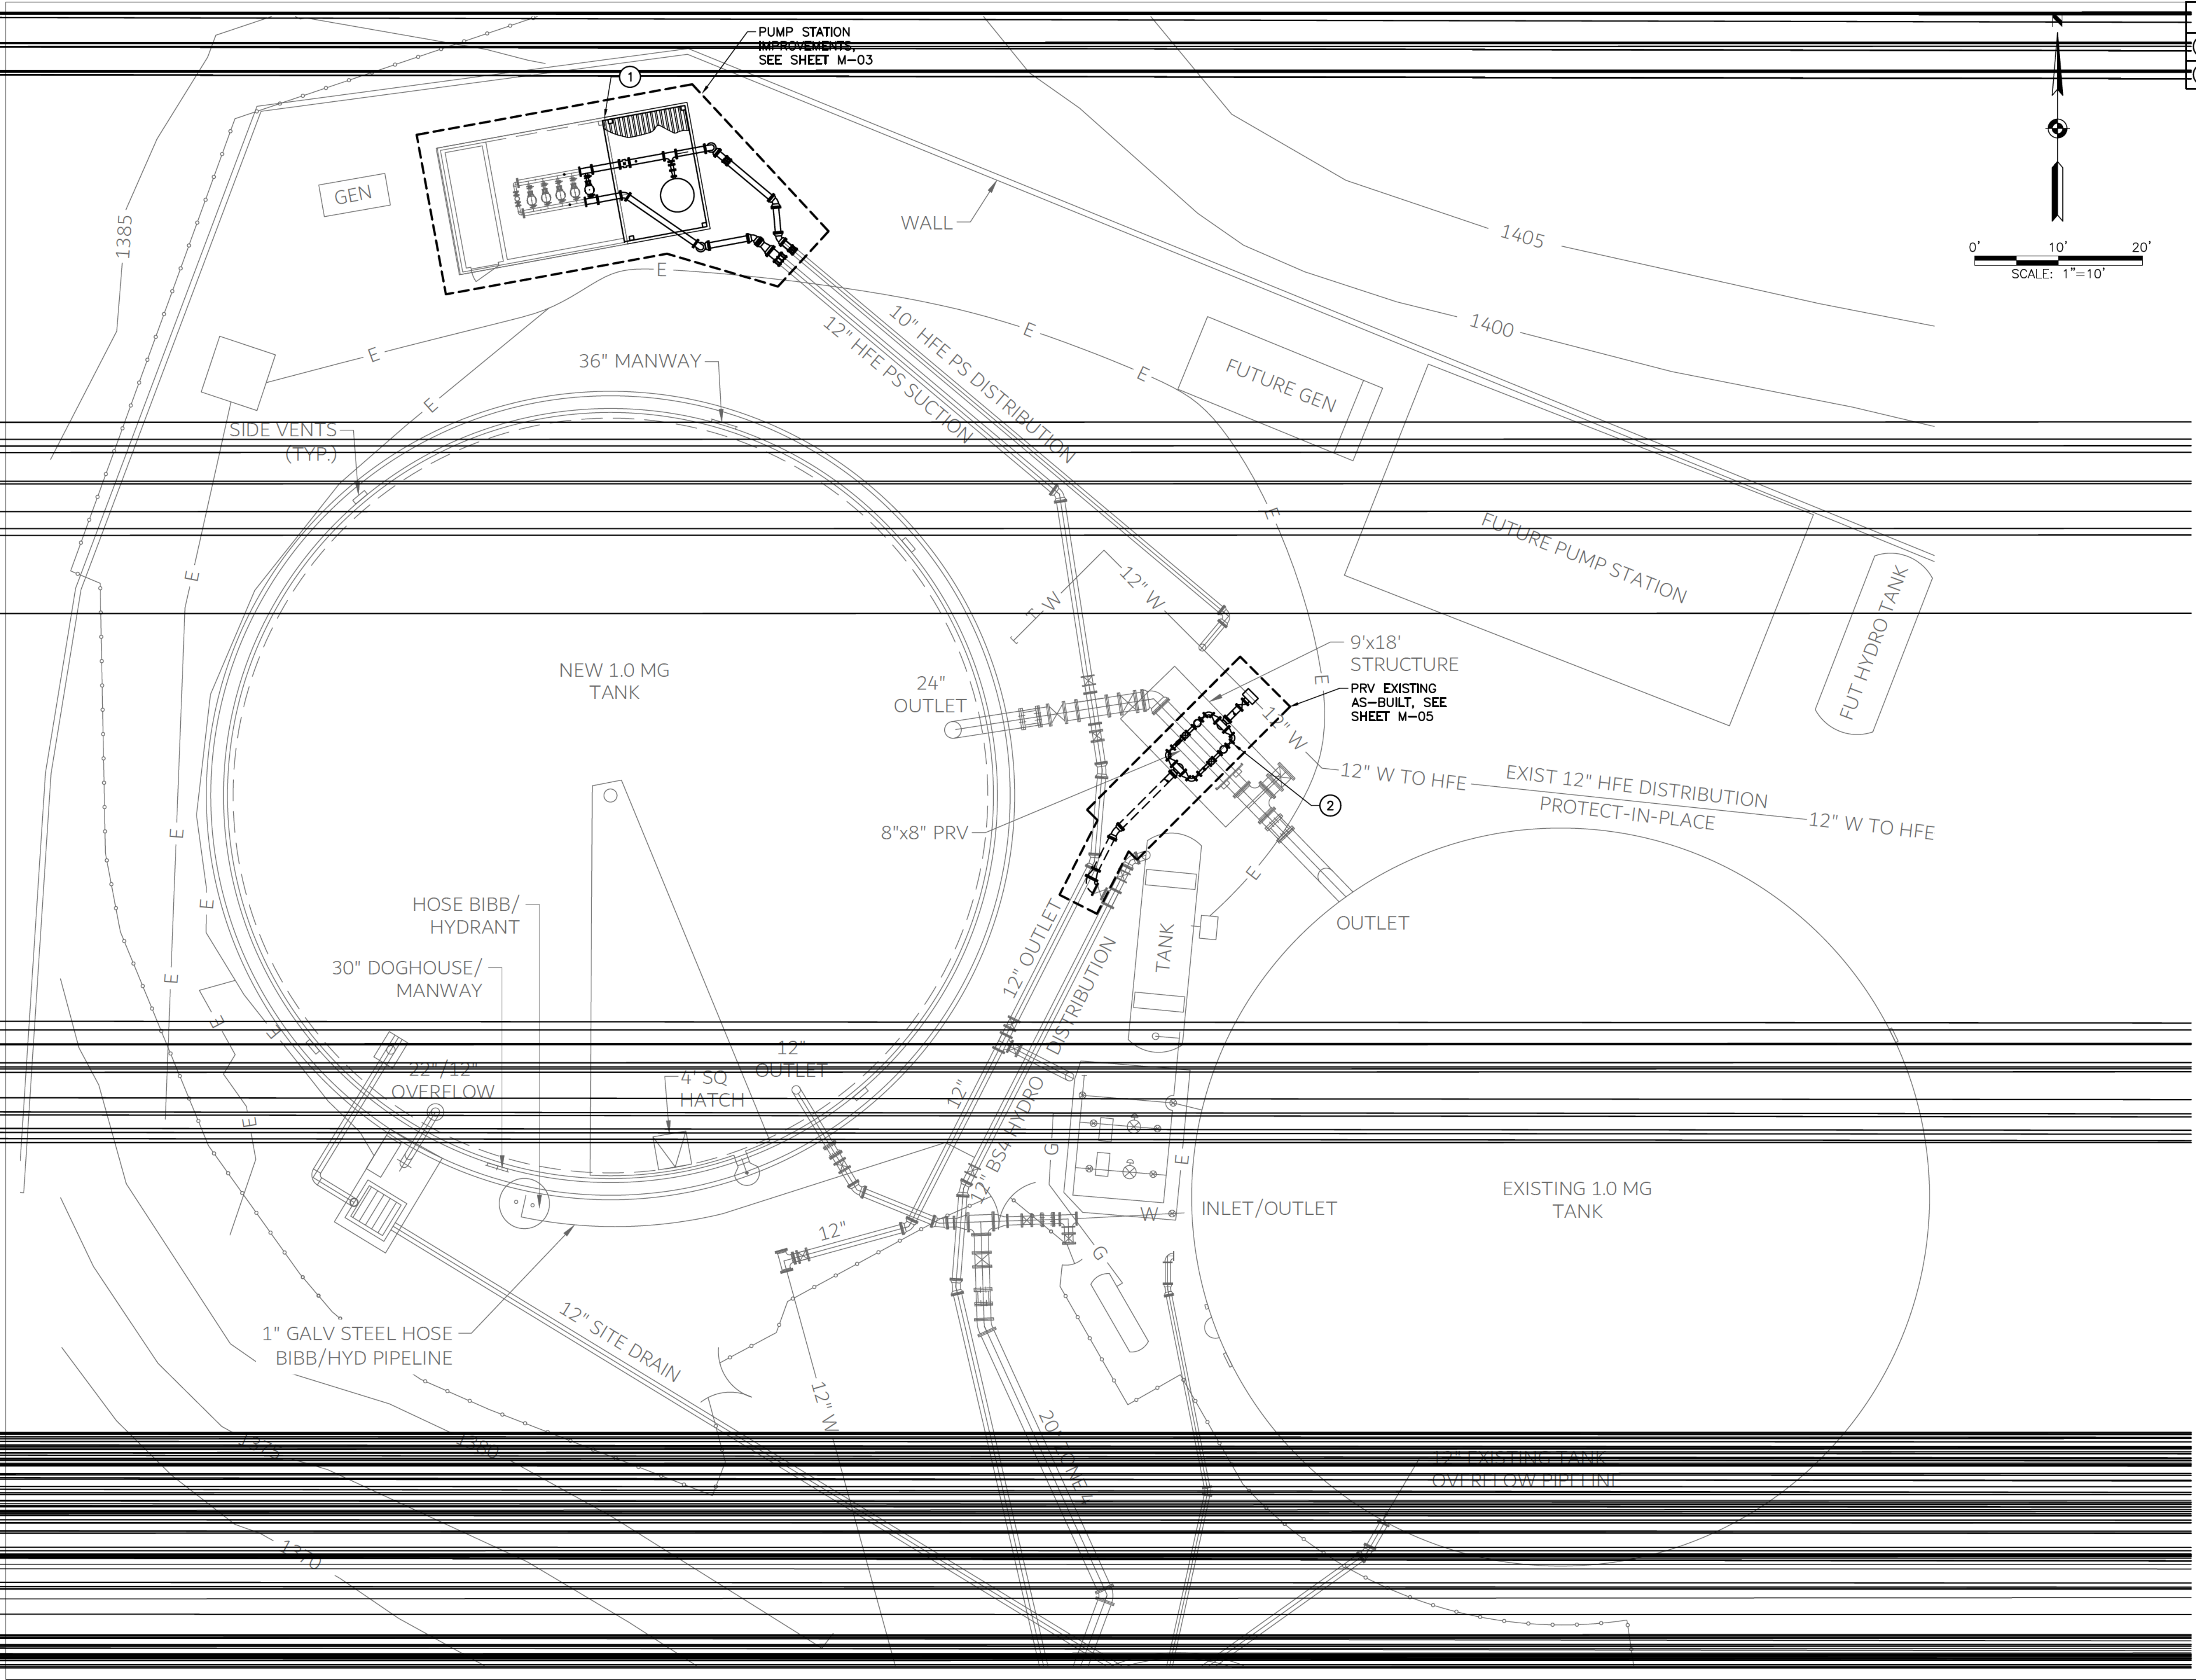


1	REVISION KEY
2	DATE
3	BY
4	DATE

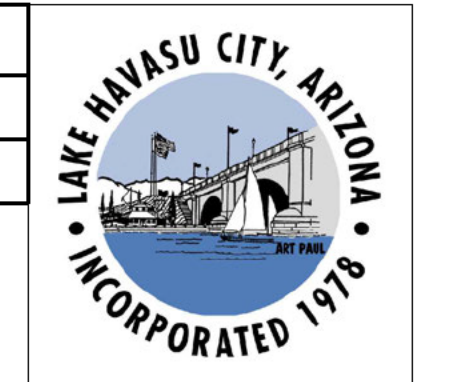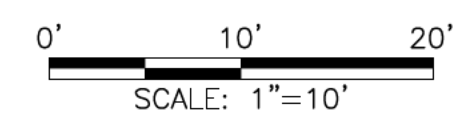

**LAKE HAVASU CITY**  
**BOOSTER STATION 4 IMPROVEMENTS**

Design by:	B
Drawn by:	KWB
Checked by:	RN
Date:	-1-
Dwg. scale:	A N T E D

**NEW FACILITIES**  
**SITE PLAN**

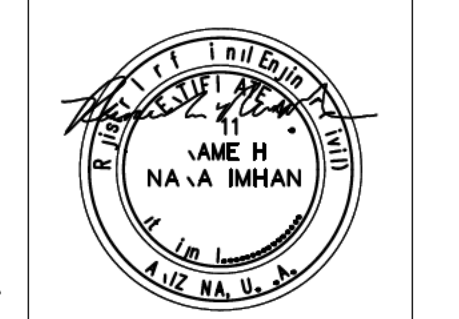



EXPLANATION: / / 4  
 sheet number: / / 4

**C-03**  
 h t f



City of Lake Havasu City  
 1111 N. Highway 89  
 Lake Havasu City, AZ 86403  
 Phone: 928.854.2100  
 Website: www.lakehavasu.com



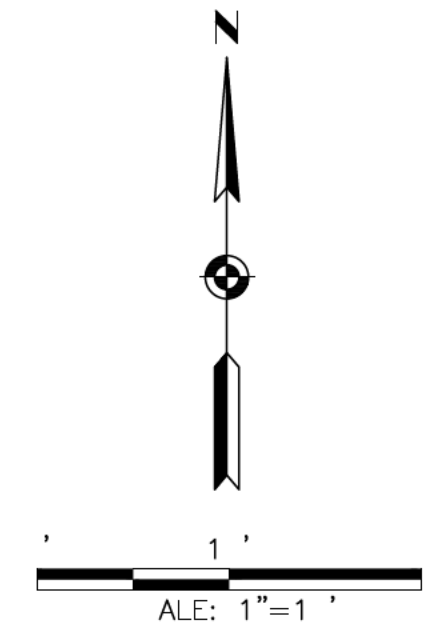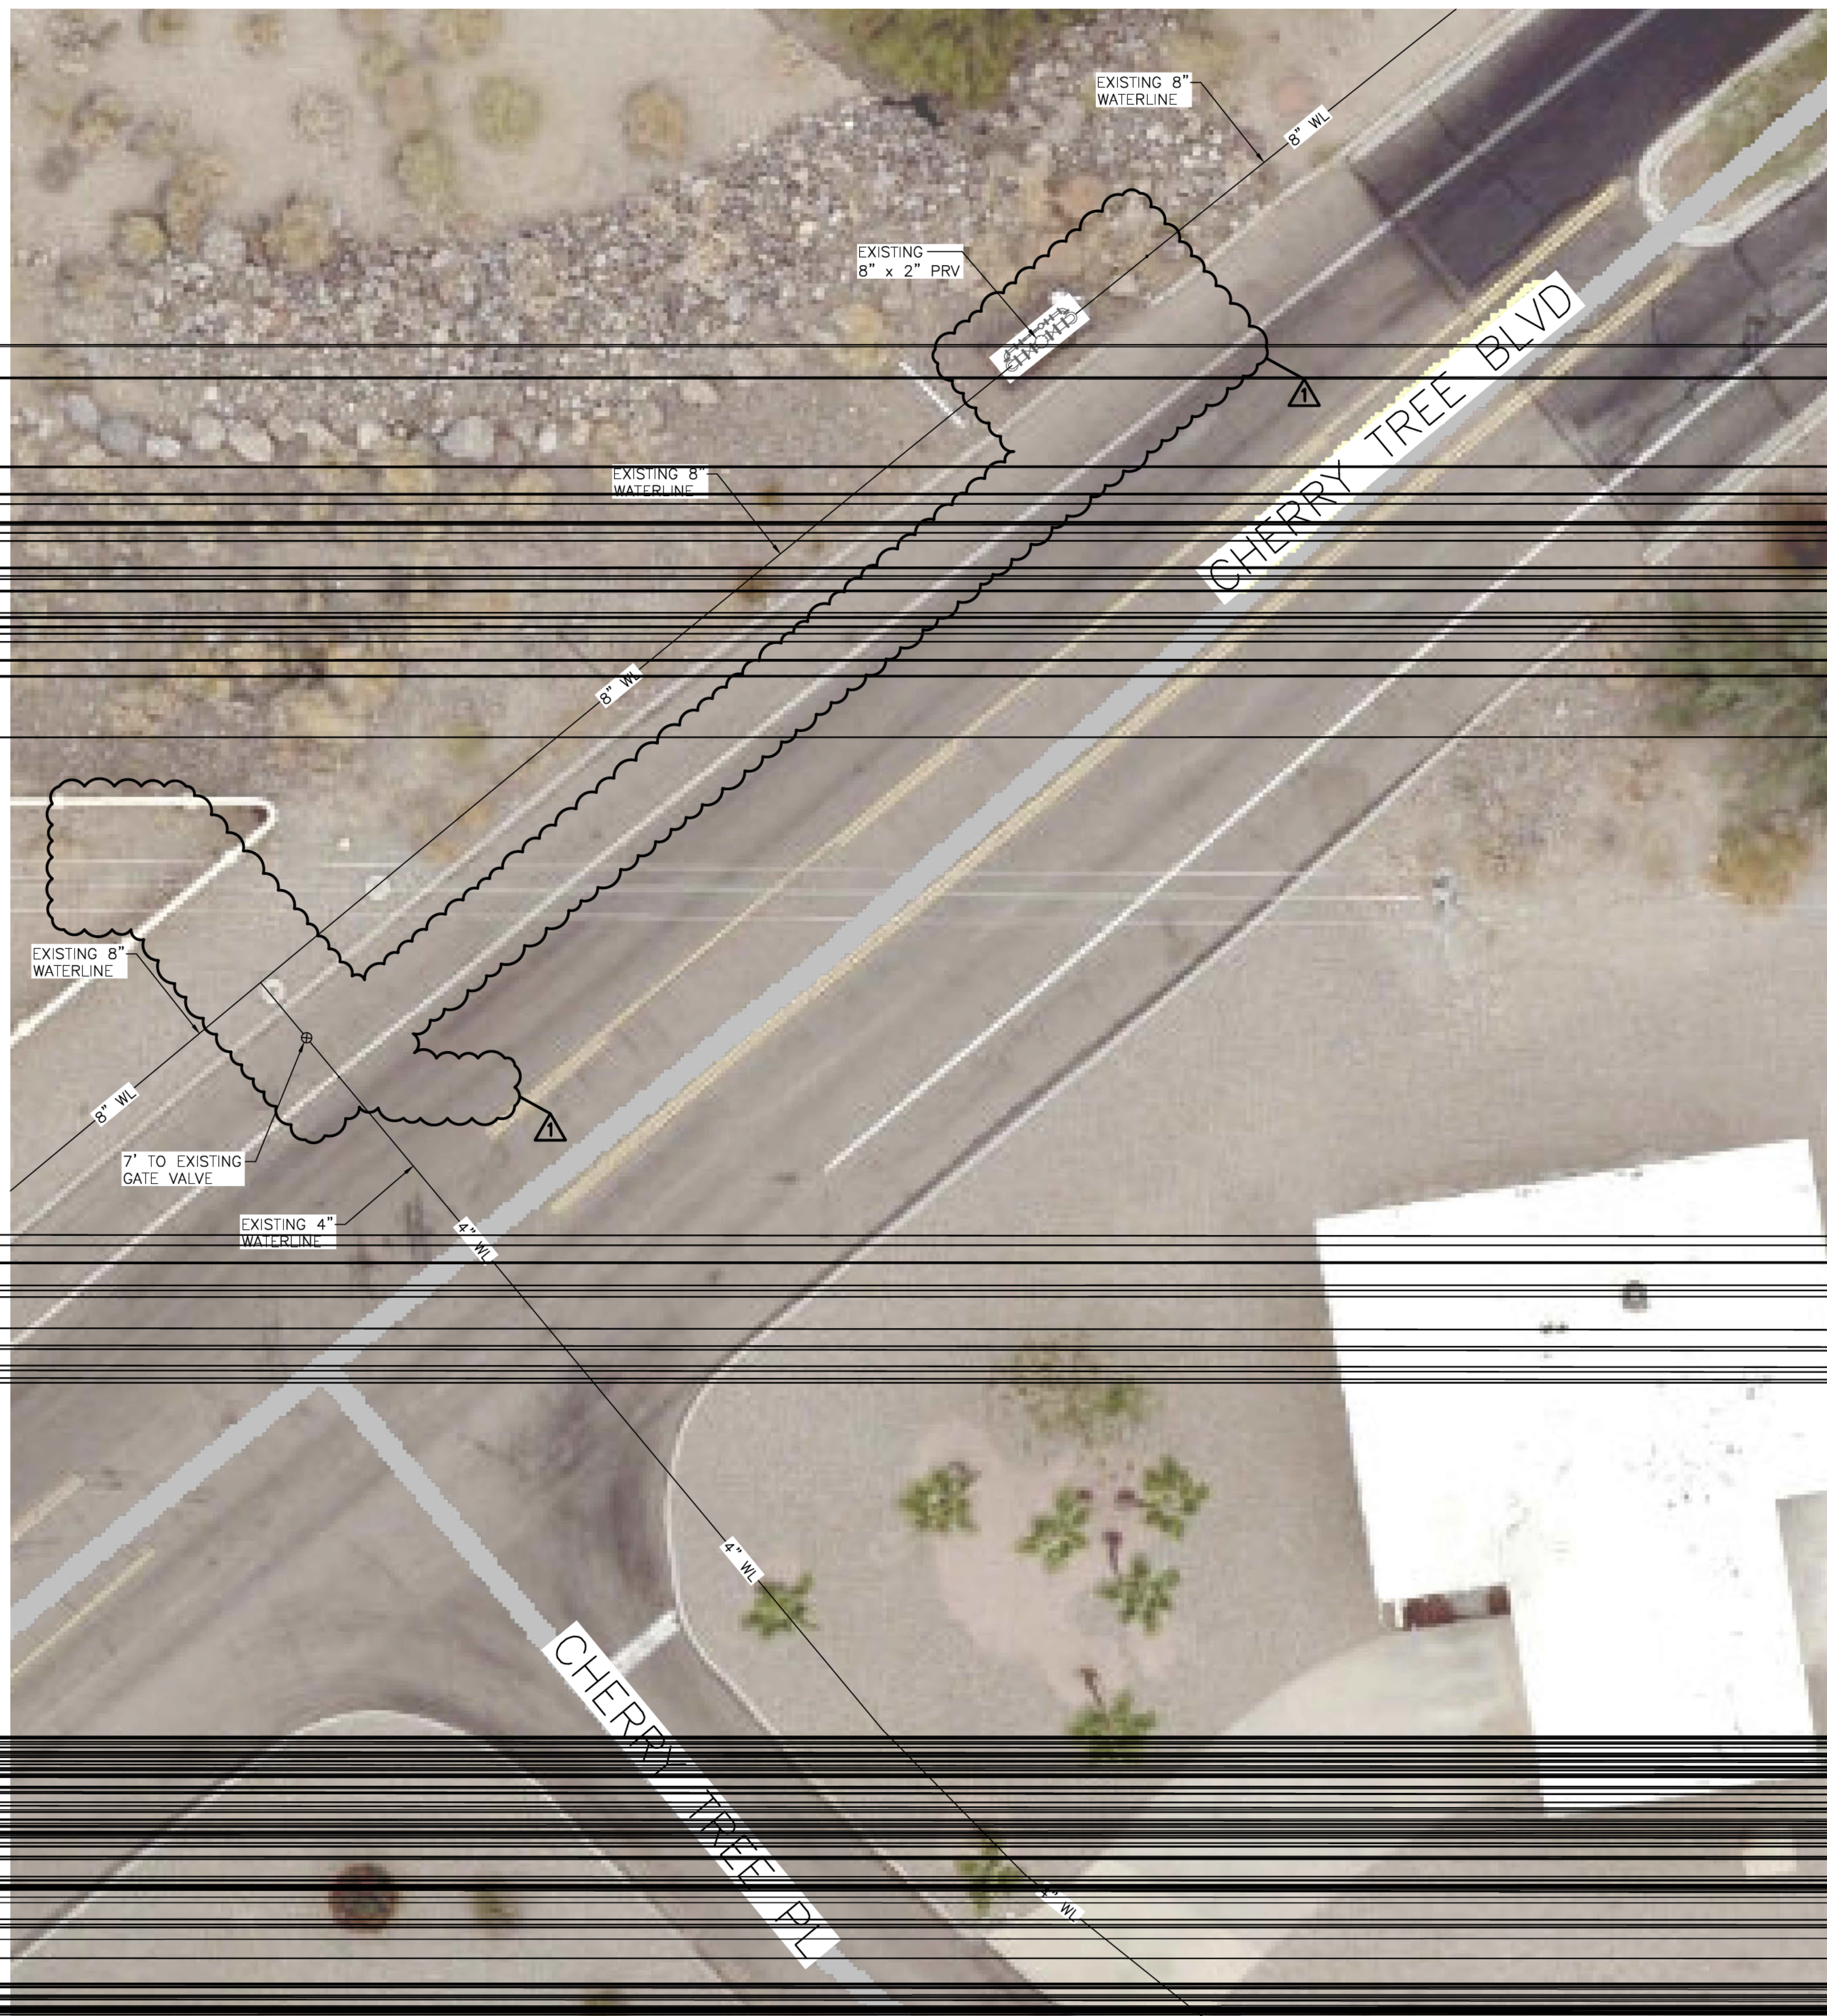

REVISION	DATE

**LAKE HAVASU CITY**  
**BOOSTER STATION 4 IMPROVEMENTS**

Designed by: KWB  
 Drawn by: RN  
 Checked by: RN  
 Date: -1-  
 Drawing: A N TED

**CHERRY TREE  
 BLVD PRV  
 ADDITION**






Sheet Number: **C-04**  
 of 7 sheets



Engineer  
 James H. Namhan  
 License No. 2117  
 State of Arizona  
 www.nj.com



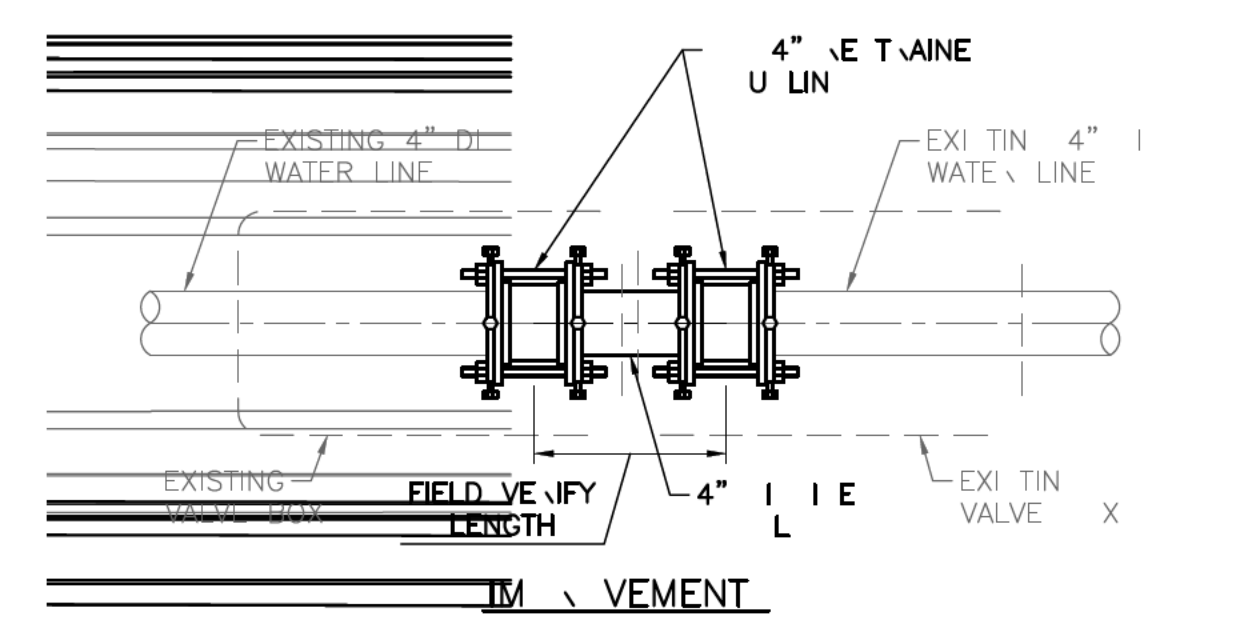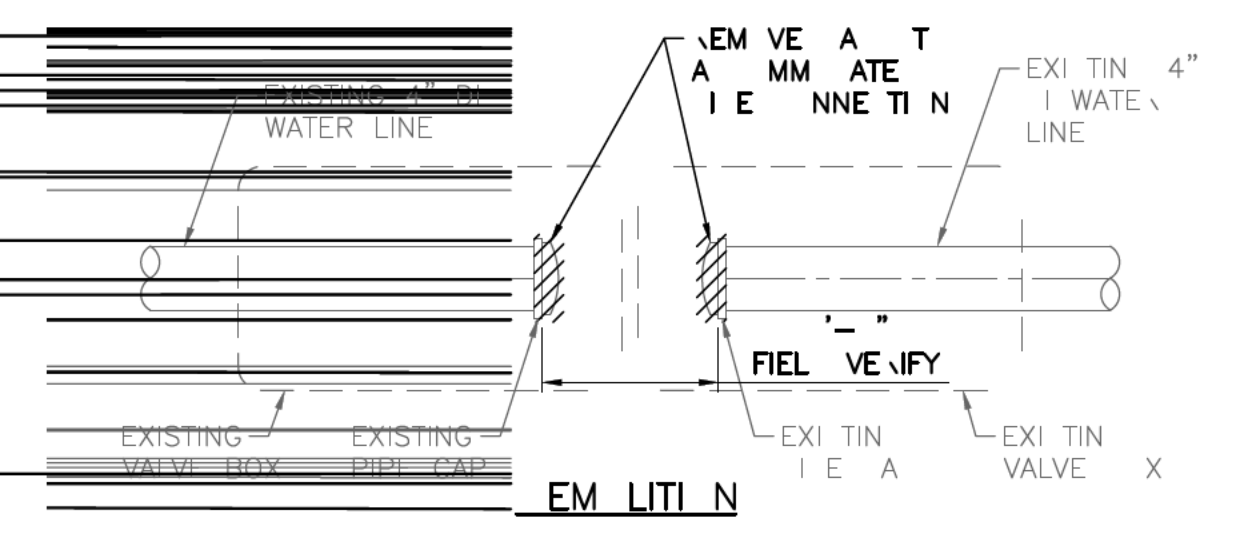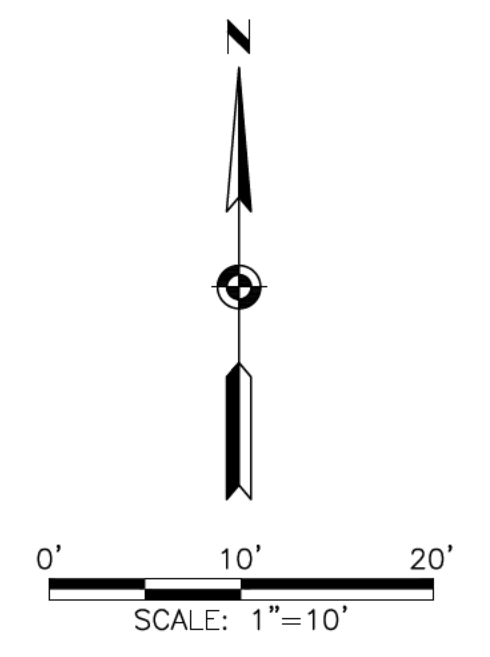

DETAIL  
SCALE: 1" = 1'-0"

FOR PIPING MODIFICATIONS, SEE DETAIL  
C-05 C-05

CHERRY TREE PL




DATE
REVISION /
BM I N
N.

LAKE HAVASU CITY  
BOOSTER STATION 4 IMPROVEMENTS


Designed by: B	Drawn by: KWB	Checked by: RN	Date: -1-	Dwg. scale: A N TED
----------------	---------------	----------------	-----------	---------------------

CHERRY TREE PL  
PIPING  
MODIFICATION  
PLAN AND DETAIL

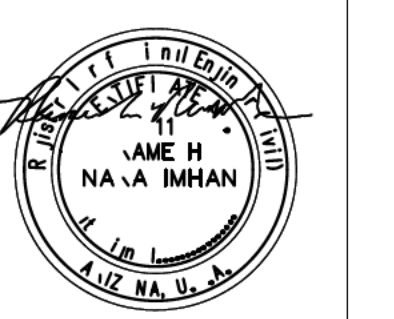

Sheet Number: / / 4


C-05  
Sheet

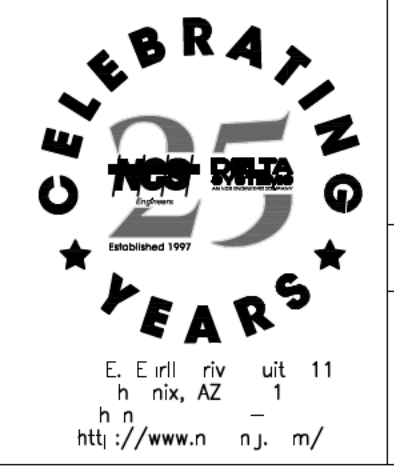





HEMATI	YM L LE EN :
	AI \ M \ E \
	AI \ VA VALVE
	UTTE \ FLY VALVE
	HE K VALVE
	E \ UI MENT TA \ NUM E \
	MA NETI FL W METE \
	\ E \ U \ E \ AU E
	\ E \ U \ E \ \ E \ U IN VALVE
	\ E \ U \ E \ WIT H HI H
	\ E \ U \ E \ WIT H L W L W
	\ E \ U \ E \ T \ AN MITTE \
	UM
	TANK LEVEL T \ AN MITTE \


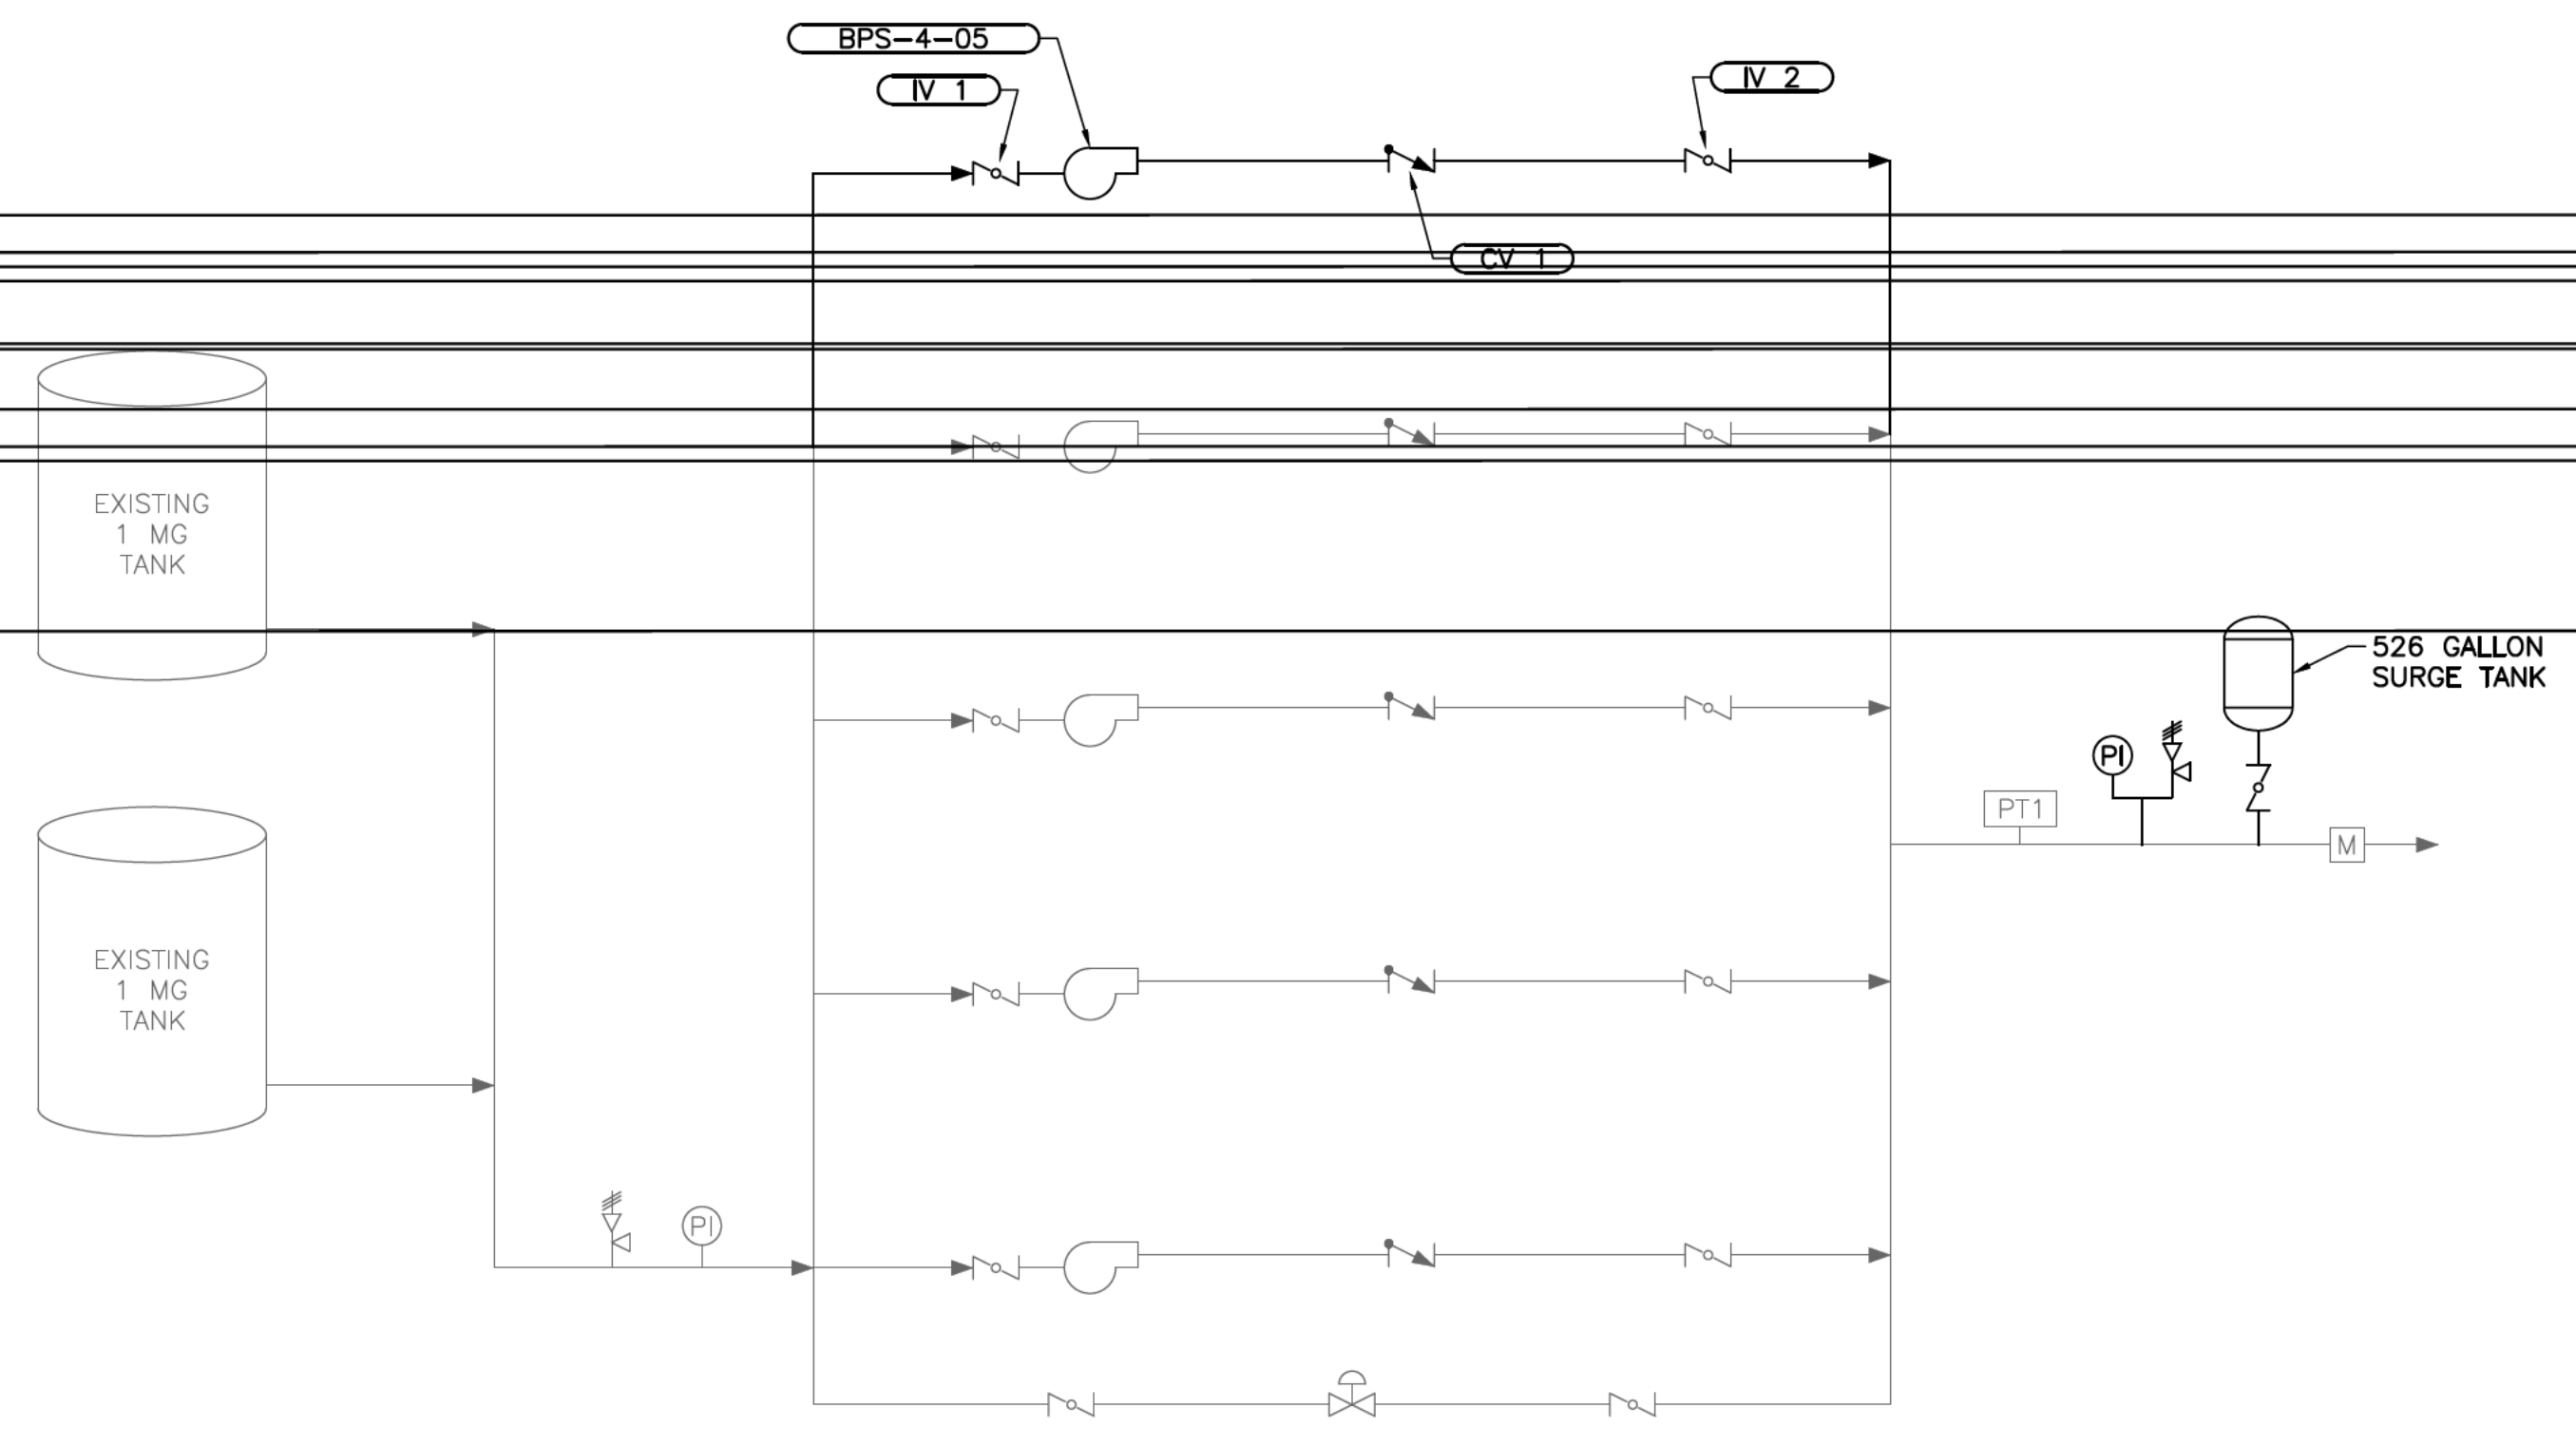


FACILITY SCHEMATIC

LAKE HAVASU CITY  
 BOOSTER STATION 4 IMPROVEMENTS

Design d by: B	KWB
Drawn by:	RN
Checked by:	-1-
Date:	DATE
Dwg scale:	AS NOTED


FACILITY SCHEMATIC

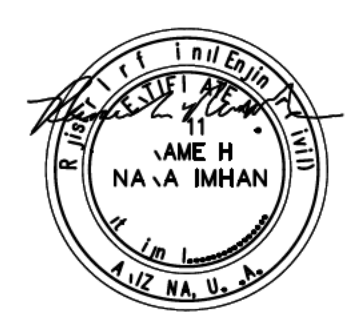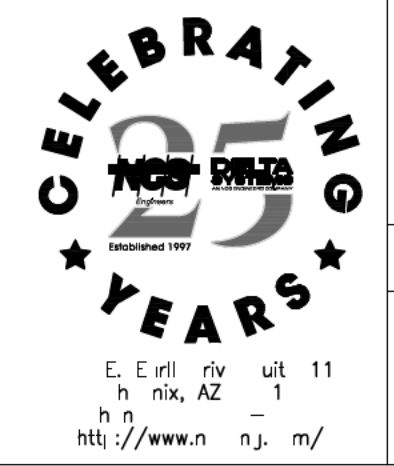

EX I \ ATI N \ ATE: / / 4  
 h t Numl r:  
**M-01**  
 h t f




EM LIT I N KEY N TE	
1	EM VE AN E LA E " FL W METE
2	EM VE 1 E MENT F " I IN
3	EM VE EXI TIN ALL N U E TANK AN I IN
4	EM VE " I EN
5	EM VE 4 " MJ EN
6	EM VE 4 " MJ EN
7	EM VE 4 " MJ EN
8	EM VE E U E AU E
9	EM VE AI E LEA E VALVE
N TE :	
1. ----	

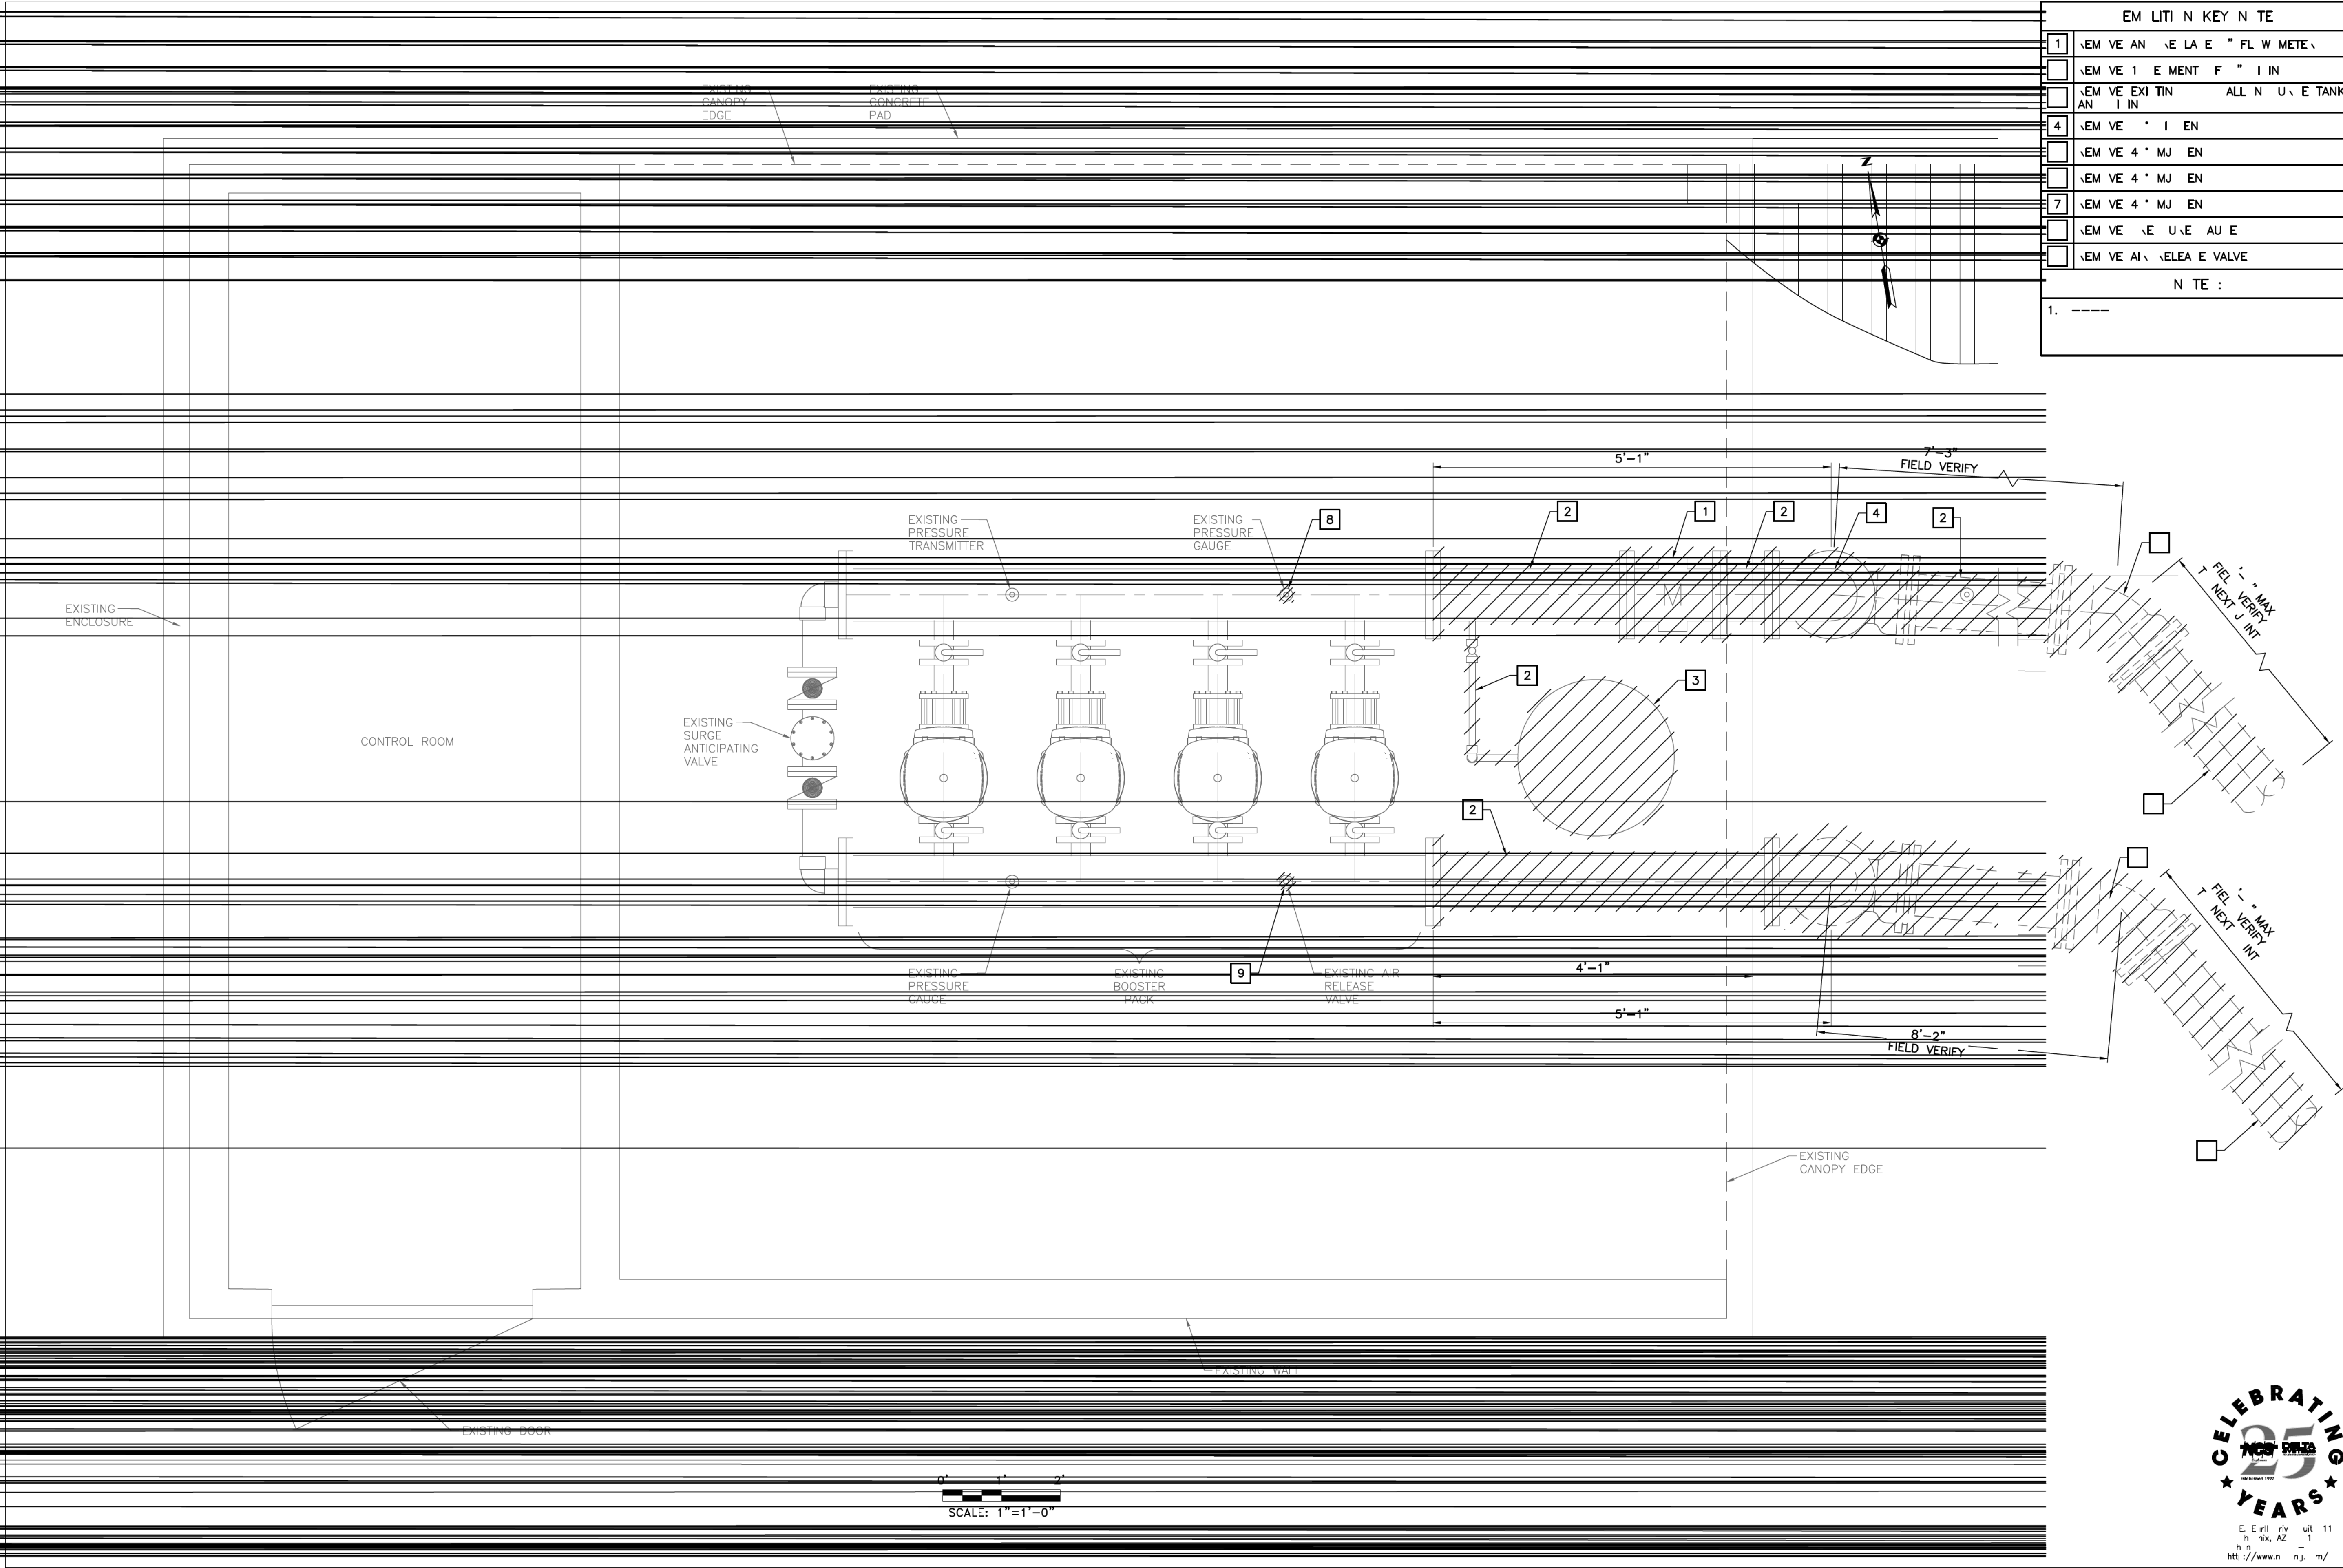

LAKE HAVASU CITY  
 BOOSTER STATION 4 IMPROVEMENTS


D sign d byB KWB  
 Drawn by: KWB  
 h ck d by: RN  
 Dct: -1-  
 Dwg scd: A N TED

BOOSTER PUMP  
 STATION  
 DEMOLITION PLAN

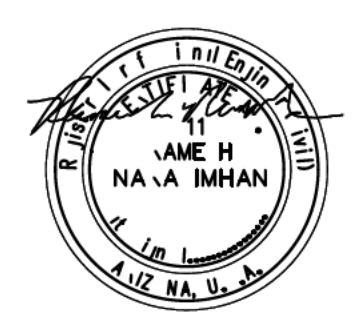


EX IATI N ATE: / / 4  
 h t Numl r:

M-02  
 h t 1 f

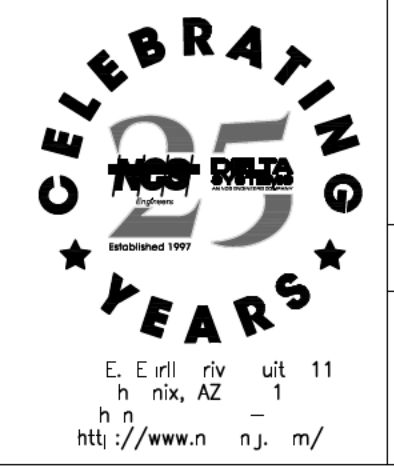


E. E. riv ut 11  
 h nix, AZ 1  
 h n  
 http://www.n nj. m/



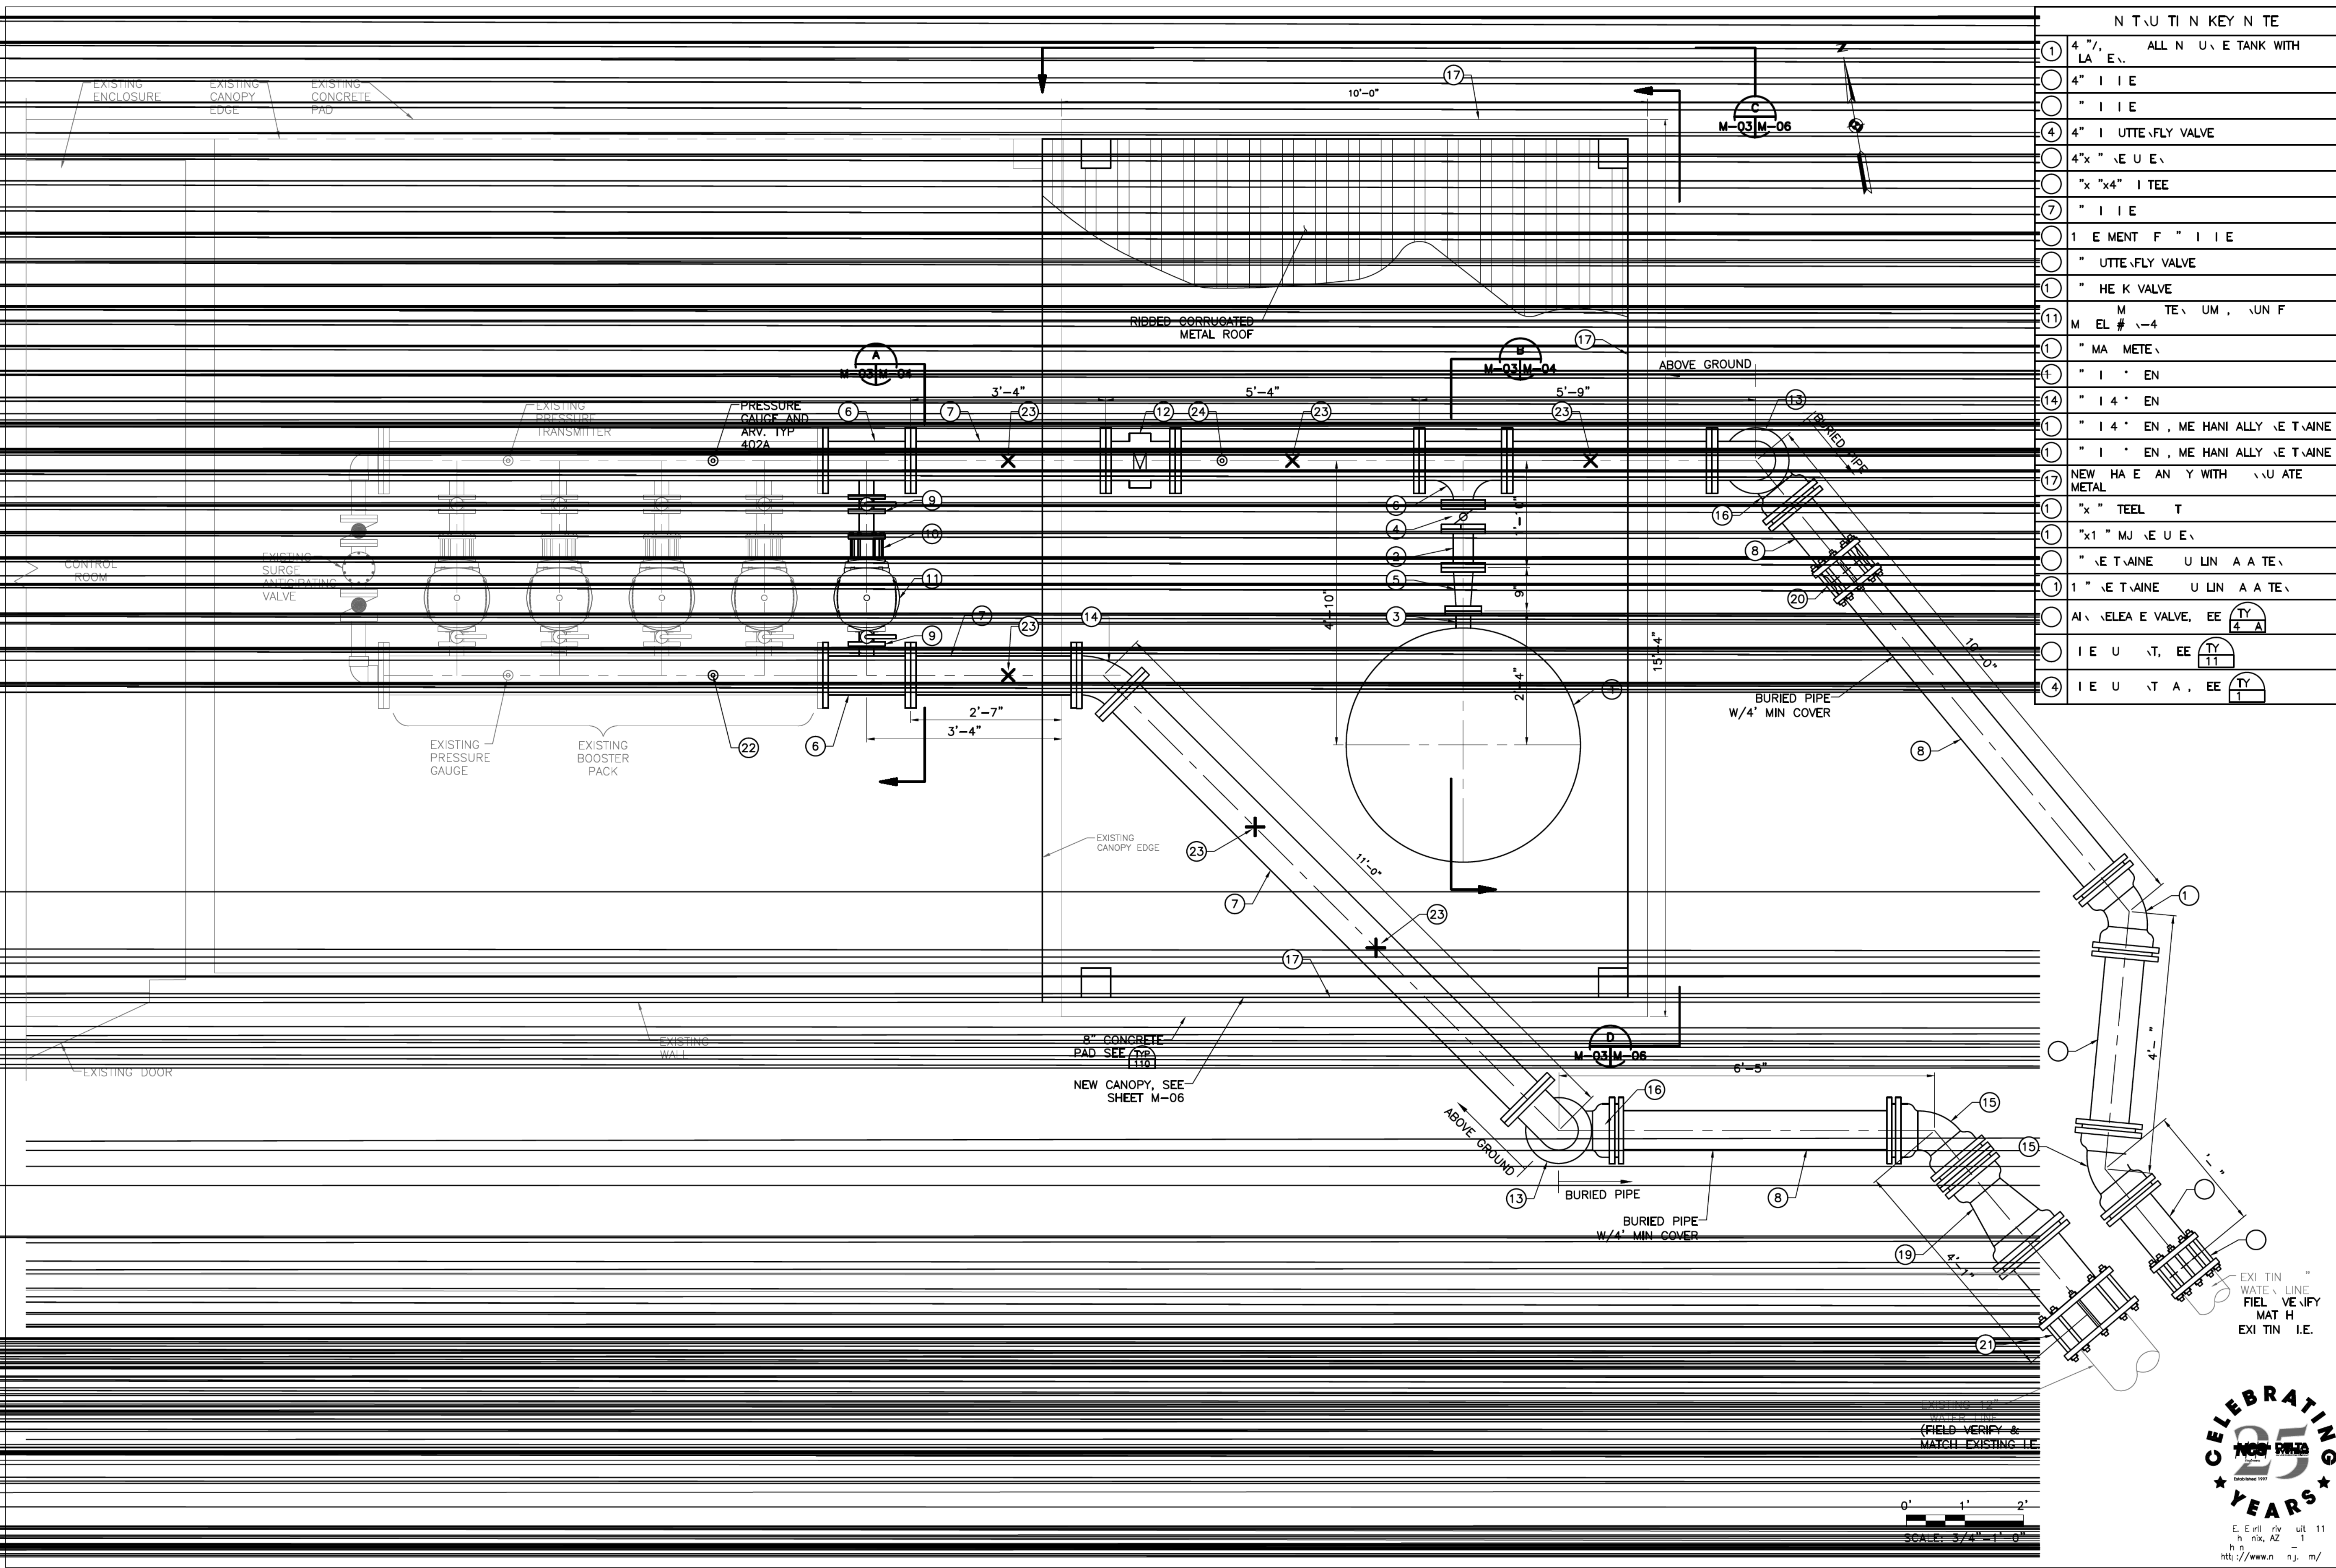

NOTATION KEY	
①	4" ILLUMINATED TANK WITH LAMP
②	4" ILLUMINATED
③	4" ILLUMINATED
④	4" ILLUMINATED VALVE
⑤	4" ILLUMINATED
⑥	4" ILLUMINATED TEE
⑦	4" ILLUMINATED
⑧	4" ILLUMINATED
⑨	4" ILLUMINATED
⑩	4" ILLUMINATED
⑪	4" ILLUMINATED
⑫	4" ILLUMINATED
⑬	4" ILLUMINATED
⑭	4" ILLUMINATED
⑮	4" ILLUMINATED
⑯	4" ILLUMINATED
⑰	4" ILLUMINATED
⑱	4" ILLUMINATED
⑲	4" ILLUMINATED
⑳	4" ILLUMINATED
㉑	4" ILLUMINATED
㉒	4" ILLUMINATED
㉓	4" ILLUMINATED

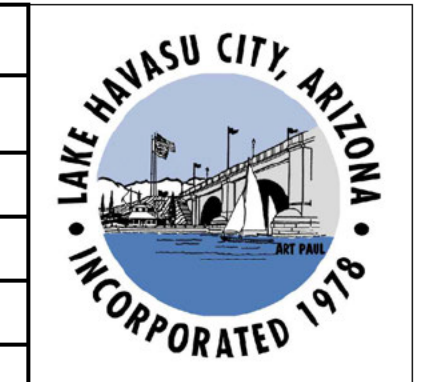

**LAKE HAVASU CITY**  
**BOOSTER STATION 4 IMPROVEMENTS**

Design by:	B
Drawn by:	KWB
Checked by:	RN
Date:	-1-
Dwg. scale:	A. N. T. D.

**BOOSTER PUMP STATION IMPROVEMENTS PLAN**

CELEBRATING 25 YEARS

EXISTING DATE: / / 4

Sheet Number: **M-03**

of 11 sheets



EXISTING WATER LINE FIELD VERIFY MATCH EXISTING I.E.


(FIELD VERIFY & MATCH EXISTING I.E.)




NOTATION KEY NOTE	
①	4" I.P.E. ALL N.U.E. TANK WITH LA E.
②	" I I E
③	4" I I E
④	"x "x4" I TEE
⑤	4" I UTTE.FLY VALVE
⑥	4"x " U E.
⑦	"x4" I TEE
⑧	1'x1'-4"x " N UETE A, EE TY 11
⑨	" UTTE.FLY VALVE
⑩	" HE K VALVE
⑪	M UTE, U M, U N F M EL # -4

NOTE :


1. ----

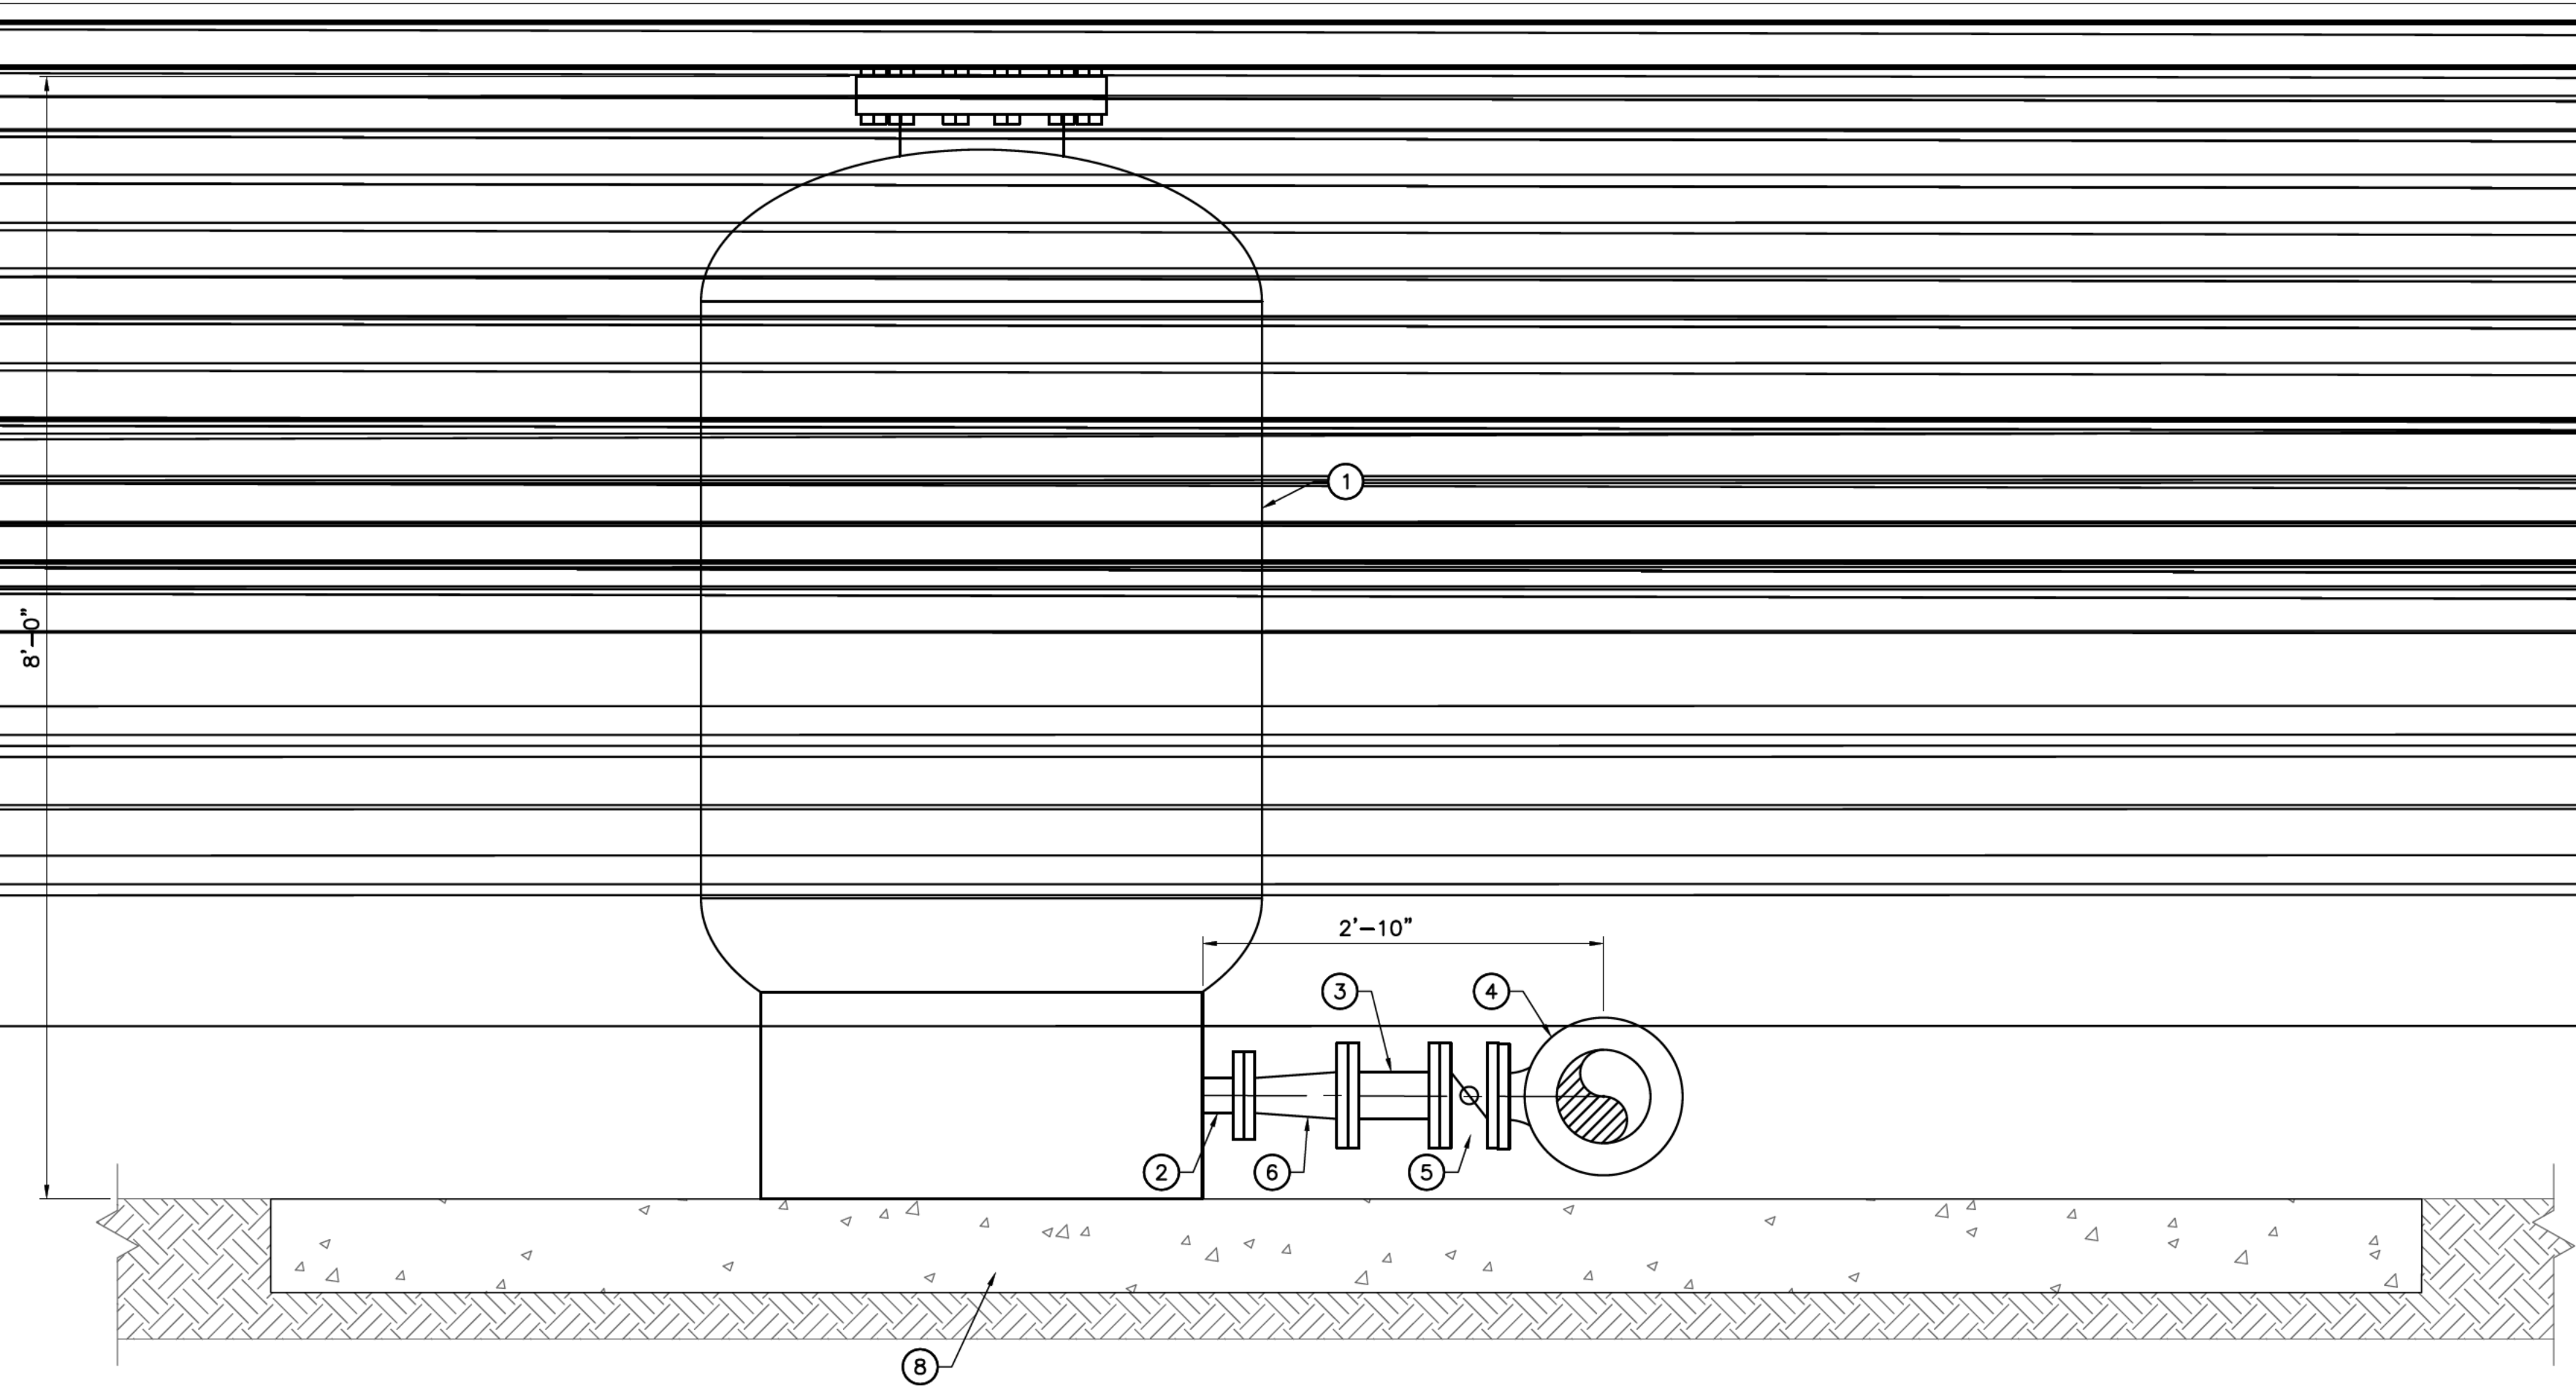

SECTION B  
SCALE: 1/2"=1'-0" M-03 M-04

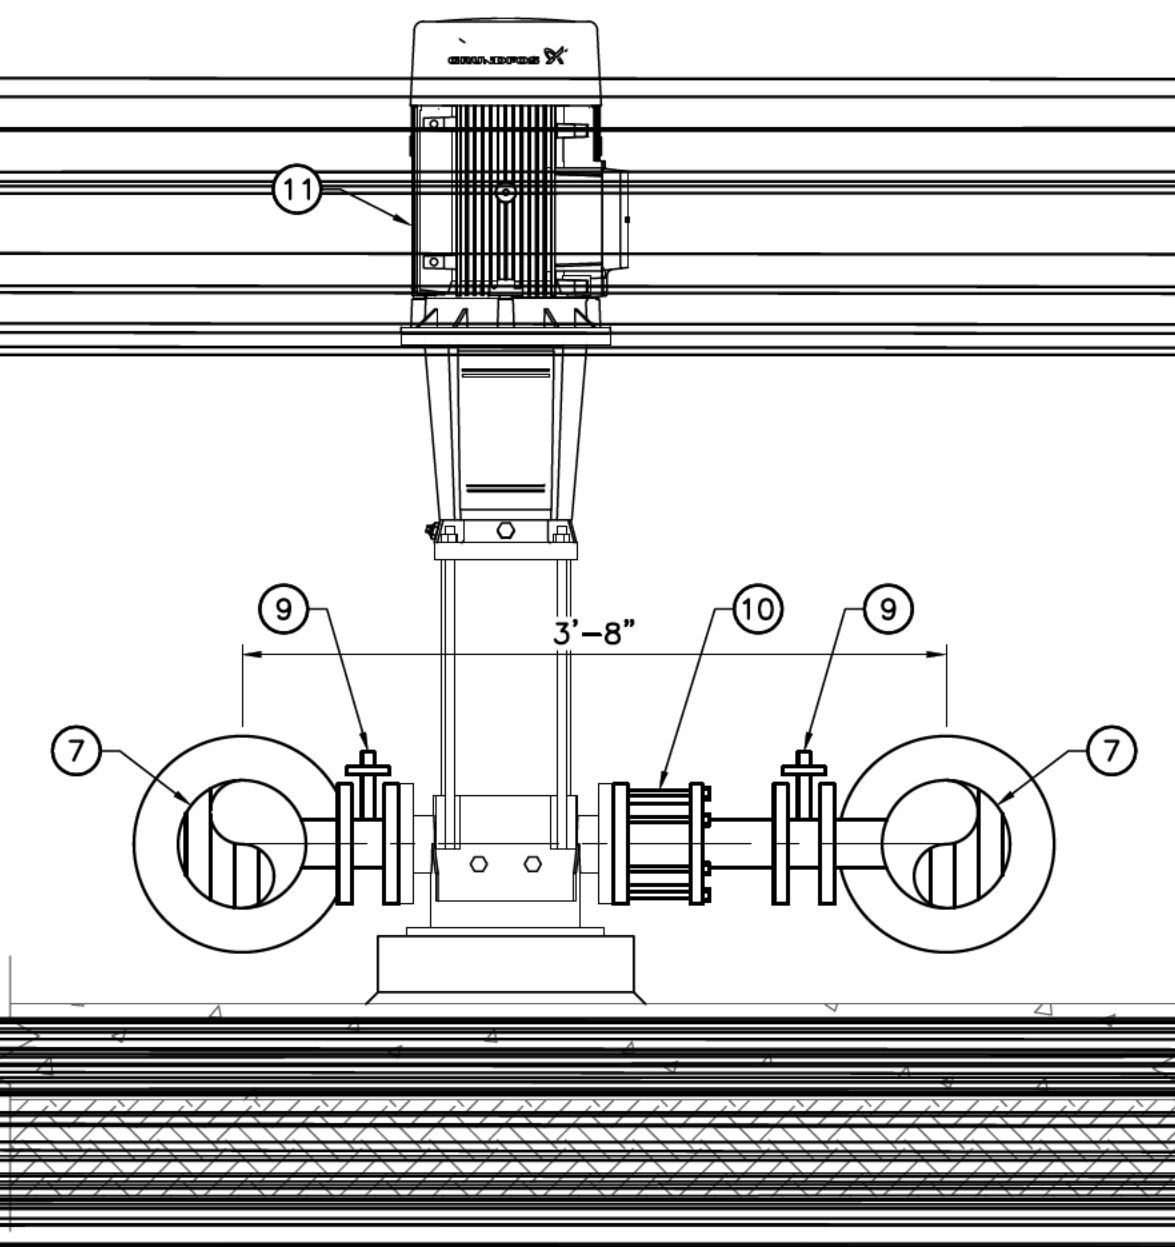

SECTION A  
SCALE: 1/2"=1'-0" M-03 M-04

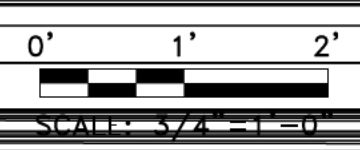

NO.	REVISION /	DATE

LAKE HAVASU CITY  
BOOSTER STATION 4 IMPROVEMENTS

Designed by:	B
Drawn by:	KWB
Checked by:	RN
Date:	-1-
Dwg. scale:	A N TED

BOOSTER PUMP  
STATION SECTIONS




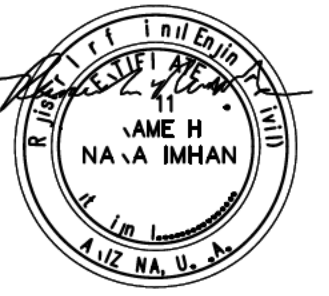


EXHIBIT DATE: / / 4  
Sheet No: M-04  
of 1

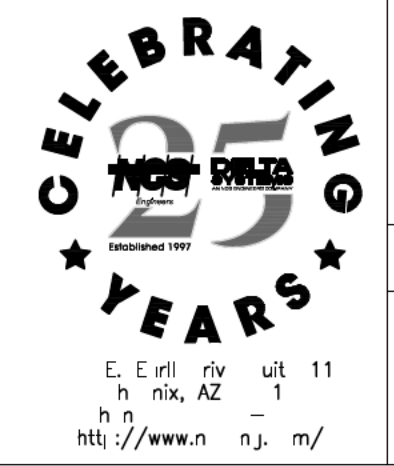

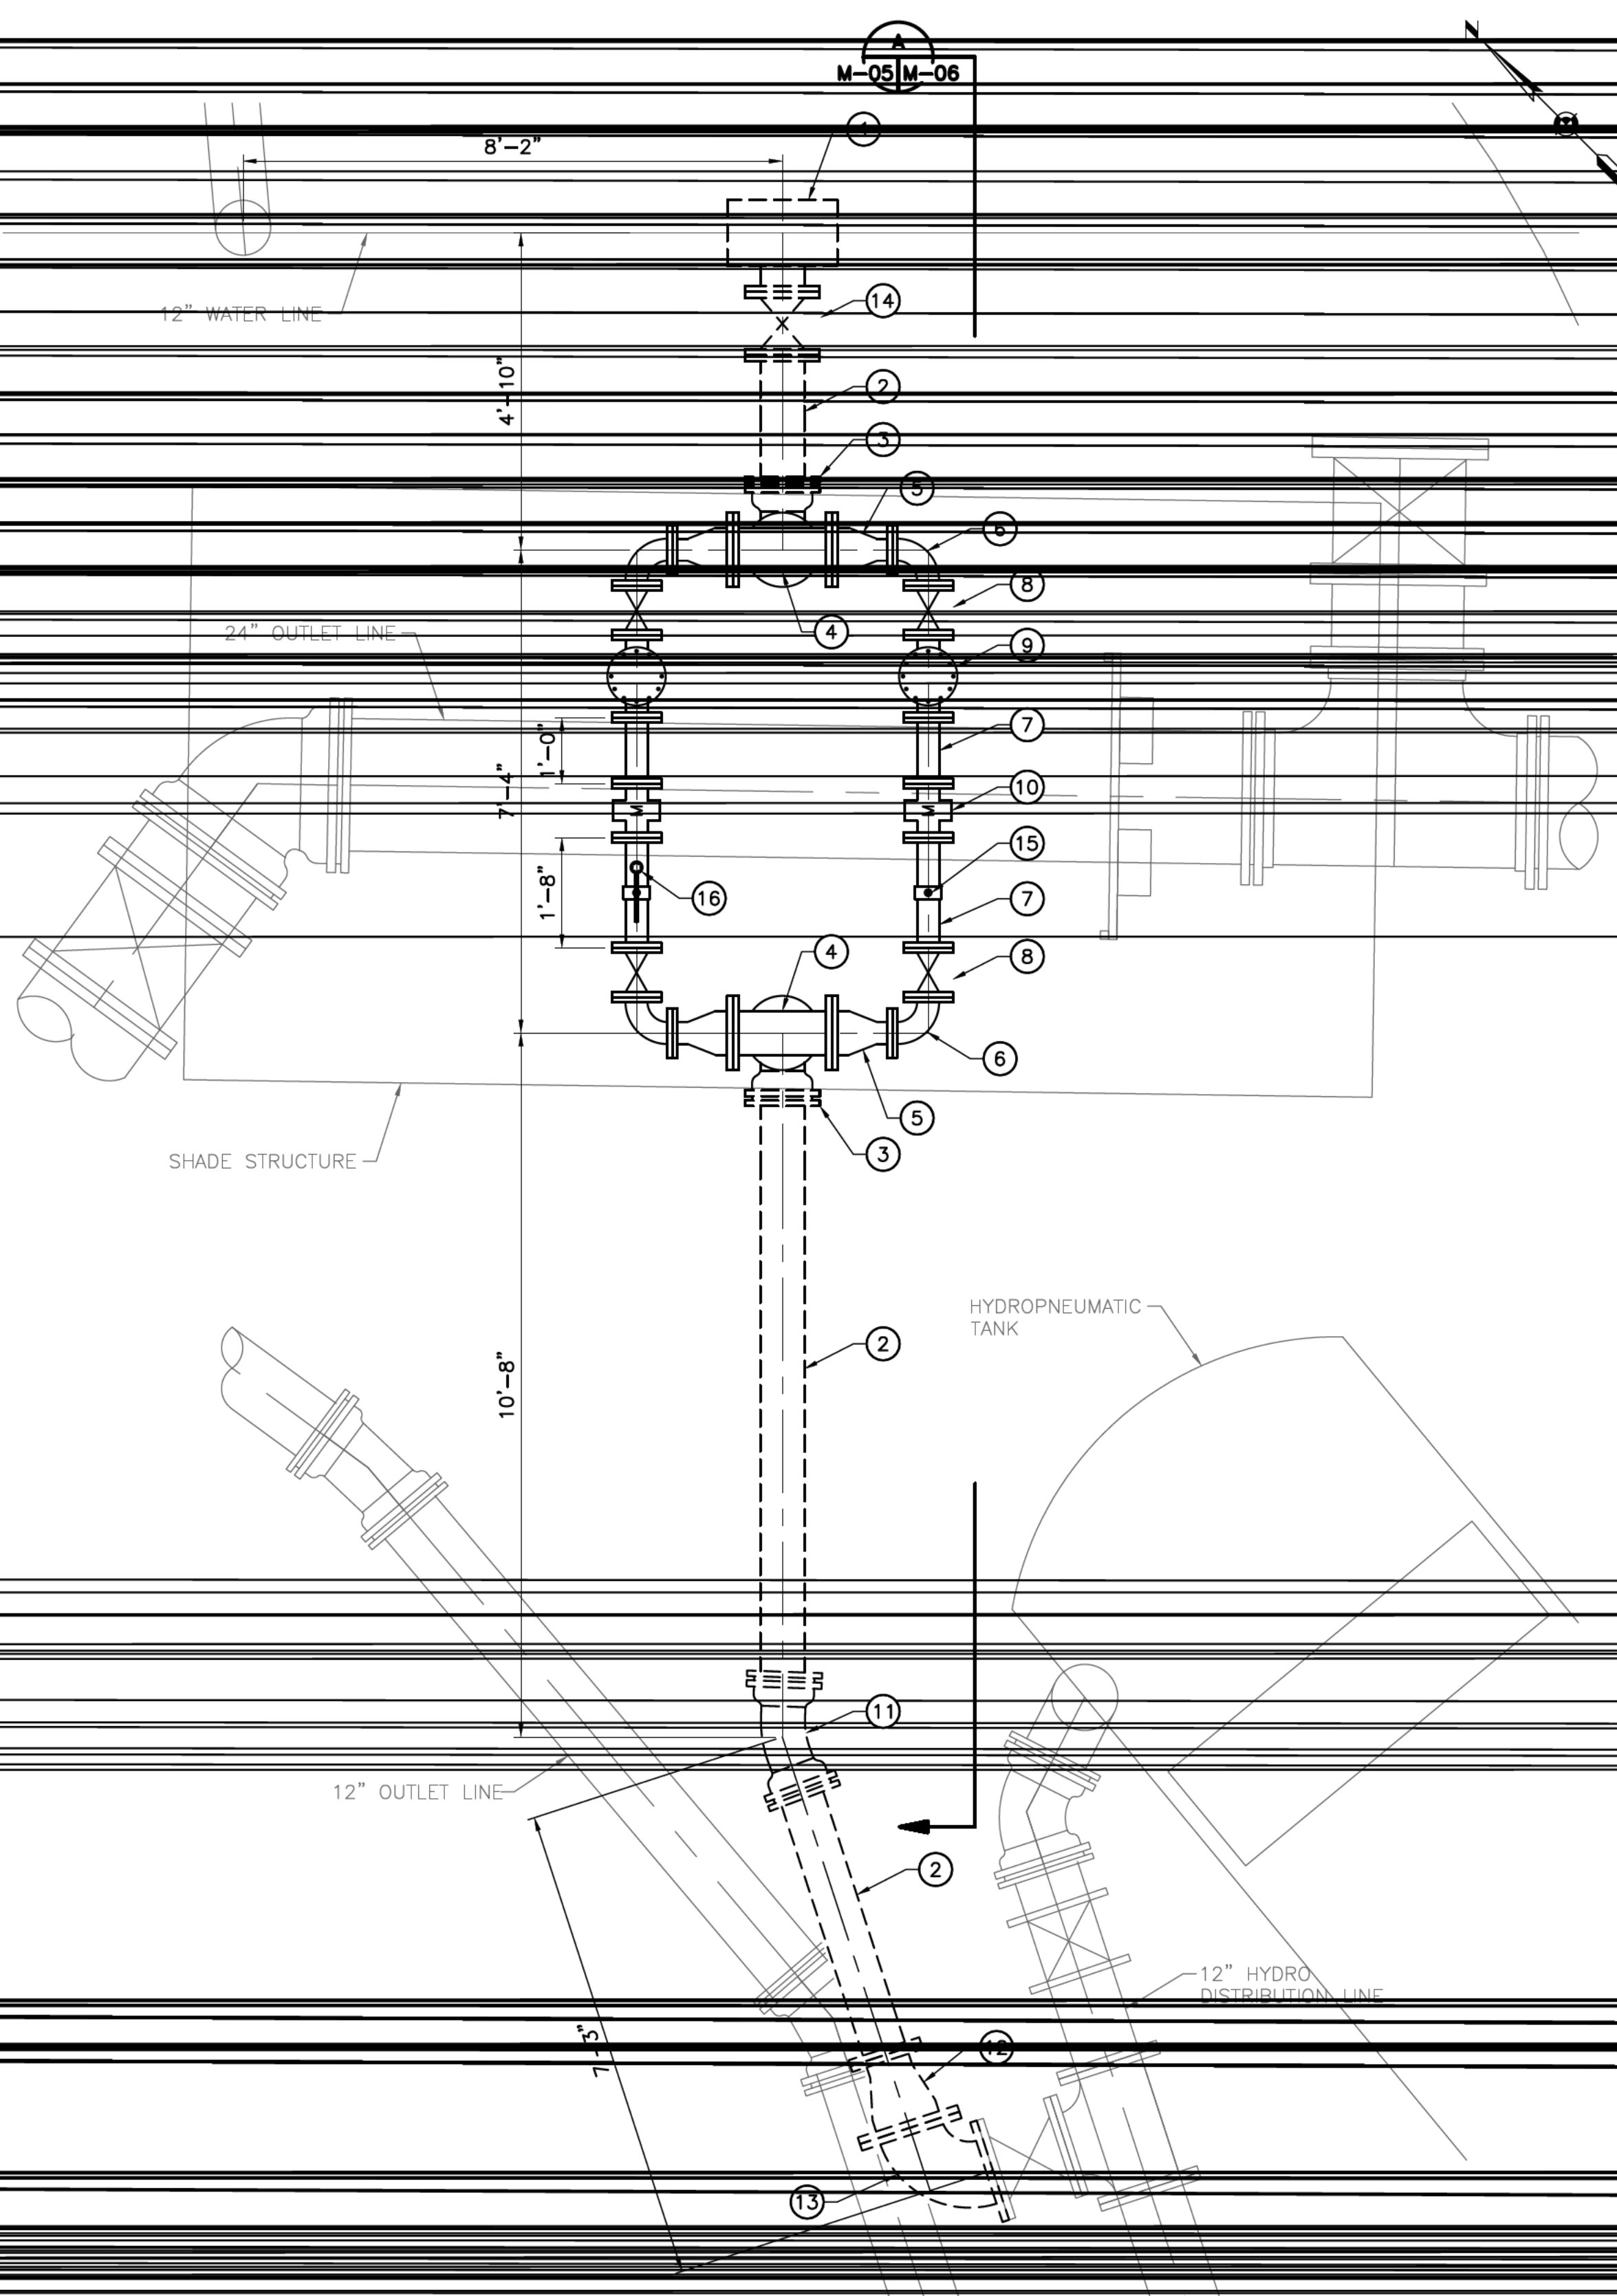

KEY NOTE	
1	1"x" H T T A LEEVE
2	" I I E
3	" I ' EN , ME HANI AL E T AINE
4	" I TEE
5	"x4" I E U E \
6	4" I ' EL W
7	4" I I E
8	4" I ATE VALVE
9	4" I E U E \ E U IN VALVE
10	4" I FL W METE \
11	" ' EN , ME HANI ALLY E T AINE
12	1"x" E U E \ , ME HANI ALLY E T AINE
13	1" ' EN , ME HANI ALLY E T AINE
14	" I ATE VALVE
15	4" E U E T A N U E \ WITH AU E
16	E U E AU E

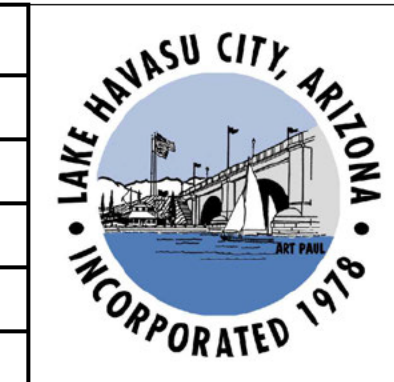

NO.	REVISION /	DATE

LAKE HAVASU CITY  
 BOOSTER STATION 4 IMPROVEMENTS

Designed by:	B
Drawn by:	KWB
Checked by:	RN
Date:	-1-
Dwg. scale:	A N TED

PRV STATION  
 PLANS





EX I A T I N A T E : / / 4  
 h t Numl r :  
**M-05**  
 h t 1 f

F \ E \ E  
 \AWIN U \ E


N T IN NT A T

HYDRO ZONE PRV PLAN  
 SCALE: 1/8" = 1'-0"

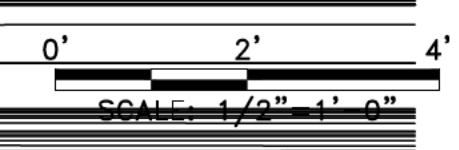


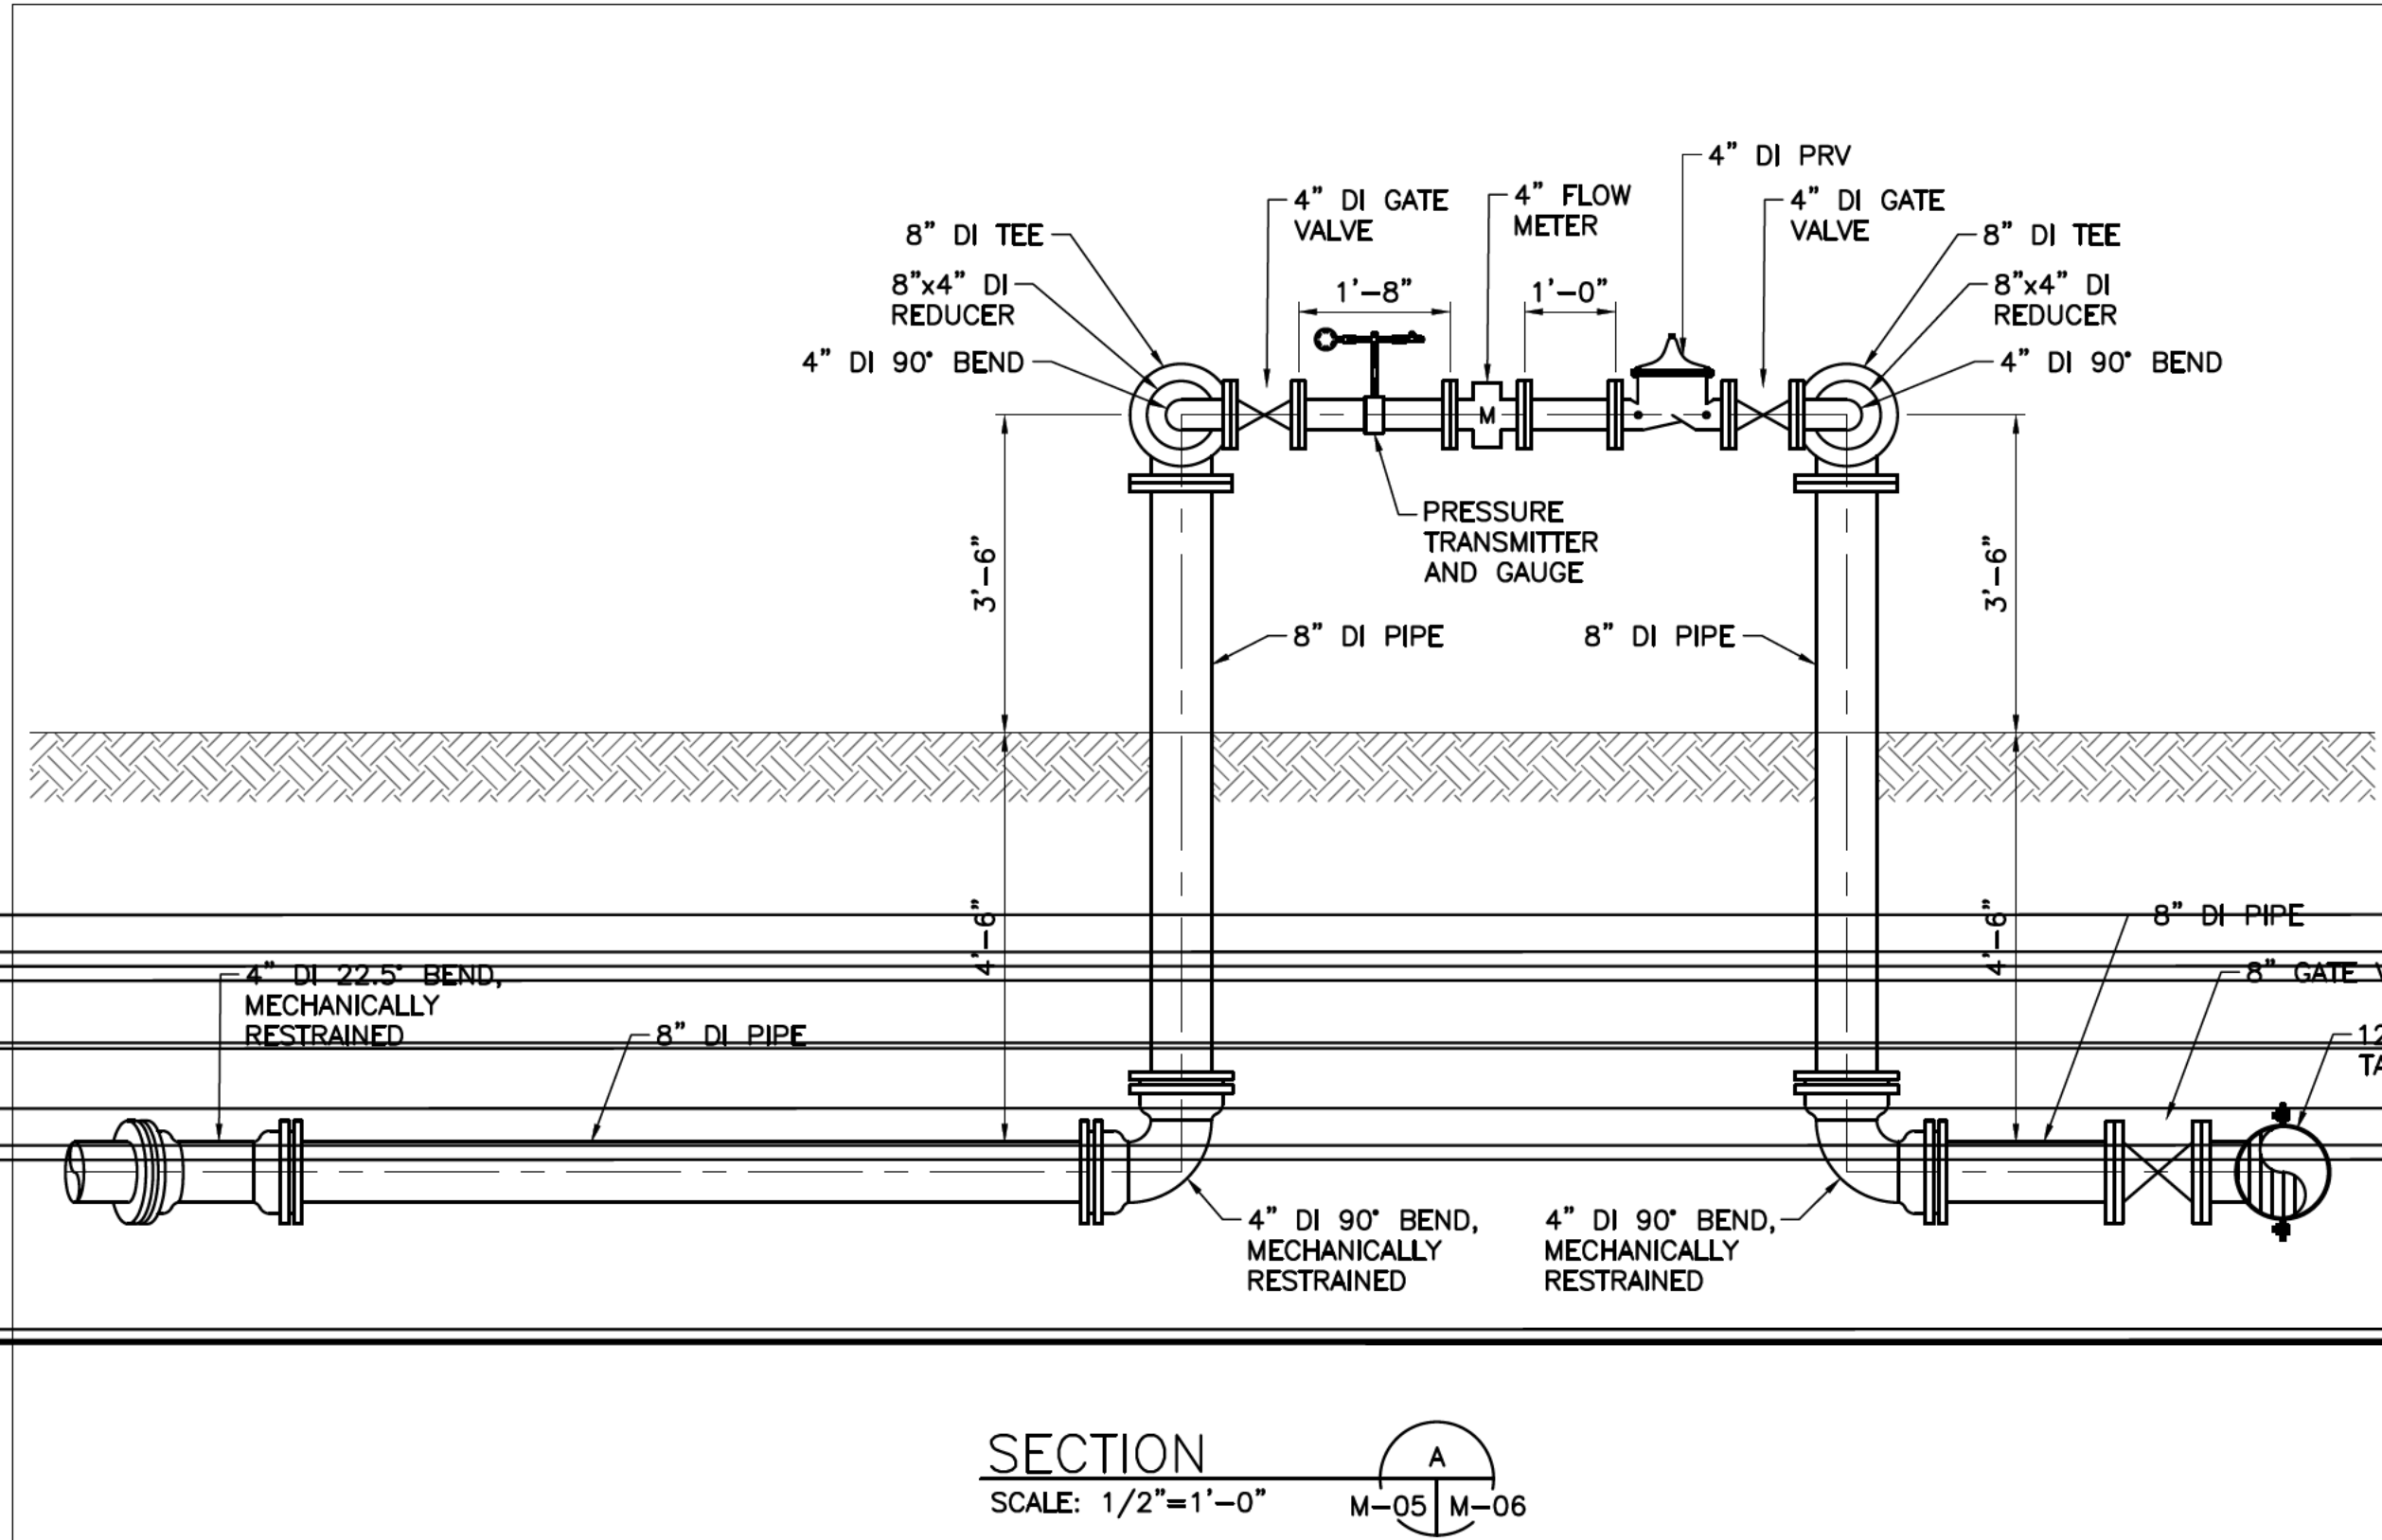


SECTION A  
SCALE: 1/2"=1'-0"  
M-05 | M-06

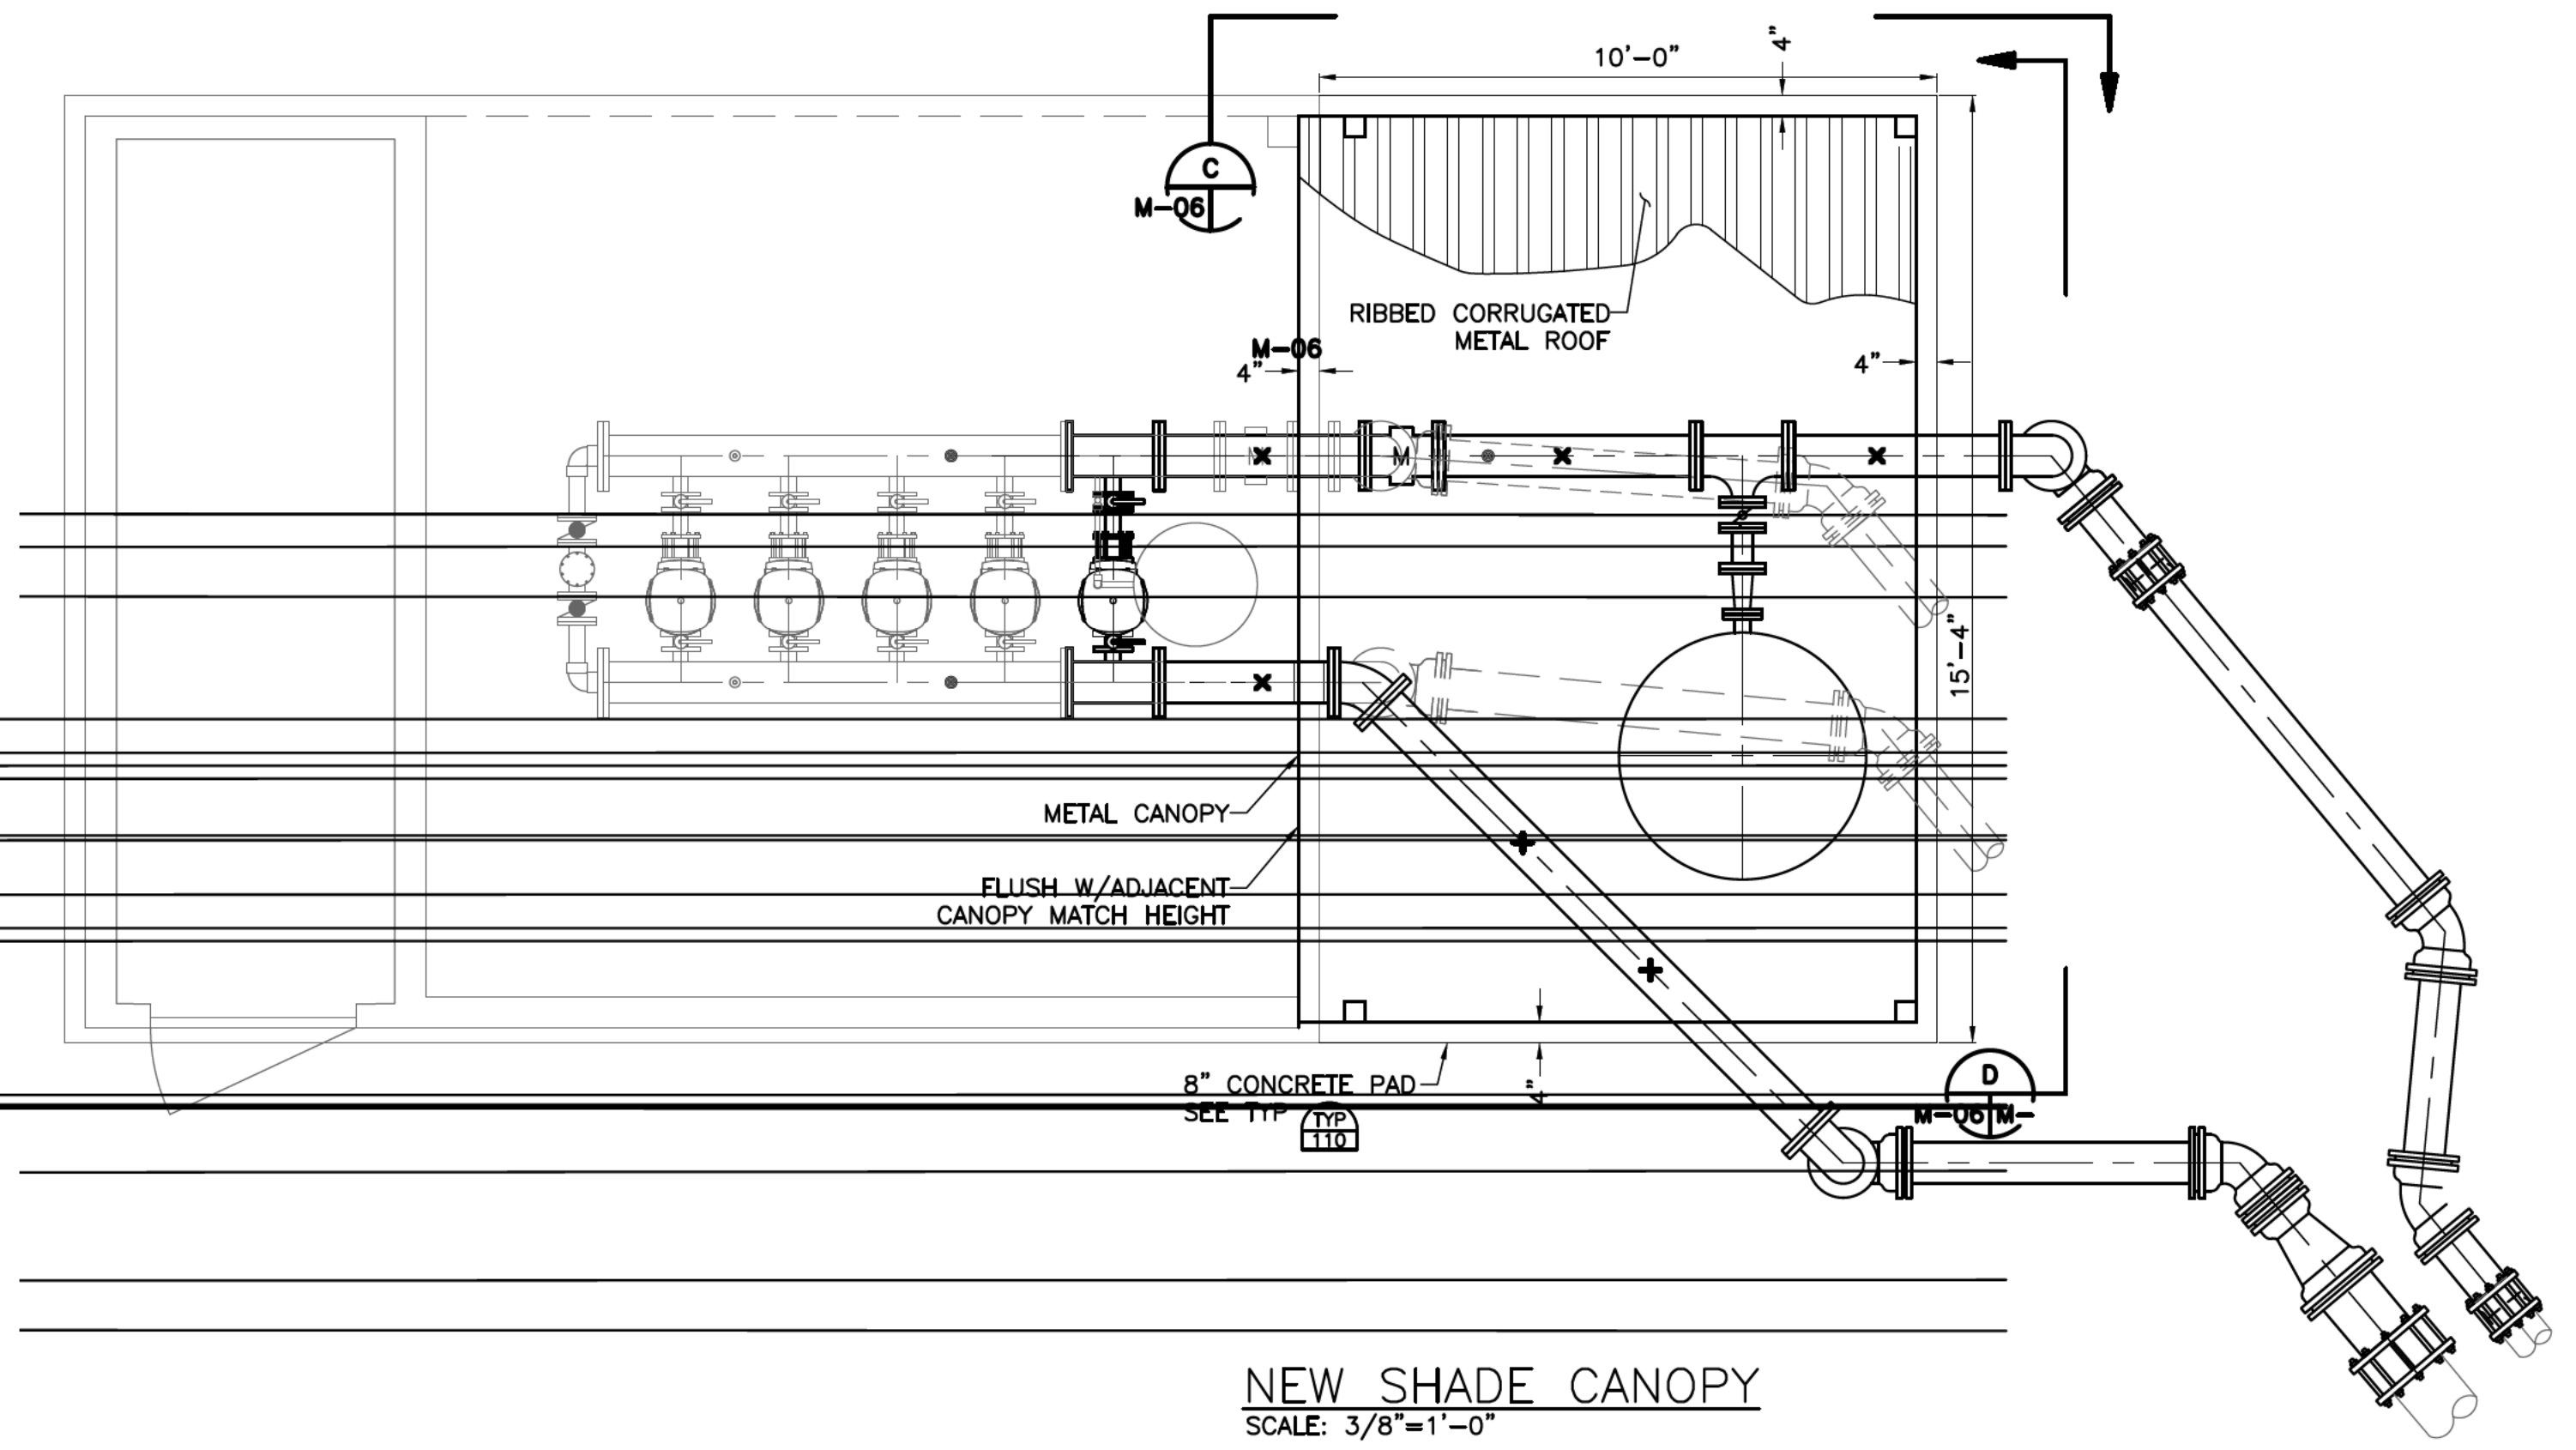

NEW SHADE CANOPY  
SCALE: 3/8"=1'-0"

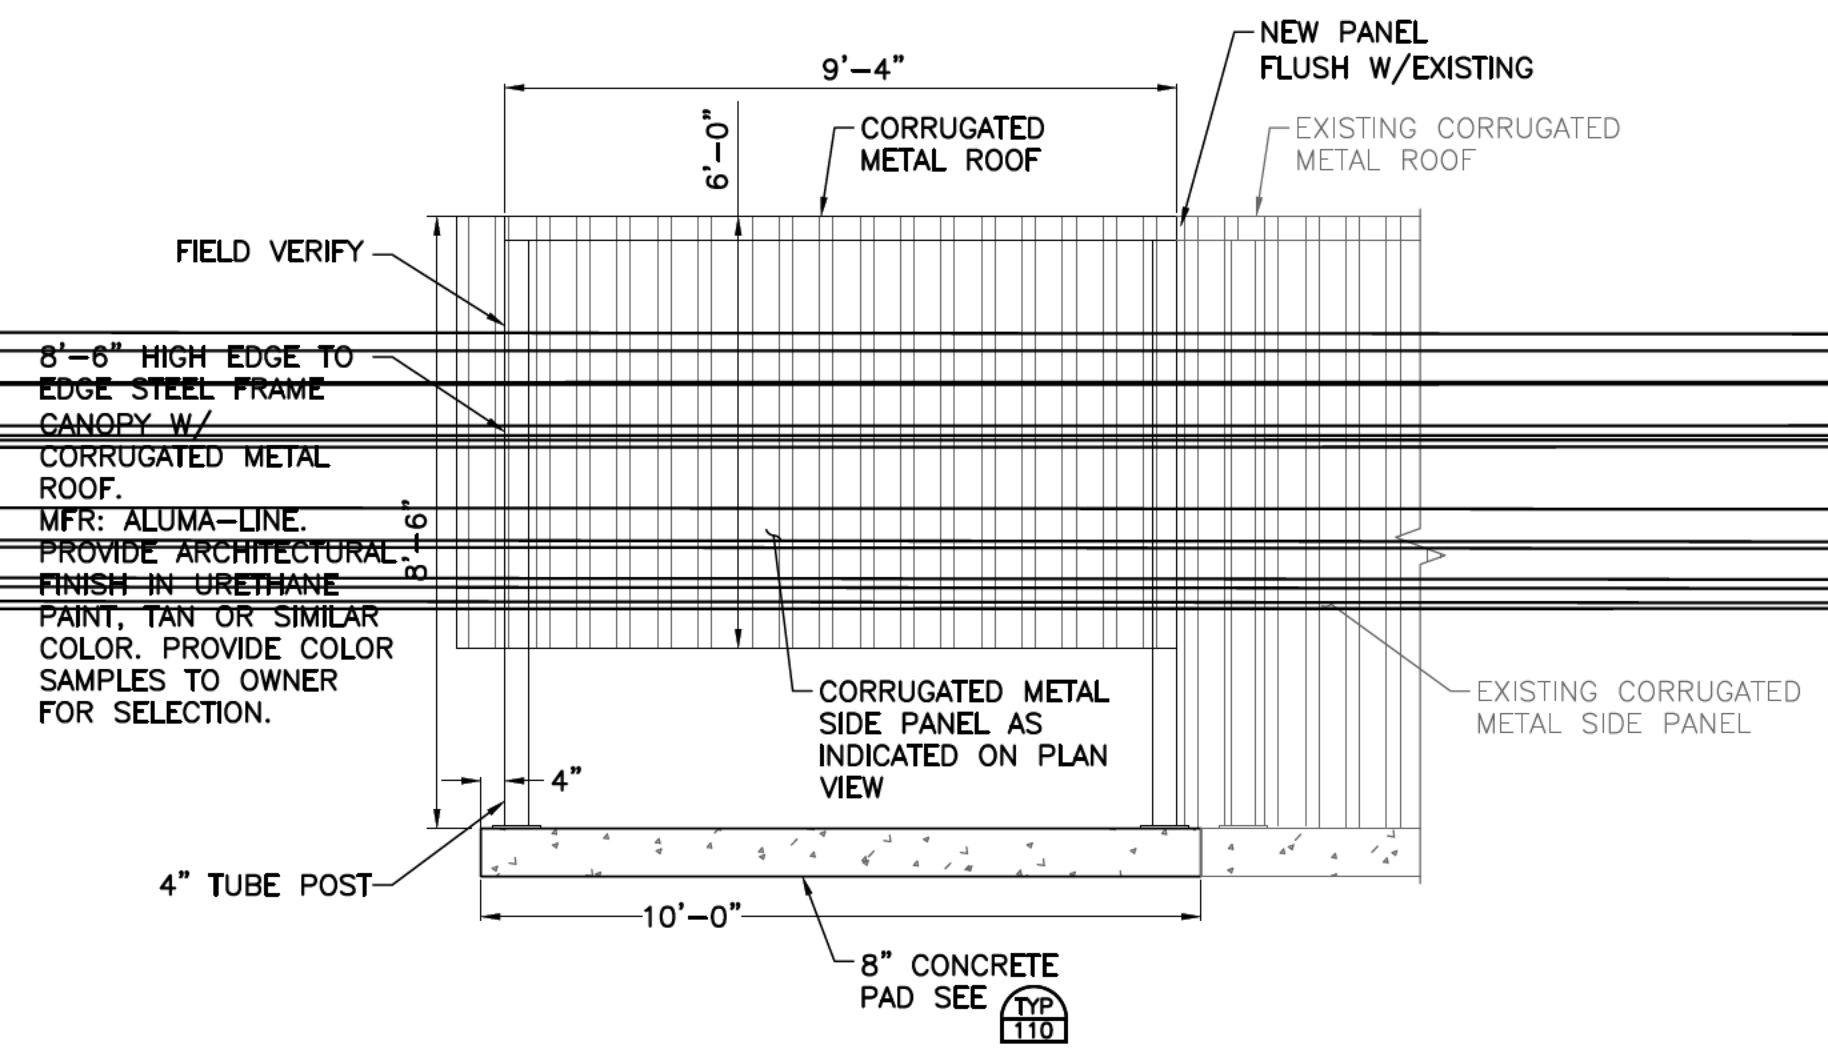

SECTION C  
SCALE: 3/8"=1'-0"  
M-06 | M-06

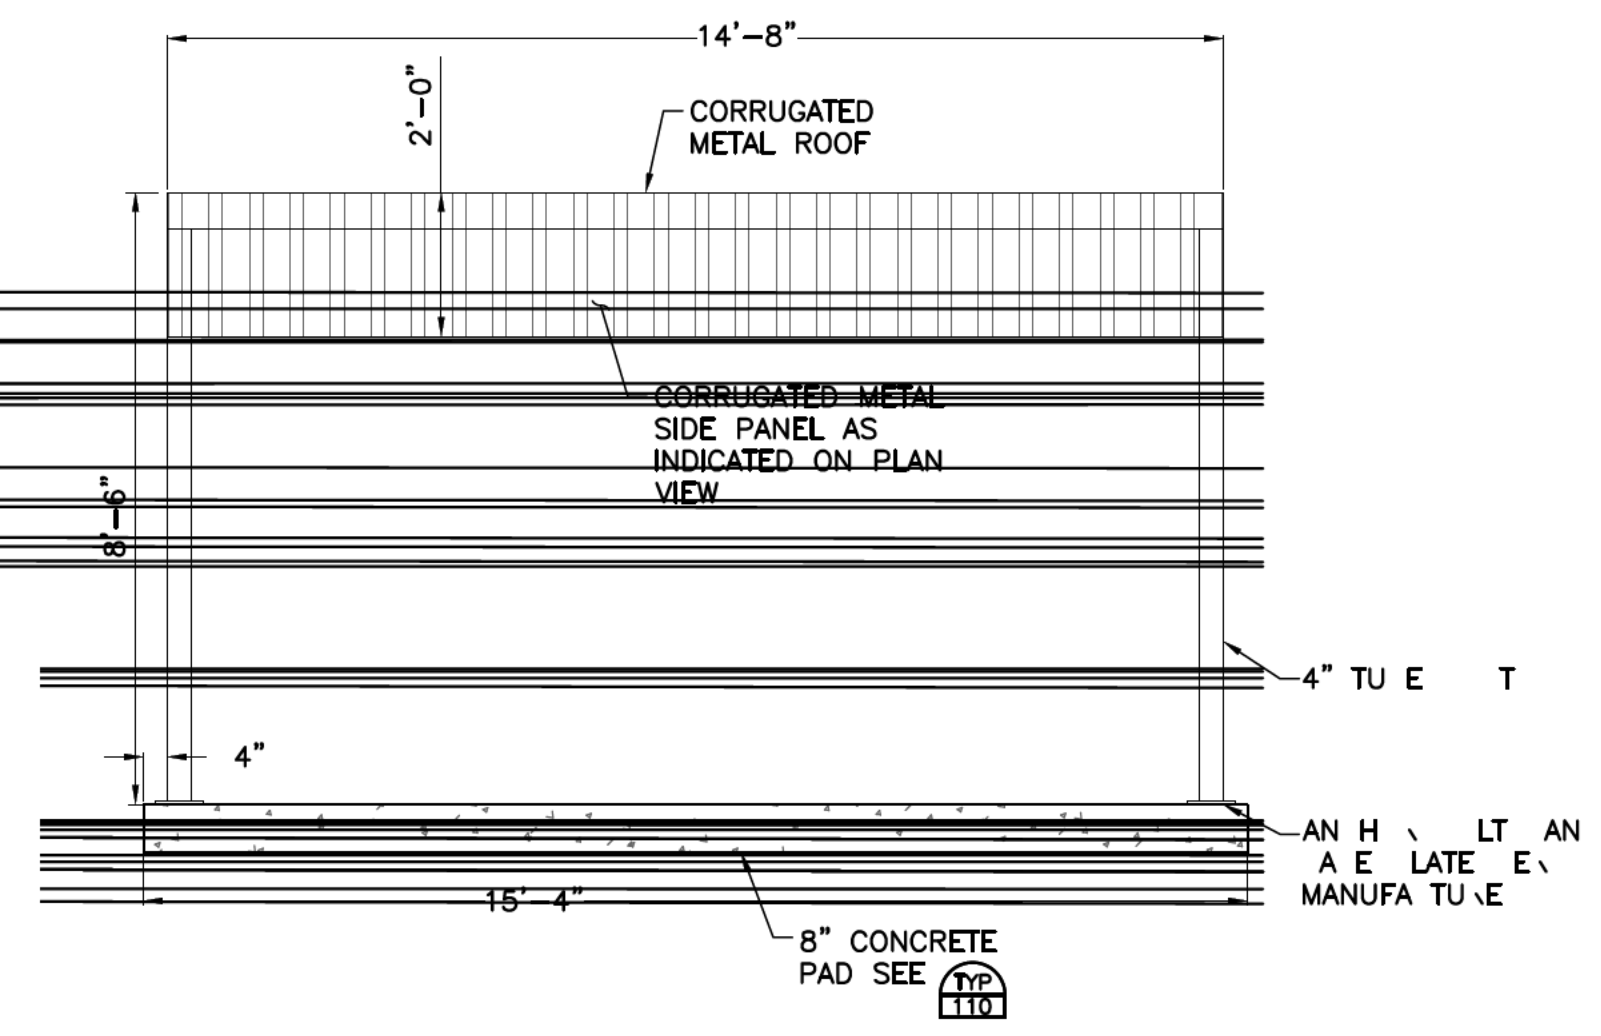

SECTION D  
SCALE: 3/8"=1'-0"  
M-06 | M-06

F A W I N U E

NO.	REVISION / BY / IN	DATE

LAKE HAVASU CITY  
BOOSTER STATION 4 IMPROVEMENTS


Designed by:	B
Drawn by:	KWB
Checked by:	RN
Date:	-1-
Dwg. scale:	A N T E D

PRV STATION  
SECTION AND  
DETAILS




EXHIBIT DATE: / / 4  
Sheet Number:

M-06  
Sheet 14 of 14

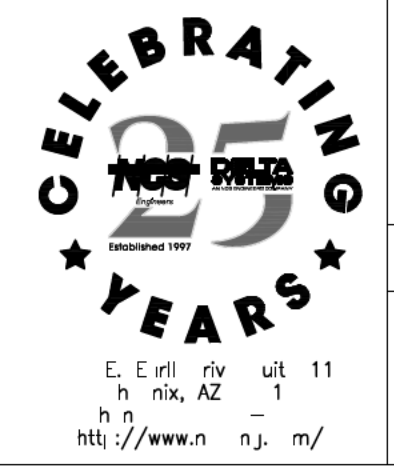


E. E. Millwright 11  
Phoenix, AZ  
http://www.nj.com/



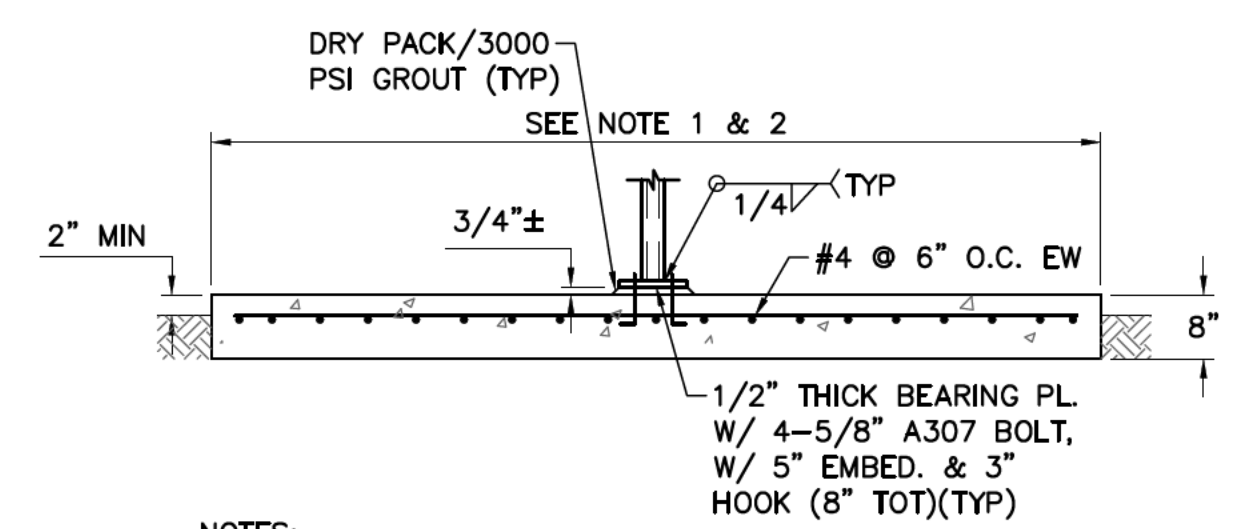


NOTES:  
 1. WIDTH=PIPE DIAMETER +6" (MIN 18") UNLESS NOTED  
 2. OTHERWISE, LENGTH=MIN 18" UNLESS NOTED OTHERWISE.

**PIPE SUPPORT PAD**  
 SCALE: NTS

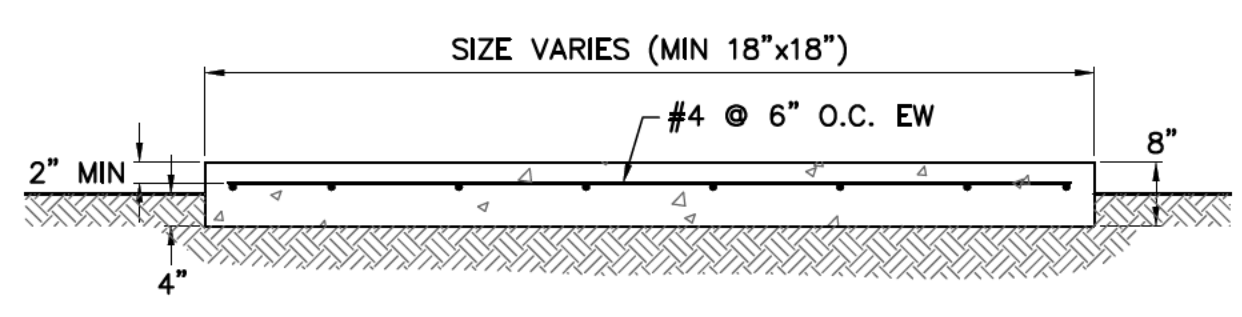


**EQUIPMENT PAD**  
 SCALE: NTS

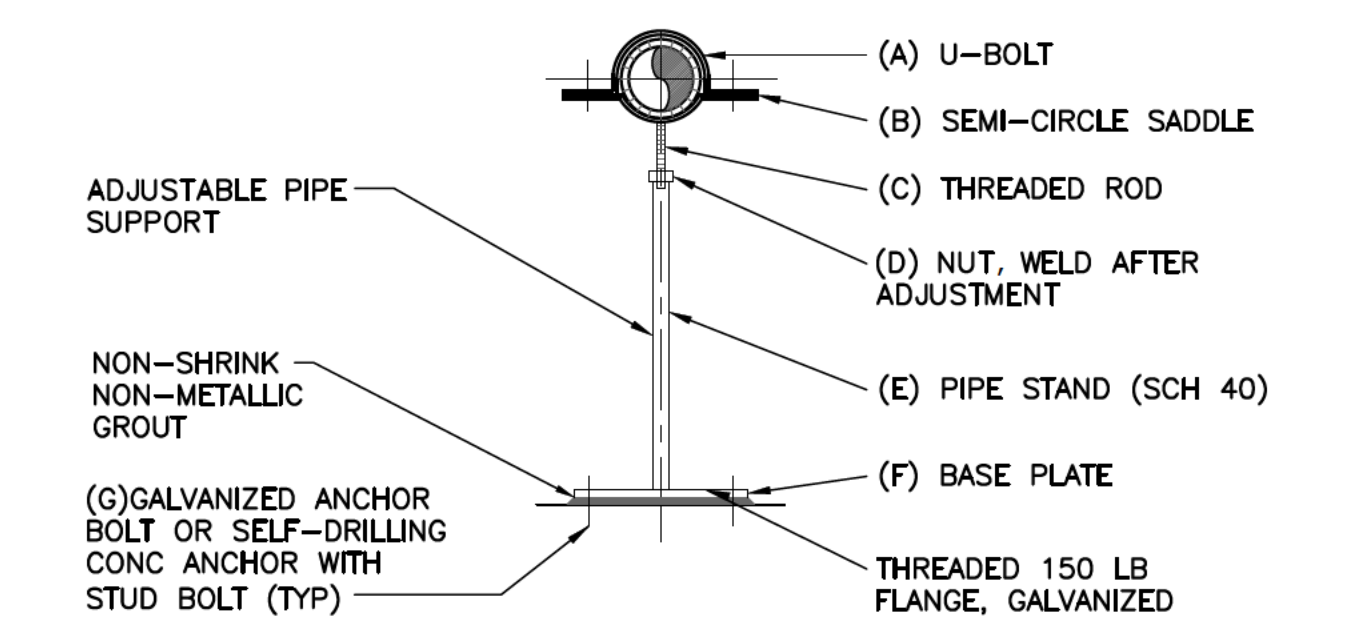


PIPE SIZE	A	B	C, D	E	F	G
2"-4"	1/2"	2"x1/4"	1"	1 1/2" ø	6"x6"x3/8"	4-1/2" DIA
6"-10"	5/8"	2"x1/4"	1 1/2"	2" ø	6"x6"x3/4"	4-1/2" DIA
12"-18"	3/4"	3"x3/8"	2"	3" ø	10"x10"x3/8"	4-5/8" DIA

NOTE:  
 1. ALL ADJUSTABLE PIPE SUPPORTS SHALL BE CARBON STEEL.  
 2. PROVIDE 5" EMBEDMENT FOR ALL ANCHOR BOLTS AND ANCHORS INTO CONCRETE SLAB.


**ADJUSTABLE PIPE SUPPORT**  
 SCALE: 1"=1'-0"

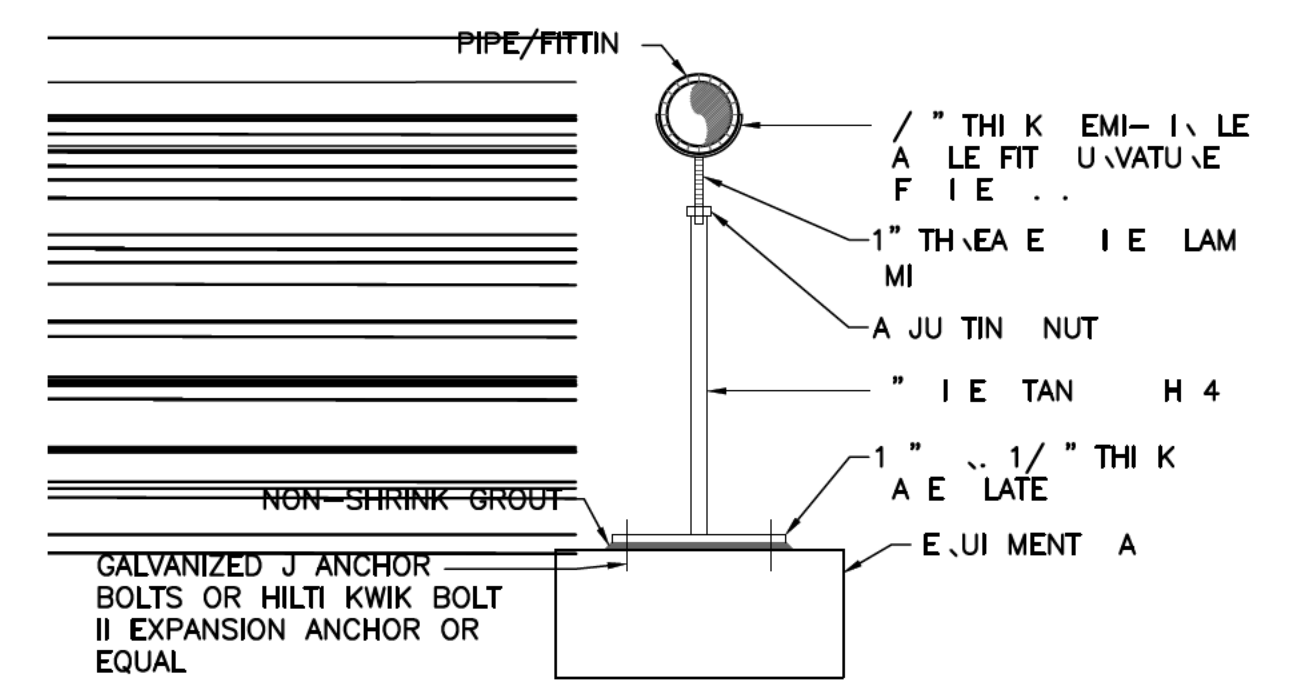


**ADJUSTABLE PIPE SADDLE**  
 SCALE: NTS

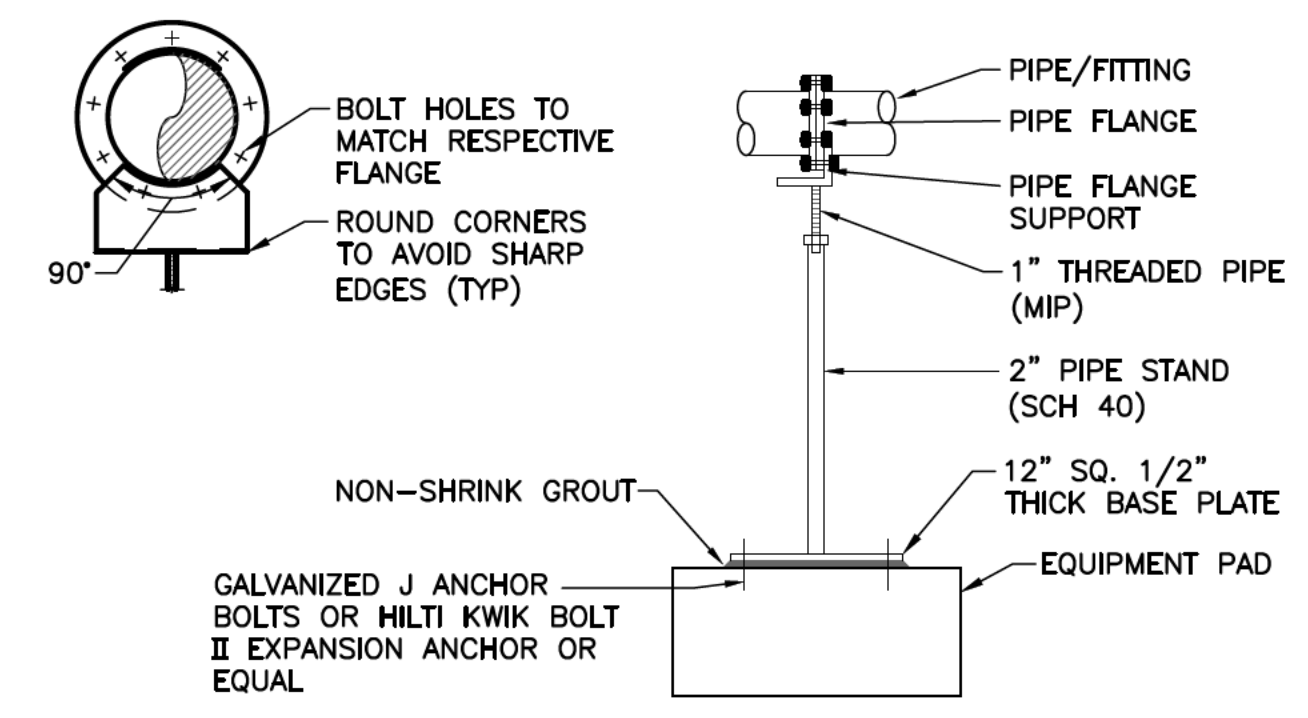


**ADJUSTABLE PIPE FLANGE SUPPORT BOLTED TO FLANGE**  
 SCALE: 1"=1'-0"

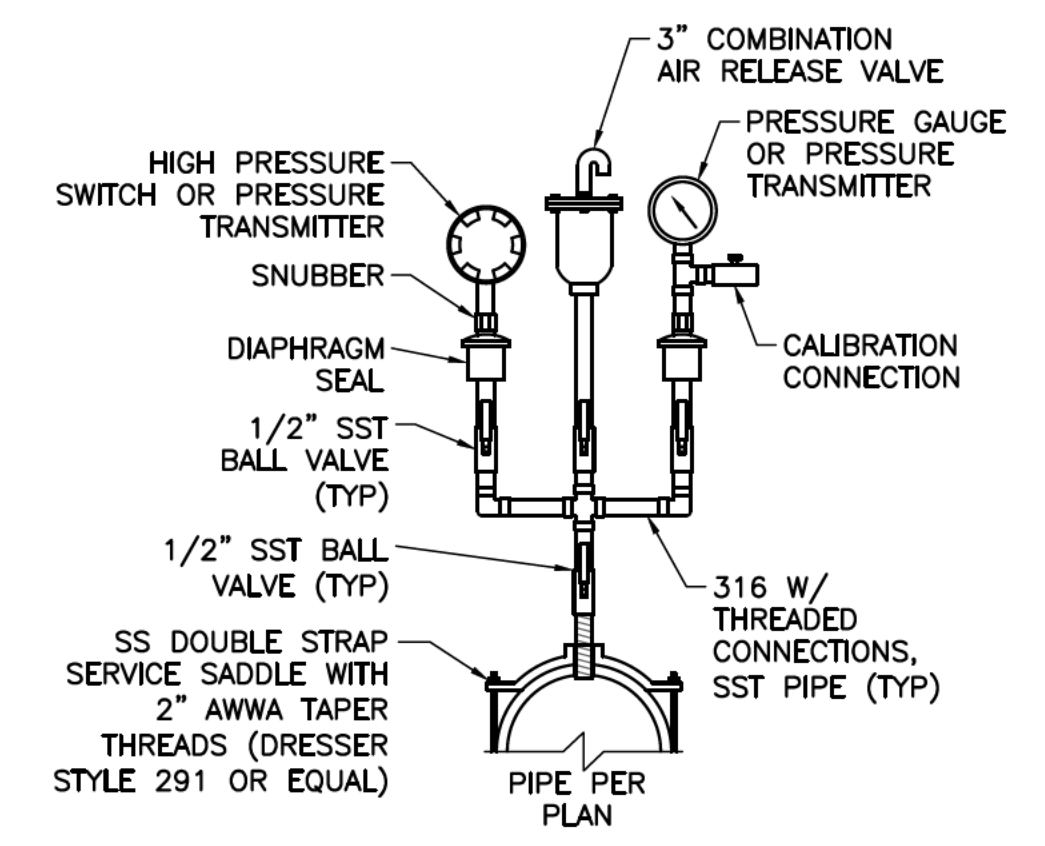


**HIGH PRESSURE SWITCH-AIR RELEASE VALVE-PRESSURE GAUGE, TAP**  
 SCALE: NTS

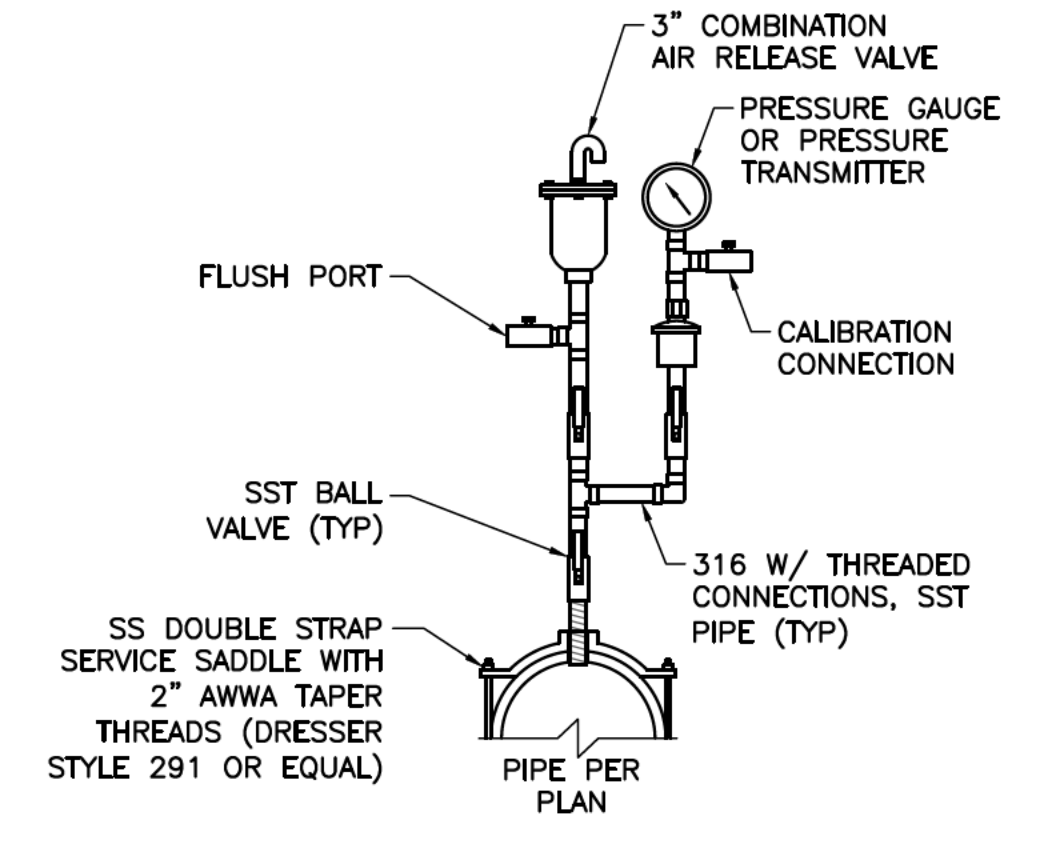


**AIR RELEASE VALVE PRESSURE GAUGE, TAP**  
 SCALE: NTS

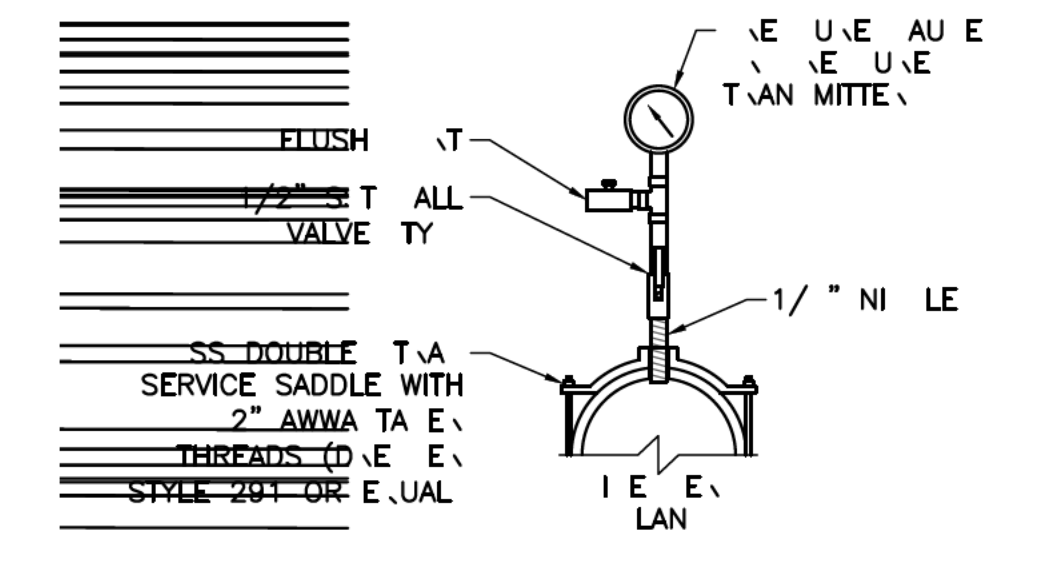

**PRESSURE GAUGE**  
 SCALE: NTS

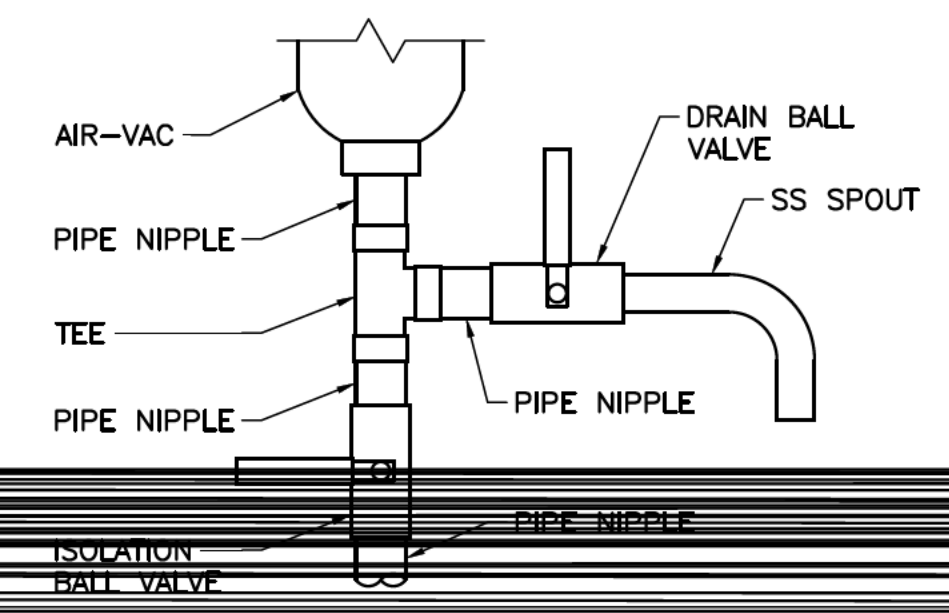

**AIR-VAC CONNECTION DETAIL**  
 SCALE: NTS

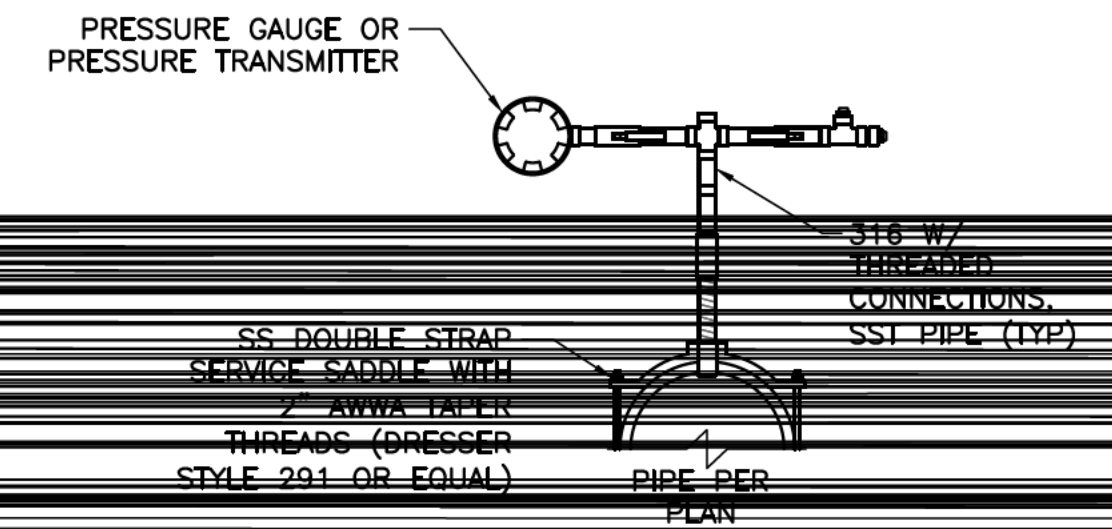


**PRESSURE GAUGE AND TRANSMITTER**  
 SCALE: NTS

NO.	REVISION /	DATE

LAKE HAVASU CITY  
 BOOSTER STATION 4 IMPROVEMENTS


Designed by:	B
Drawn by:	KWB
Checked by:	RN
Date:	-1-
Dwg. scale:	N T T ALE

TYPICAL MECHANICAL DETAILS-1

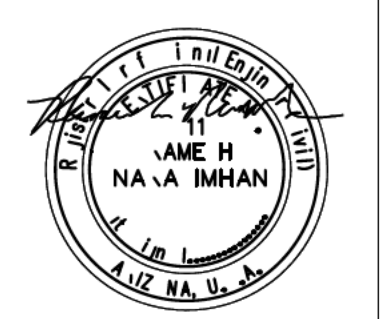

EX. DATE: / / 4  
 h t Numl r:

M-07  
 h t1 f

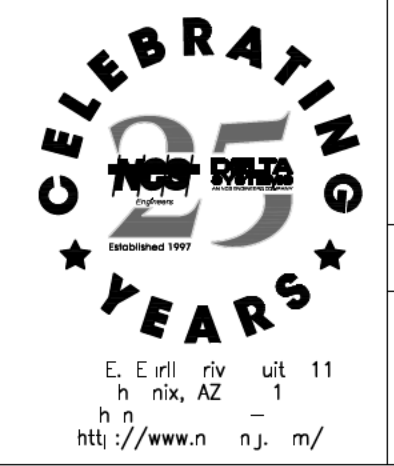

EX. DATE: / / 4  
 h t1 f







SCHEMATIC DIAGRAM SYMBOLS	
	CONTROL RELAY 2 POSITION SELECTOR SWITCH POSITION LEGEND: X=CLOSED O=OPEN
	TIME DELAY RELAY 3 POSITION SELECTOR SWITCH HAND - OFF - AUTO POSITION LEGEND: X=CLOSED O=OPEN
	ALARM RELAY NORMALLY CLOSED PUSH BUTTON
	ELAPSED TIME METER LOCKOUT STOP PUSH BUTTON
	MOTOR STARTER OR CONTACTOR COIL NORMALLY OPEN PUSH BUTTON
	PHOTO CELL EMERGENCY STOP PUSH BUTTON (MAINTAINED)
	BEACON ALARM LIGHT LETTER INDICATES COLOR R=RED, A=AMBER, B=BLUE, G=GREEN
	PILOT LIGHT LETTER INDICATES COLOR R=RED, A=AMBER, B=BLUE, G=GREEN
	OUTPUT DV/DT FILTER PRESSURE SWITCH HIGH
	HEATING ELEMENT PRESSURE SWITCH LOW
	TRANSFORMER FLOW SWITCH
	CURRENT TRANSFORMER LEVEL FLOAT SWITCH
	GROUND CONNECTION TIMER RELAY CONTACT INSTANTANEOUS CLOSE TIME DELAY OPEN
	GENERATOR TIMER RELAY CONTACT NORMALLY OPEN TIME DELAY CLOSE
	HORN TEMPERATURE SWITCH
	FULL VOLTAGE NON-REVERSING (FVNR) MOTOR STARTER OR CONTACTOR NUMBER DESIGNATES NEMA SIZE FUSE
	NORMALLY OPEN CONTACT FUSEHOLDER OR FUSEBLOCK
	NORMALLY CLOSED CONTACT THERMAL OVERLOAD RELAY
	RTU OR PLC CONTACT TERMINAL BLOCK
	DEVICE LOCATED AT REMOTE LOCATION
	CONDUIT SEALOFF

POWER SINGLE LINE DIAGRAM SYMBOLS	
	JUNCTION BOX WITH POWER DISTRIBUTION BLOCK OR LUGS
	CONDUIT SEALOFF
	LTC CONNECTION
	MC CONNECTION
	BOND TO METALLIC WATER PIPE
	UTILITY METER
	MOTOR, NUMBER DESIGNATES NEMA HORSEPOWER SIZE
	FUSE
	FUSEHOLDER OR FUSEBLOCK
	GENERATOR
	CIRCUIT BREAKER, SHOWN WITH TRIP RATING AND NUMBER OF POLES
	MOTOR CIRCUIT PROTECTOR WITH TRIP RATING AND NUMBER OF POLES
	DISCONNECT SWITCH SHOWN WITH RATING AND NUMBER OF POLES
	MOTOR MANAGEMENT RELAY
	SURGE PROTECTIVE DEVICE
	SOLID STATE STARTER
	VARIABLE FREQUENCY DRIVE
	HARMONIC FILTER
	ELECTRONIC OVERLOAD RELAY
	GROUND CONNECTION
	TRANSFORMER
	CONTACTOR

SITE PLAN SYMBOLS	
	TELEPHONE OUTLET
	FIELD DEVICE
	SINGLE POLE SWITCH
	GROUND ROD
	3 WAY SWITCH
	DUPLEX RECEPTACLE
	4-WAY SWITCH
	ANTENNA MAST
	MANUAL MOTOR STARTER
	CONDUIT SEALOFF
	SPECIAL PURPOSE OR WELDING OUTLET
	DISCONNECT SWITCH
	SMOKE DETECTOR
	MOTOR
	CONDUIT TURN UP
	THERMOSTAT
	CONDUIT TURN DOWN

CIRCUIT SCHEDULE LEGEND	
	SEQUENCE NUMBER
	TYPE C=CONTROL P=POWER
	DEVICE SERVED
	GROUPED CONDUIT AND CIRCUIT IDENTIFICATION TAGS. REFER TO THE POWER SINGLE-LINE, SCHEMATIC CONNECTION DIAGRAMS AND CIRCUIT SCHEDULE FOR CONDUIT SIZES AND CONTENTS. P=POWER C=CONTROL

ELECTRICAL ABBREVIATIONS					
A	AMPERE	JB	JUNCTION BOX	PNL	PANEL
AFD	ADJUSTABLE FREQUENCY DRIVE	L, LO	LOW	PO	PULSE OUTPUT
AFF	ABOVE FINISHED FLOOR	LAN	LOCAL AREA NETWORK	PPB	POWER PULLBOX
AFG	ABOVE FINISHED GRADE	LC	LOCAL CONTROL	PPG	POUNDS PER GALLON
AI	ANALOG INPUT	LCL	LEVEL CONTROL LOW	PPH	POUNDS PER HOUR
AIC	AMPS INTERRUPTING CAPACITY	LCP	LOCAL CONTROL PANEL	PPM	PARTS PER MILLION
AO	ANALOG OUTPUT	LOS	LOCK-OUT-STOP	PR	PAIR
AS	AIR SUPPLY	LOR	LOCAL/OFF/REMOTE	PRES	PRESSURE
ATS	AUTOMATIC TRANSFER SWITCH	LS	LEVEL (i.e., FLOAT) SWITCH	PS	PRESSURE SWITCH
BC	BYPASS CONTACTOR	LTC	LIQUIDTIGHT FLEXIBLE METAL CONDUIT	PSH	PRESSURE SWITCH, HIGH
CB	CIRCUIT BREAKER	M	MOTOR	PSI	POUNDS PER SQUARE INCH
CCW	COUNTER CLOCKWISE	MA	MANUAL/AUTO	PV	PROCESS VARIABLE
CL2	CHLORINE	mA	MILLIAMPERE	RAS	RETURN ACTIVATED SLUDGE
CON	CONTACTOR	MAX	MAXIMUM	RW	RAW WATER
CPB	CONTROL PULLBOX	MC	MANUFACTURER'S CABLE	RF	RADIO FREQUENCY
CU	COPPER, BARE	MCB	MAIN CIRCUIT BREAKER	RIO	REMOTE INPUT OUTPUT
CV	CONTROL VALVE	MCC	MOTOR CONTROL CENTER	RS	RAW SEWAGE
CW	CLOCKWISE	MCP	MOTOR CIRCUIT PROTECTOR	RSP	RAW SEWAGE PUMP
DCS	DISTRIBUTED CONTROL SYSTEM	MFR(S)	MANUFACTURER(S)	RST	RESET
DI	DISCRETE INPUT	MGD	MILLION GALLONS PER DAY	RTD	RESISTANCE TEMPERATURE DETECTOR
DO	DISCRETE OUTPUT	MGL	MILLIGRAMS PER LITER	RTU	REMOTE TELEMETRY UNIT
DP	DISTRIBUTION PANEL	MH	MANHOLE	RWT	REFLECTED WAVE TRAP
DV/DT	DIFFERENTIAL VOLTAGE/TIME	MIN	MINIMUM	SCA	SHORT CIRCUIT AMPS
DWG	DRAWING	MOV	MOTOR OPERATED VALVE	SCCR	SHORT CIRCUIT CURRENT RATING
ETM	ELAPSED TIME METER	MMR	MOTOR MANAGEMENT RELAY	SEQ	SERVICE ENTRANCE EQUIPMENT
EOL	ELECTRONIC OVERLOAD	MTU	MASTER TELEMETRY UNIT	SES	SERVICE ENTRANCE SECTION
EXIST	EXISTING	NEC	NATIONAL ELECTRICAL CODE	SLC	SINGLE LOOP CONTROLLER
FA	FOUL AIR	NECA	NATIONAL ELECTRICAL CONTRACTOR ASSOCIATION	SLOS	START-LOCK-OUT-STOP
FC	FAIL CLOSED	N.C.	NORMALLY CLOSED	SMC	SUBMERSIBLE MANUFACTURER CABLE
FE	FLOW ELEMENT	N.O.	NORMALLY OPEN	SO2	SULFUR DIOXIDE
FLA	FULL LOAD AMPS	NIC	NOT IN CONTRACT	SP	SET POINT
FS	FLOW SWITCH	NTC	NORMALY OPEN TIMED CLOSED	SFC	SPARE CONDUIT
FVNR	FULL VOLTAGE NON-REVERSING	NPW	NON-POTABLE WATER	SPR	SPARE
FW	FINISHED WATER	NS	NITROGEN SUPPLY	SS	START/STOP
GFCI	GROUND FAULT CIRCUIT INTERRUPTER	NTS	NOT TO SCALE	SSS	SOLID STATE STARTER (SOFT START)
GFP	GROUND FAULT PROTECTION	NTU	TURBIDITY	ST	SHUNT TRIP
GND	GROUND	OF	OVERFLOW	TC	TELEPHONE CABLE
GPD	GALLONS PER DAY	OIT	OPERATOR INTERFACE TERMINAL	TS	TEMPERATURE SWITCH
GPH	GALLONS PER HOUR	OL	OVERLOAD	TVSS	TRANSIENT VOLTAGE SURGE SUPPRESSOR
GPM	GALLONS PER MINUTE	OLR	OVERLOAD RELAY	TYL	TYPICAL
GRS	GALVANIZED RIGID STEEL	ON	ON/OFF (MAINTAINED)	UG	UNDERGROUND
H, HI	HIGH	OR	OFF-REMOTE	UL	UNDERWRITERS LABORATORIES
H2S	HYDROGEN SULFIDE	OSC	OPEN/STOP/CLOSE	UM	UTILITY METER
HMI	HUMAN MACHINE INTERFACE	P	PHASE	UNO	UNLESS NOTED OTHERWISE
HOA	HAND-OFF-AUTO	PB	PULL BOX	V	VOLT
HOR	HAND-OFF-REMOTE CURRENT	PCP	PROCESS CONTROL PANEL	VFD	VARIABLE FREQUENCY DRIVE
IC	INSTRUMENTATION CABLE	PV	PRESSURE CONTROL VALVE	W	WATT, WIRE
ICR	INTERMITTENT CYCLE REACTOR	PFR	PHASE/POWER FAILURE RELAY	WAS	WASTE ACTIVATED SLUDGE
IO	INPUT/OUTPUT	PI	PULSE INPUT	WP	WEATHERPROOF
ISC	SHORT CIRCUIT CURRENT	PLC	PROGRAMMABLE LOGIC CONTROLLER	XFMR	TRANSFORMER
		PLI	PLANT INFLUENT	XMR	TRANSFORMER
		PMP	PUMP	XMTX	TRANSMITTER
				ZS	POSITION (i.e., LIMIT) SWITCH

ELECTRICAL LINETYPES	
	EXPOSED CONDUIT
	EXISTING EXPOSED CONDUIT
	UNDERGROUND CONDUIT
	EXISTING UNDERGROUND CONDUIT
	BARE COPPER GROUND CONDUCTOR
	EXISTING OR FUTURE
	NEW ELECTRICAL EQUIPMENT
	DEMOLITION
	DETAIL VIEW OR MATCHING
	CAPPED CONDUIT STUB OUT
	GROUPED CONDUIT AND CIRCUIT IDENTIFICATION TAGS. REFER TO THE POWER SINGLE-LINE, SCHEMATIC CONNECTION DIAGRAMS AND CIRCUIT SCHEDULE FOR CONDUIT SIZES AND CONTENTS. P=POWER C=CONTROL

GENERAL NOTES	
1.	THE COMPLETED INSTALLATION SHALL COMPLY WITH LATEST REVISION OF APPLICABLE FEDERAL, STATE, AND LOCAL CODES, ORDINANCES, AND REGULATIONS. THE CONTRACTOR SHALL OBTAIN NECESSARY PERMITS AND INSPECTIONS REQUIRED BY THE AUTHORITIES HAVING JURISDICTION. ALL WORK SHALL BE COMPLETED IN A NEAT, WORKMANLIKE MANNER IN ACCORDANCE WITH THE LATEST NECA STANDARDS OF INSTALLATION UNDER COMPETENT SUPERVISION. INSTALL GROUNDING PER NEC.
2.	VISIT THE SITE PRIOR TO BIDDING TO BECOME FAMILIAR WITH EXISTING CONDITIONS AND OTHER FACTORS, WHICH MAY AFFECT THE EXECUTION OF THE WORK. INCLUDE ALL RELATED COSTS IN THE INITIAL BID PROPOSAL.
3.	THE CONTRACTOR SHALL COORDINATE WORK WITH THE UTILITIES PROVIDING SERVICES ON THIS PROJECT, AND SHALL COMPLY WITH ALL THEIR INSTALLATION REQUIREMENTS.
4.	ALL MATERIALS SHALL BE NEW AND OF THE BEST QUALITY, MANUFACTURED IN ACCORDANCE WITH THE LATEST REVISION OF NEMA, ANSI, UL, OR OTHER APPLICABLE STANDARDS. THE USE OF MANUFACTURERS' NAMES, MODELS, AND NUMBERS IS INTENDED TO ESTABLISH STYLE, QUALITY, APPEARANCE, USEFULNESS, AND BID PRICE.
5.	PROTECT ALL ELECTRICAL MATERIAL AND EQUIPMENT INSTALLED AGAINST DAMAGE BY OTHER TRADES, WEATHER CONDITIONS, OR ANY OTHER PREVENTABLE CAUSES. EQUIPMENT DAMAGED DURING SHIPPING OR CONSTRUCTION, PRIOR TO ACCEPTANCE BY THE ENGINEER OR THE OWNER, WILL BE REJECTED AS DEFECTIVE.
6.	LEAVE THE SITE CLEAN. REMOVE ALL DEBRIS, EMPTY CARTONS, TOOLS, CONDUIT, WIRE SCRAPS AND ALL MISCELLANEOUS SPARE EQUIPMENT AND MATERIALS USED IN THE WORK DURING CONSTRUCTION. ALL COMPONENTS SHALL BE FREE OF DUST, GRIT AND FOREIGN MATERIALS, LEFT AS NEW BEFORE FINAL ACCEPTANCE OF WORK. DAMAGED PAINT AND FINISHES SHALL BE TOUCHED UP OR REPAINTED WITH MATCHING COLOR PAINT AND FINISH.
7.	CIRCUIT CONDUCTORS #6 AWG OR SMALLER SHALL BE THWN STRANDED COPPER. #4 AWG THROUGH #2 AWG SHALL BE XHHW STRANDED COPPER. #1 AWG OR LARGER SHALL BE XHHW-2 STRANDED COPPER. MINIMUM POWER CONDUCTOR SIZE SHALL BE #12 AWG WITH #12 AWG GROUND.
8.	UNDERGROUND CONDUITS SHALL BE SCHEDULE 40 PVC. MINIMUM CONDUIT DEPTH SHALL BE 24 INCHES. MINIMUM UNDERGROUND CONDUIT SIZE SHALL BE 1 INCH.
9.	CONDUITS SHALL BE MARKED AT EACH END WITH MATCHING NUMBERED BRASS TAGS. SPARE CONDUITS SHALL HAVE A PULL STRING INSTALLED, SECURED, AND CAPPED.
10.	EXPOSED CONDUITS SHALL BE GALVANIZED RIGID STEEL (GRS). MINIMUM SIZE 3/4 INCH, UNLESS OTHERWISE NOTED ON THE PLANS.
11.	SAFETY SWITCHES, ELECTRICAL DISTRIBUTION EQUIPMENT, CONTROL PANELS, AND OTHER ELECTRICAL DEVICES SHALL BE UL LISTED, AND RATED FOR HEAVY DUTY SERVICE.
12.	WIRING DEVICES SHALL BE SPECIFICATION GRADE.
13.	THE CONTRACTOR IS RESPONSIBLE FOR MANAGING, SCHEDULING, DOCUMENTING, AND PERFORMING THE WORK SO THAT A COMPLETE ELECTRICAL, INSTRUMENTATION AND CONTROL SYSTEM FOR THE FACILITY IS PROVIDED. ACCURATE SHOP AND RECORD DRAWINGS, AND O&M MANUALS SHALL BE SUBMITTED PRIOR TO FINAL ACCEPTANCE OF THE WORK.
14.	TYPICAL DETAILS SHALL APPLY IN ALL CASES, WHETHER SPECIFICALLY REFERRED TO OR NOT.



**LAKE HAVASU CITY**  
INCORPORATED 1978

NO.	REVISONS / SUBMISSIONS	DATE	

**LAKE HAVASU CITY**

**BOOSTER STATION 4 IMPROVEMENTS**

Designed by: DLN  
Drawn by: JHA  
Checked by: AGA  
Date: 11/13/23  
Dwg scale: AS NOTED

**ELECTRICAL  
NOTES,  
SYMBOLS,  
AND LEGEND**



EXPIRATION DATE: 12/31/24

Sheet Number:  
**E-01**

Sheet 17 of 24








CIRCUIT/DESCRIPTION	KVA	HP	FLA
<b>MOTOR LOADS</b>			
BOOSTER PUMP NO. 1 (EXISTING)		40.0	52.0
BOOSTER PUMP NO. 2 (EXISTING)		40.0	52.0
BOOSTER PUMP NO. 3 (EXISTING)		40.0	52.0
BOOSTER PUMP NO. 4 (EXISTING)		40.0	52.0
BOOSTER PUMP NO. 5		40.0	52.0
HYDRO PUMP NO. 1 (ABANDONED)			
HYDRO PUMP NO. 2 (ABANDONED)			
<b>NON-MOTOR LOADS</b>			
SINGLE PHASE TRANSFORMER (EXISTING)	15.0		31.3
SUBTOTAL			291.3
+ 25% OF LARGEST MOTOR			13.0
TOTAL AMPS @ 480V/3PHASE			304.3
SERVICE SIZE (AMPS)			600.0

**NOTES:**

- ALL SHORT CIRCUIT INTERRUPTING AND PROTECTING DEVICES SHALL HAVE A SHORT CIRCUIT INTERRUPTING RATING EQUAL TO OR GREATER THAN THE ASSOCIATED AVAILABLE FAULT CURRENT.
- OVERCURRENT PROTECTIVE DEVICES ARE TO BE COORDINATED SUCH THAT FAULTS ARE LOCALIZED/ISOLATED TO THEIR NEAREST RESPECTIVE OCPD.
- INSTALL 80A CIRCUIT BREAKER IN EXISTING DISTRIBUTION PANEL. NEW CIRCUIT BREAKER SHALL MATCH EXISTING.
- NEW VARIABLE FREQUENCY DRIVE SHALL MATCH EXISTING (ALLEN-BRADLEY POWER FLEX 753 WITH ETHERNET/IP COMMUNICATIONS MODULE).
- PER ALLEN-BRADLEY, SPECIFIED VARIABLE FREQUENCY DRIVE IN CONJUNCTION WITH CLASS J FUSES PROVIDE AN SCCR RATED COMBINATION OF 65KA.


**B LOAD CALCULATIONS**

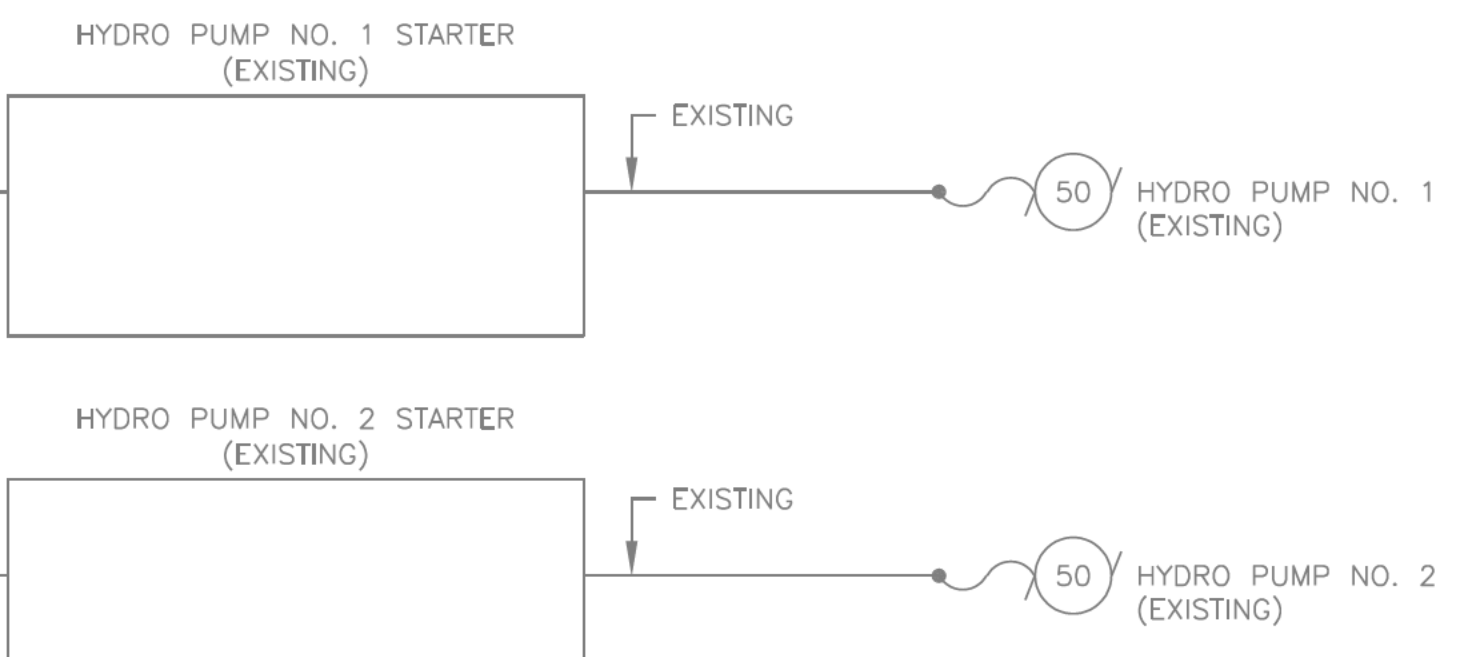

**C CALLOUT SCHEDULE**

CALLOUT NO.	NO. SETS	CONDUIT SIZE	CIRCUIT CONDUCTORS	CIRCUIT NO.'s
P100	1	1 1/2"	3 - #4, #8 GND	VFDBP1-P1
	1		EXISTING CONDUCTORS	EXISTING
EXISTING	1	1"	3 - #4, #8 GND	VFDBP1-P1
	1	1 1/2"	3 - #4, #8 GND	VFDBP2-P1
P101	1	1 1/2"	3 - #4, #8 GND	VFDBP2-P1
	1		EXISTING CONDUCTORS	EXISTING
EXISTING	1	1"	3 - #4, #8 GND	VFDBP2-P1
	1	1 1/2"	3 - #4, #8 GND	VFDBP3-P1
P102	1	1 1/2"	3 - #4, #8 GND	VFDBP3-P1
	1		EXISTING CONDUCTORS	EXISTING
EXISTING	1	1"	3 - #4, #8 GND	VFDBP3-P1
	1	1 1/2"	3 - #4, #8 GND	VFDBP4-P1
P103	1	1 1/2"	3 - #4, #8 GND	VFDBP4-P1
	1		EXISTING CONDUCTORS	EXISTING
EXISTING	1	1"	3 - #4, #8 GND	VFDBP4-P1
	1	1"	3 - #4, #8 GND	DSCBP5-P1
P104A	1	1"	3 - #4, #8 GND	VFDBP5-P1
P104B	1	1"	3 - #4, #8 GND	BP5-P1

**A SINGLE LINE DIAGRAM**

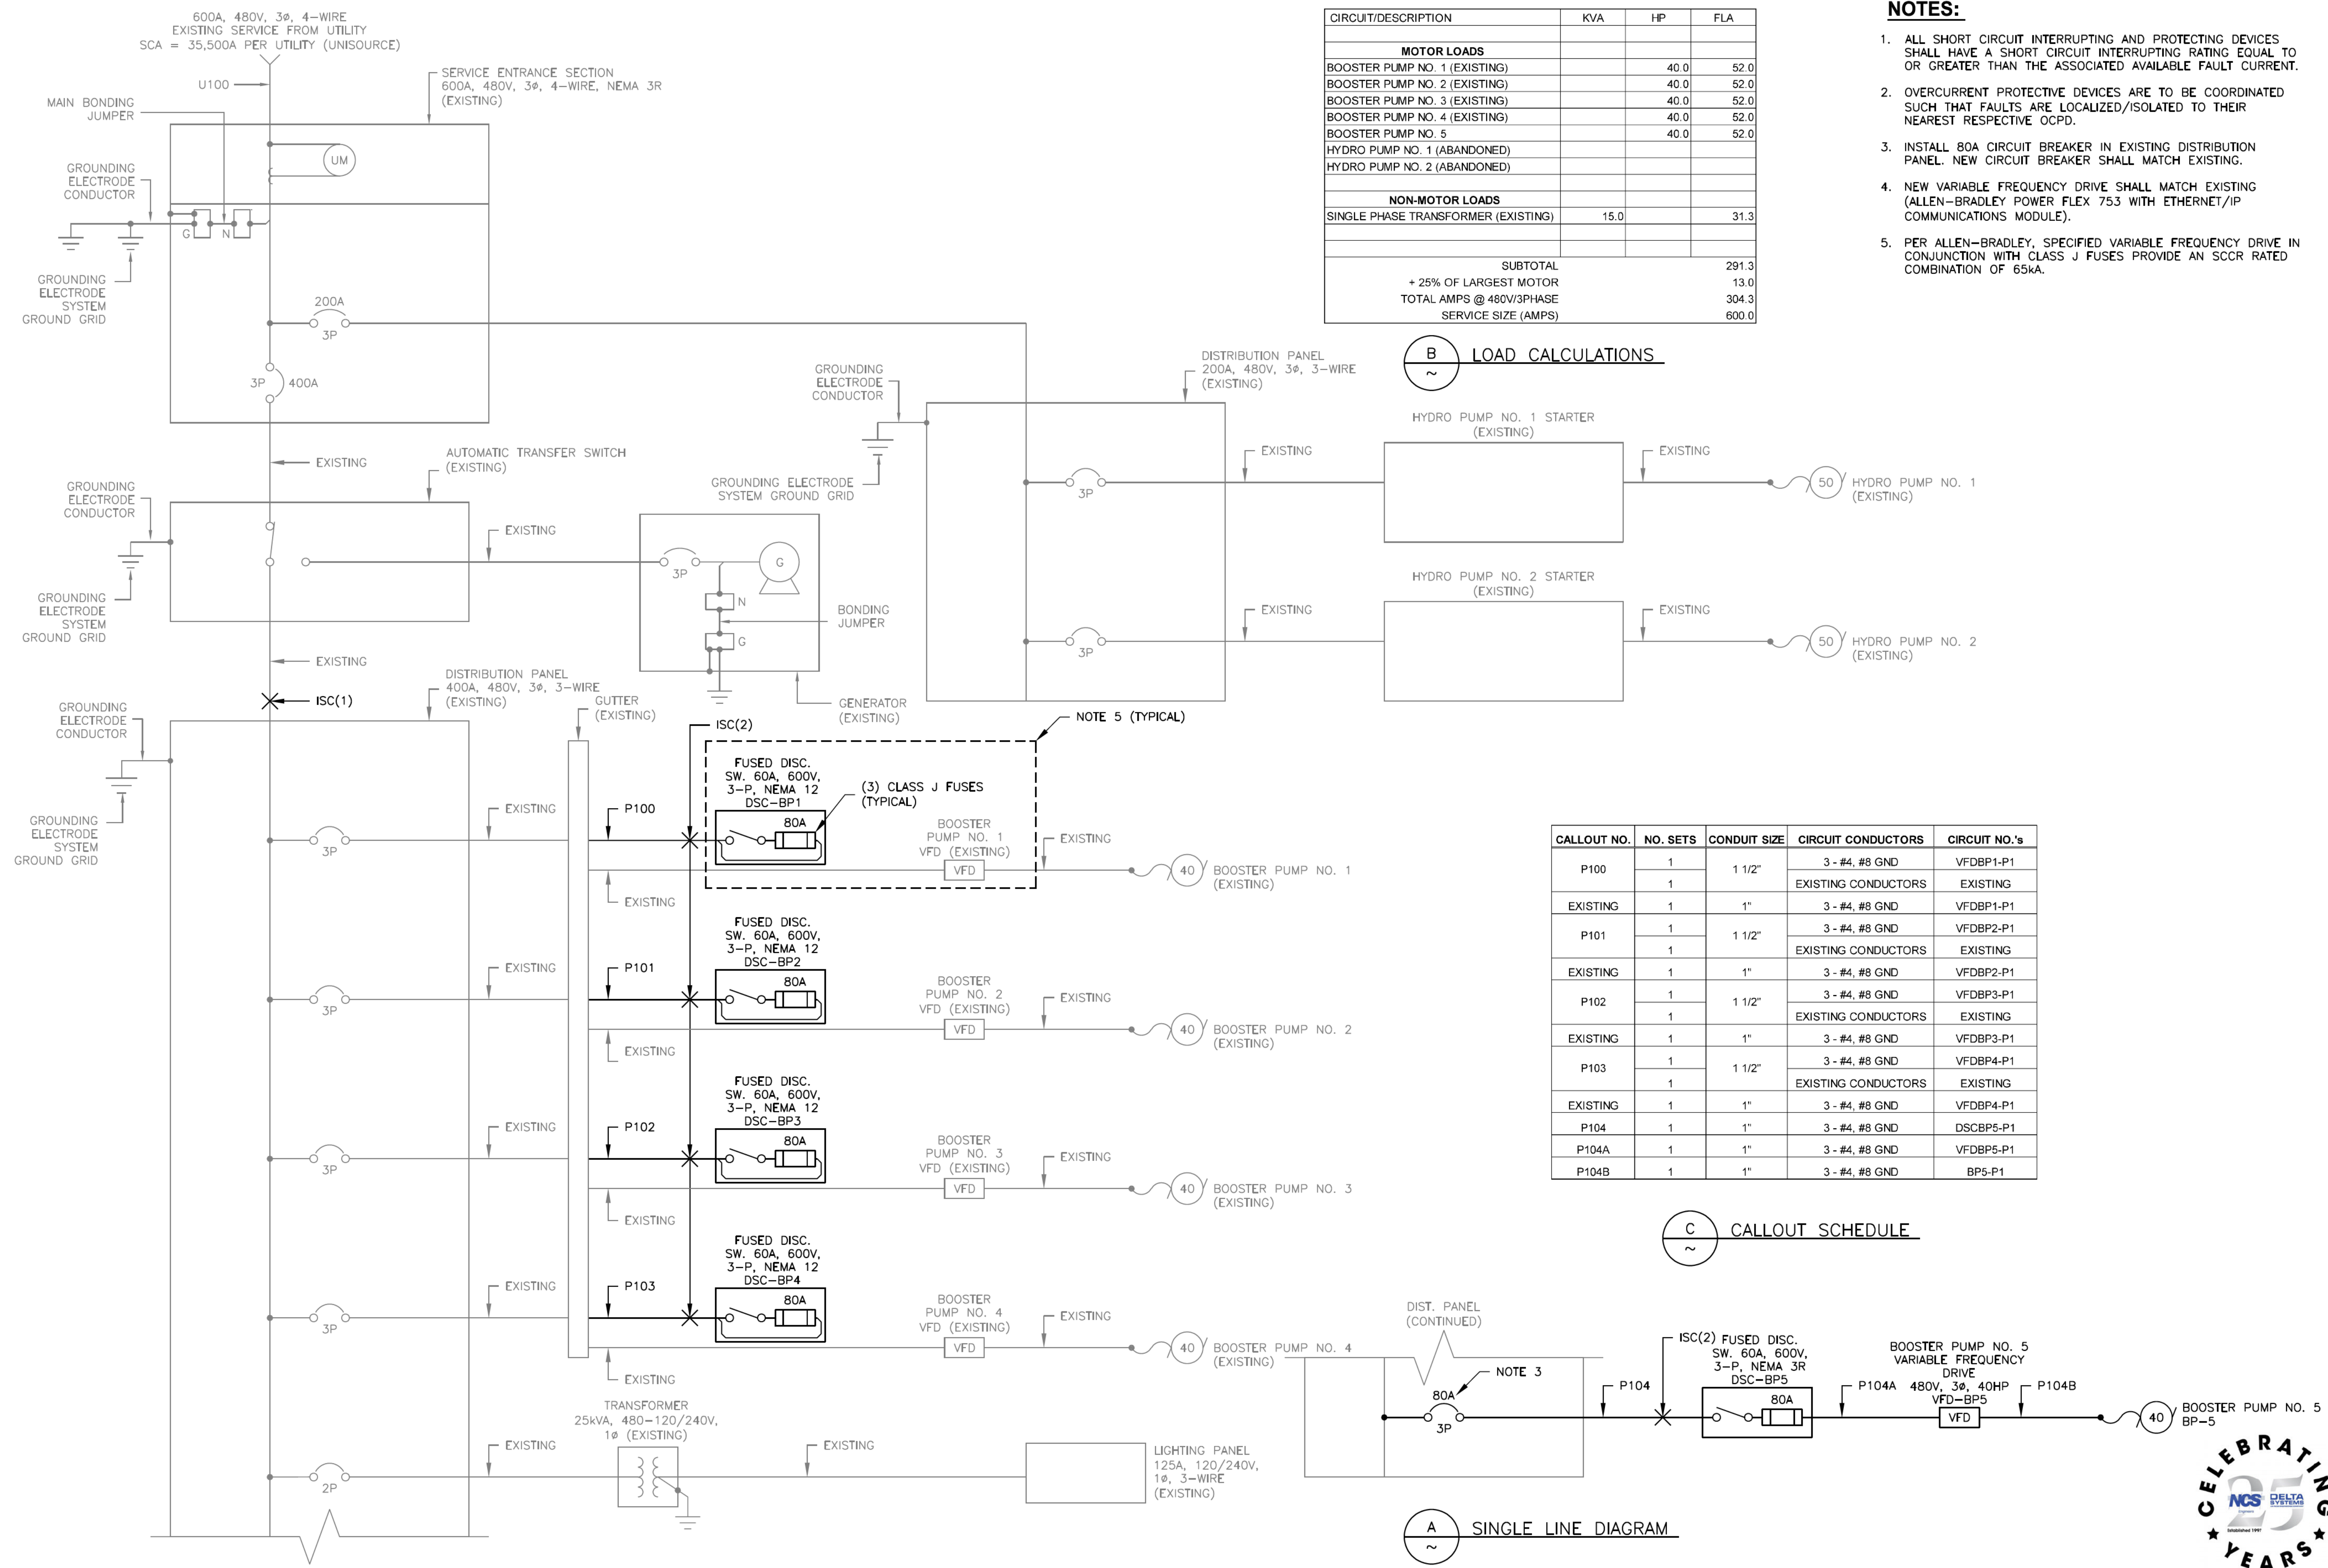

LAKE HAVASU CITY  
BOOSTER STATION 4 IMPROVEMENTS

Designed by: DLN  
Drawn by: JHA  
Checked by: AGA  
Date: 11/13/23  
Dwg scale: AS NOTED

**SINGLE LINE DIAGRAM**

Professional Engineer  
74459  
AARON G. ARMENTA  
ARIZONA, U.S.A.  
EXPIRATION DATE: 12/31/24

Sheet Number:

**E-02**  
Sheet 18 of 24







NO.	REVISIONS / SUBMISSIONS	DATE

**LAKE HAVASU CITY**  
**BOOSTER STATION 4 IMPROVEMENTS**

Designed by: DLN
Drawn by: vHA
Checked by: AGA
Date: 11/13/23
Dwg scale: AS NOTED

**ELECTRICAL SCHEDULES**



EXPIRATION DATE: 12/31/24

Sheet Number:

**E-03**  
 Sheet 19 of 24



SHORT CIRCUIT CALCULATIONS	
DEFINITIONS	FORMULAS
ISC = SHORT CIRCUIT CURRENT (AMPS)	3 PH: $f = \frac{1.732 \times L \times I_{sc}}{N \times C \times V_{L-L}}$
N = NUMBER OF CONDUCTORS/PHASE	
L = LENGTH OF CONDUCTOR (FEET)	
C = CONSTANT FROM TABLE OF "C"	1 PH: $f = \frac{2 \times L \times I_{sc}}{N \times C \times V_{L-L}}$
Isc = AVAILABLE SHORT-CIRCUIT AMPS	
V <sub>L-L</sub> = LINE TO LINE VOLTAGE (VOLTS)	
V <sub>P</sub> = PRIMARY VOLTAGE	1 PH XFMR: $f = \frac{I_{sc} \times V_P \times \% Z}{100,000 \times KVA}$
V <sub>S</sub> = SECONDARY VOLTAGE	
% Z = TRANSFORMER % IMPEDANCE	

ISC(1)

$$f1 = \frac{1.732 \times 50 \times 35,500}{2 \times 16673 \times 480} = 0.1921$$

$$M = \frac{1}{1 + 0.1921} = 0.8389$$

$$ISC(1) = 35,500 \times 0.8389 = 29,781 \text{ A}$$

ISC(2)

$$f2 = \frac{1.732 \times 20 \times 29,781}{1 \times 3825 \times 480} = 0.5619$$

$$M = \frac{1}{1 + 0.5619} = 0.6402$$

$$ISC(2) = 29,781 \times 0.6402 = 19,066 \text{ A}$$

SHEET NO.	CIRCUIT	CONDUCTORS
E-05	VFDBP5-C1	CAT6 ETHERNET CABLE


**A**  
 ~  
**MASTER CIRCUIT SCHEDULE**

**B**  
 ~  
**SHORT CIRCUIT CALCULATIONS**




**NOTES:**

1. CONDUIT ROUTING SHOWN IS SCHEMATIC IN NATURE ACTUAL CONDUIT ROUTING SHALL BE FIELD DETERMINED. REFER TO CONDUIT BLOCK DIAGRAM FOR CONDUIT INFORMATION/REQUIREMENTS INCLUDING TO/FROM INFO, CONTENTS, TAG #'S, SIZES ETC.
2. ETHERNET COMMUNICATION CABLES BETWEEN VARIABLE FREQUENCY DRIVE AND RTU SHALL BE ROUTED THROUGH WIREWAYS (I.E. PANDUIT; NOT SHOWN) MOUNTED ON PLYWOOD WALLS. REFER TO CONDUIT BLOCK DIAGRAM FOR ADDITIONAL DETAILS.
3. EXISTING SWITCH AND RECEPTACLE SHALL BE RELOCATED AS DIRECTED BY OWNER TO PROVIDE ADEQUATE SPACE FOR NEW VARIABLE FREQUENCY DRIVE AND ASSOCIATED DISCONNECT SWITCH.

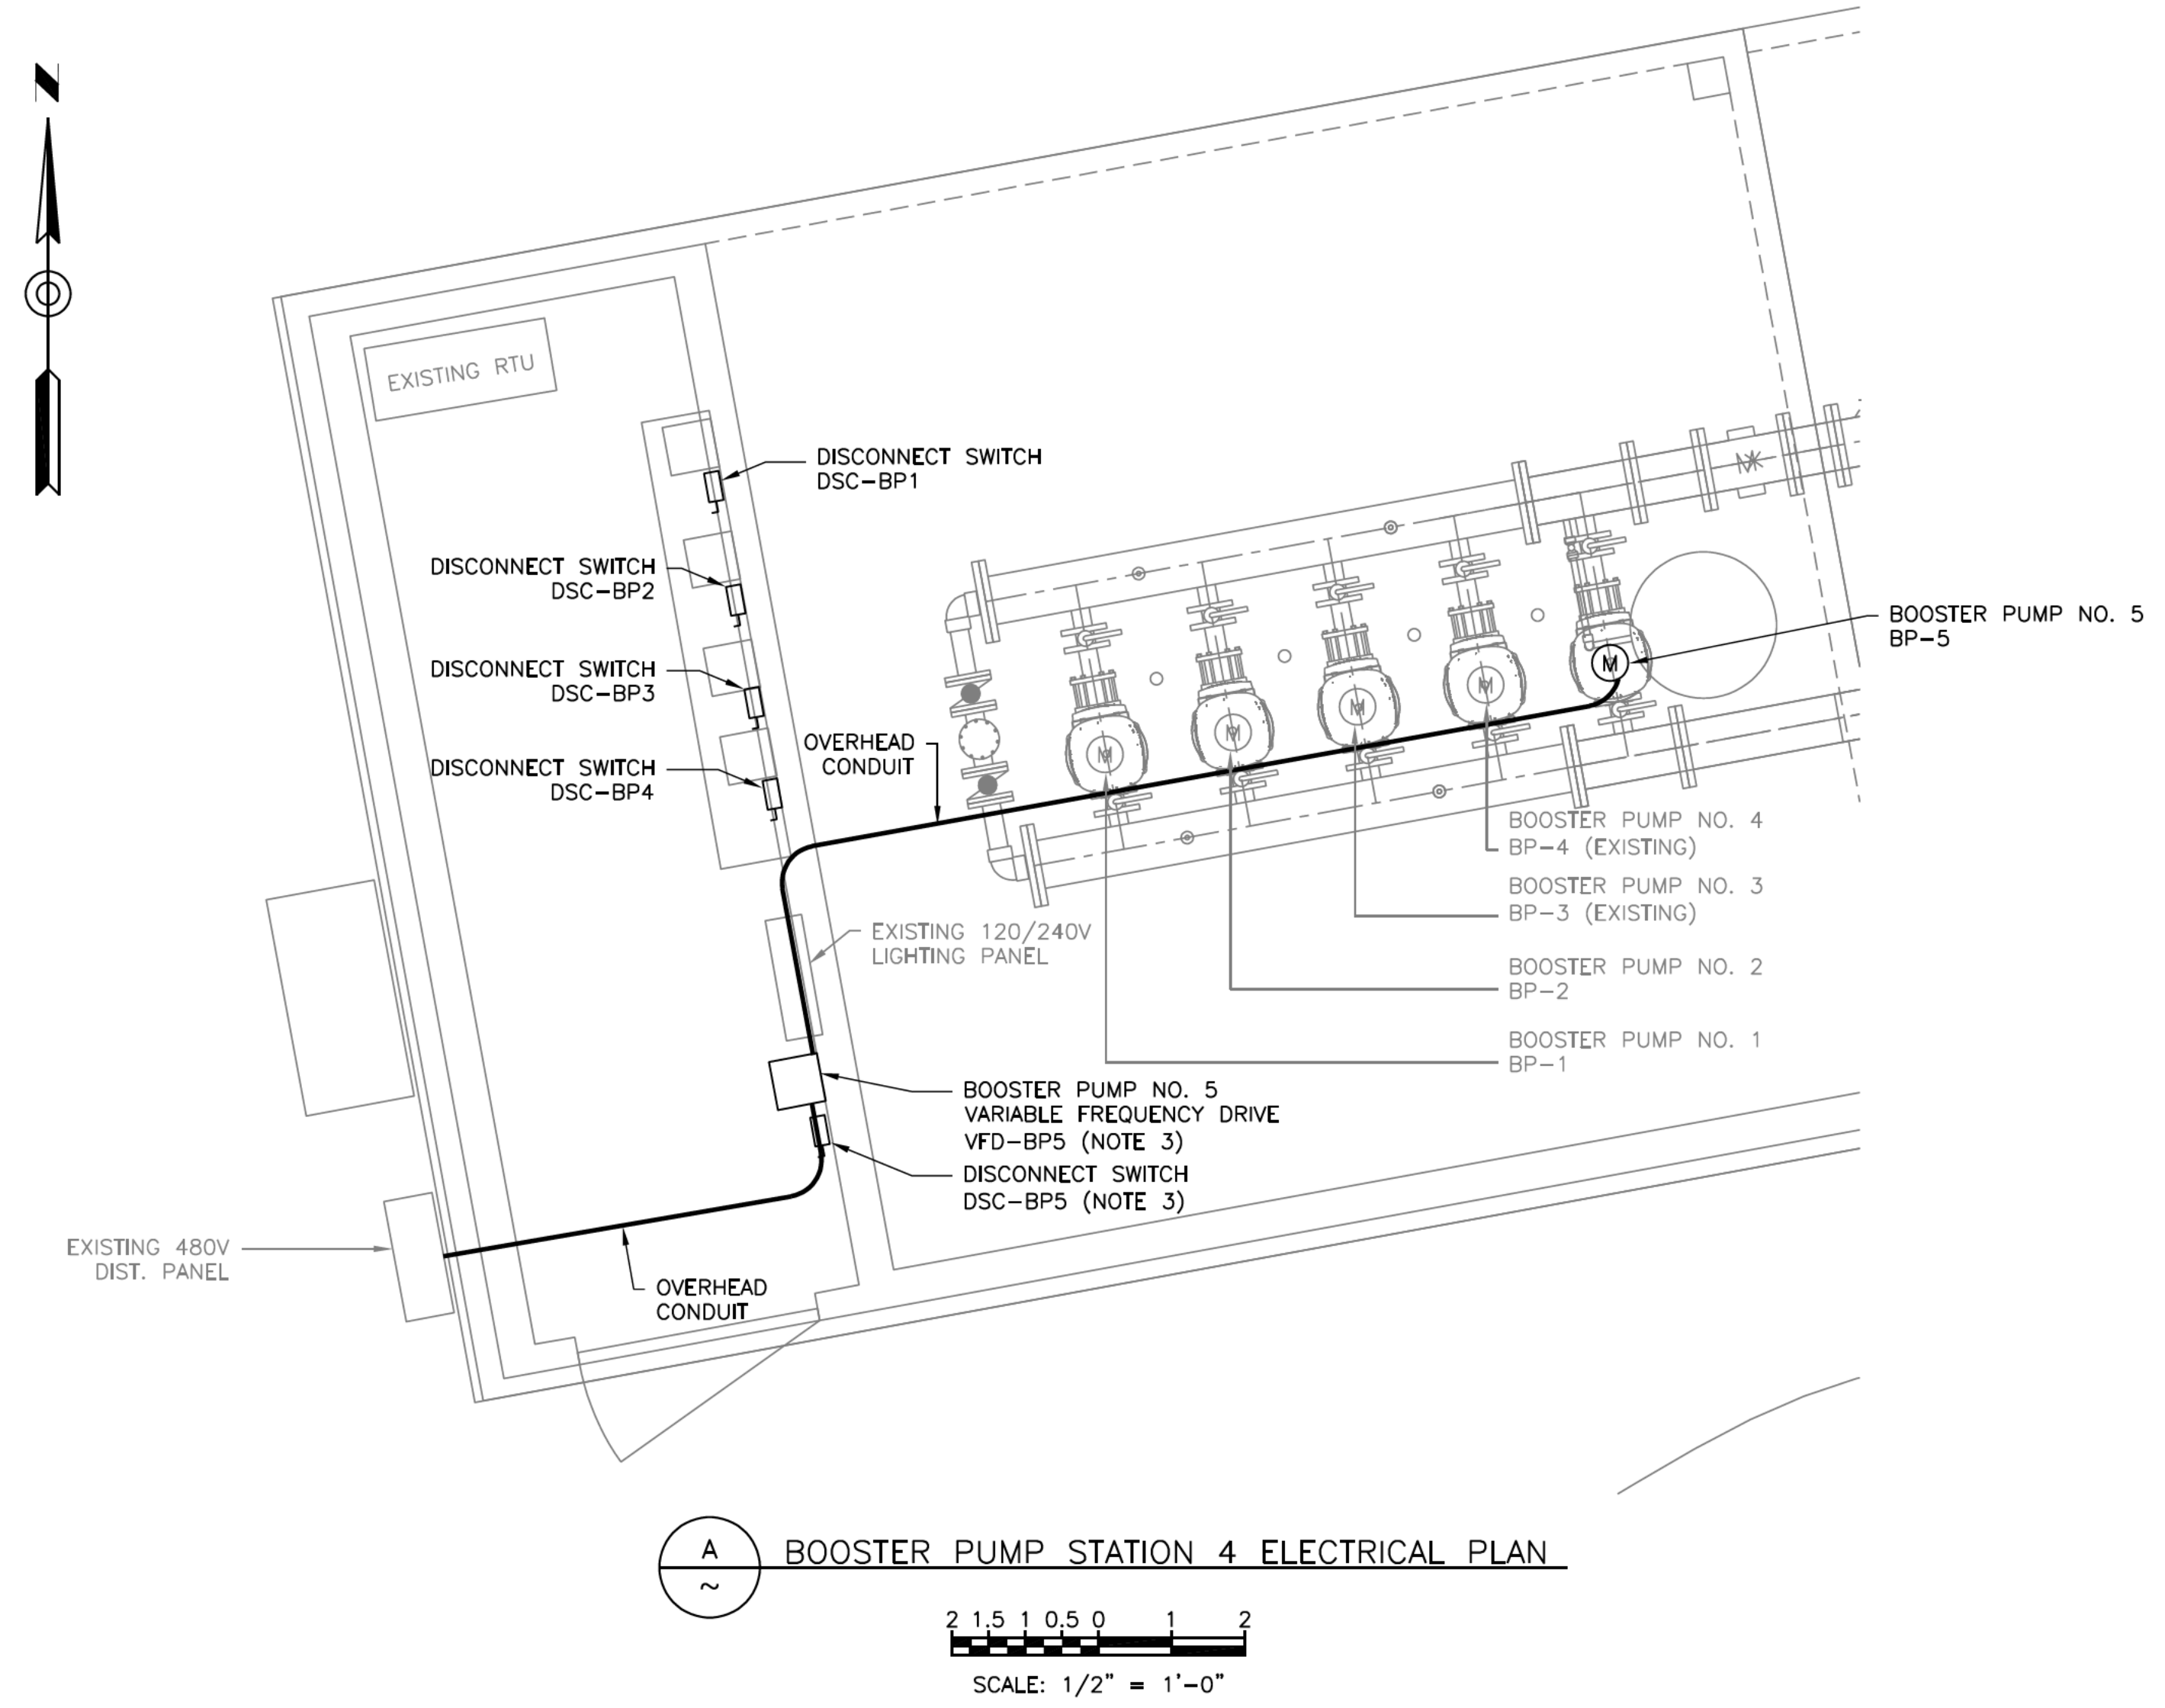

**A** BOOSTER PUMP STATION 4 ELECTRICAL PLAN

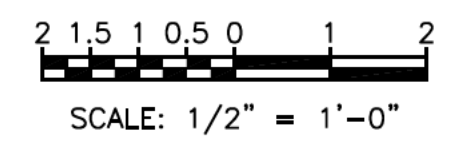

NO.	REVISIONS / SUBMISSIONS	DATE

**LAKE HAVASU CITY**  
**BOOSTER STATION 4 IMPROVEMENTS**

Designed by: DLN
Drawn by: JHA
Checked by: AGA
Date: 11/13/23
Dwg scale: AS NOTED

**ELECTRICAL**  
**SITE PLAN**



EXPIRATION DATE: 12/31/24

Sheet Number:

**E-04**


Sheet 20 of 24






**NOTES:**

1. REFER TO SHEET E-03 FOR MASTER CIRCUIT SCHEDULE.
2. ENSURE ALL ELECTRICAL CONNECTIONS ON VARIABLE FREQUENCY DRIVES ARE PROPERLY COVERED TO PREVENT SHOCK HAZARD.

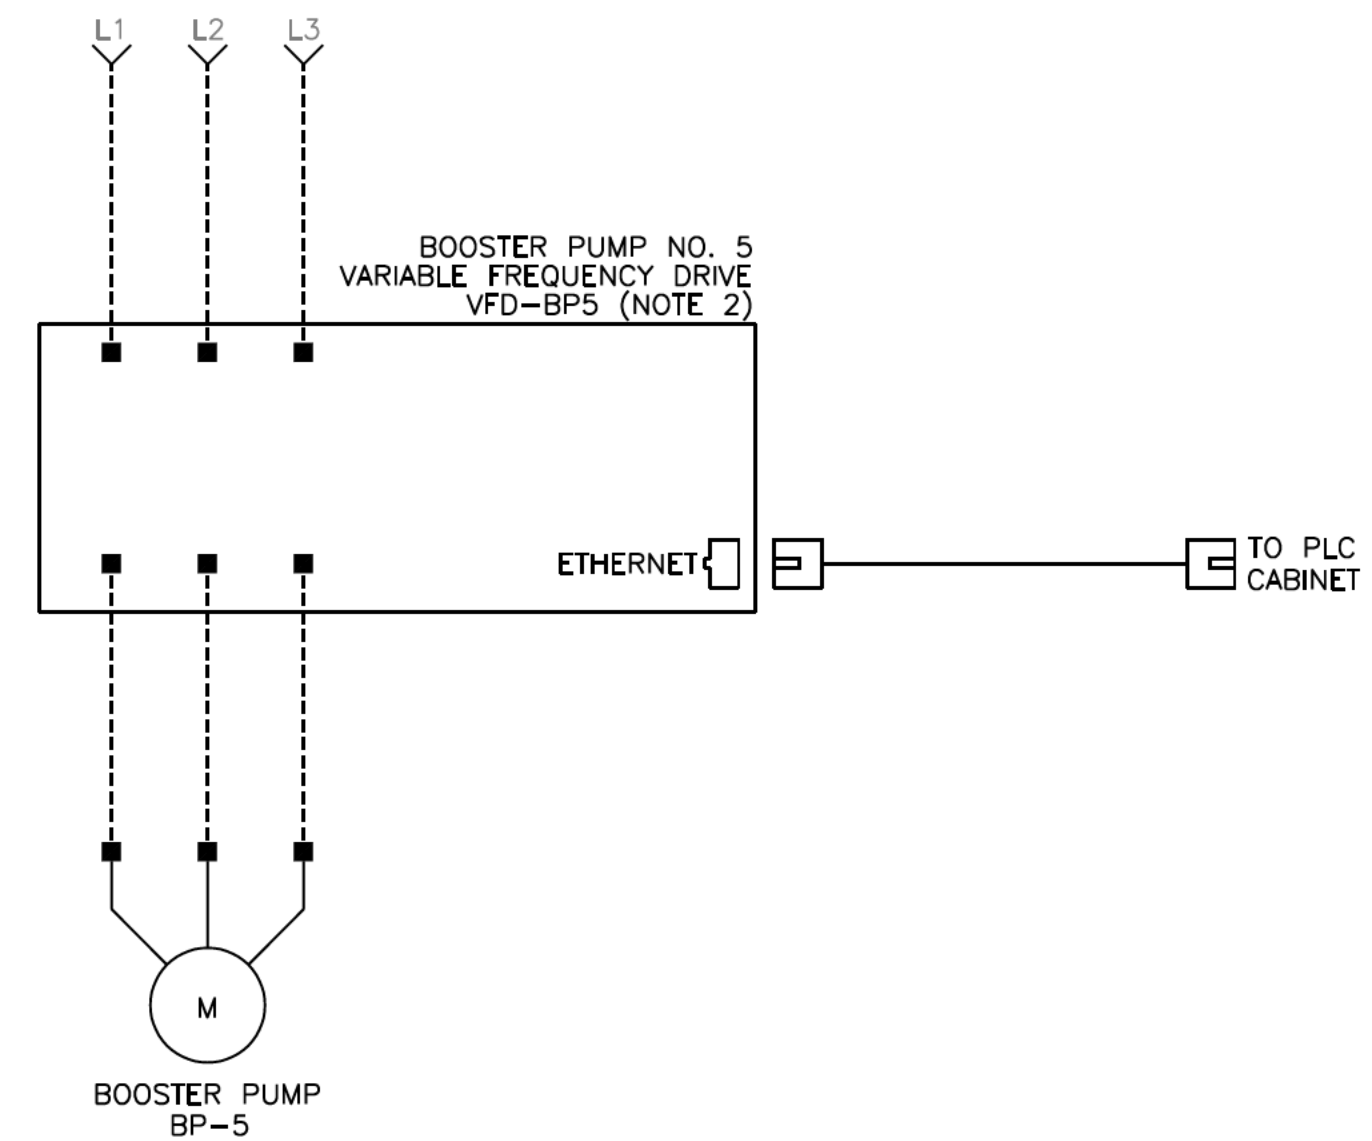

**A** BOOSTER PUMP VARIABLE FREQUENCY DRIVE (VFD-BP5) SCHEMATIC DIAGRAM  
SCHEMATIC

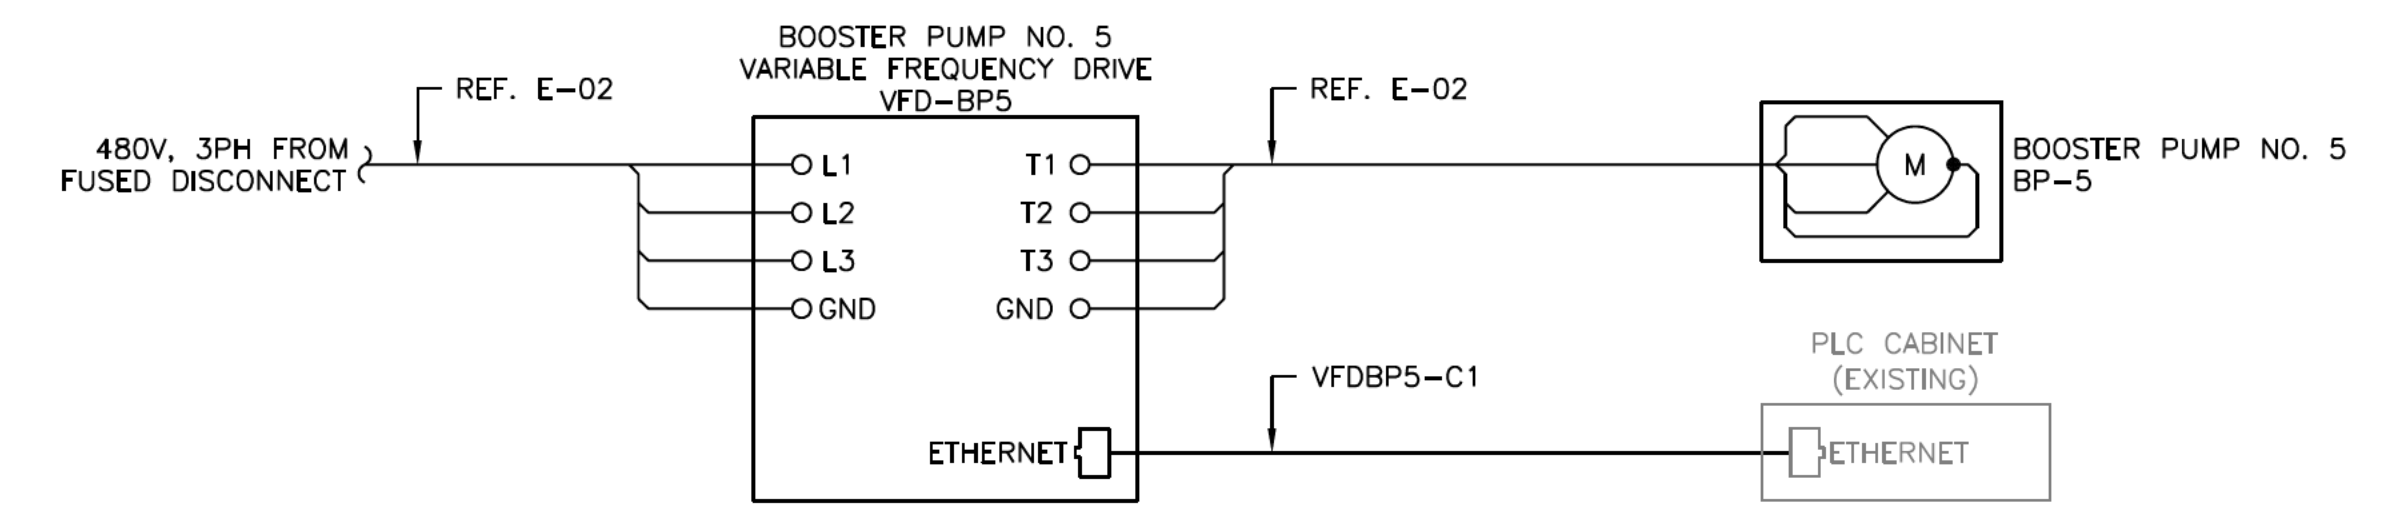

**B** BOOSTER PUMP VARIABLE FREQUENCY DRIVE (VFD-BP5) CONNECTION DIAGRAM  
CONNECTION

NO.	REVISIONS / SUBMISSIONS	DATE

**LAKE HAVASU CITY**  
**BOOSTER STATION 4 IMPROVEMENTS**

Designed by: DLN
Drawn by: JHA
Checked by: AGA
Date: 11/13/23
Dwg scale: AS NOTED

**SCHEMATIC & CONNECTION DIAGRAMS**



EXPIRATION DATE: 12/31/24

Sheet Number:

**E-05**  
Sheet 21 of 24









**NOTES:**

- ETHERNET WIRING BETWEEN NEW VFD AND RTU PANEL SHALL BE ROUTED IN WIREWAY (I.E. PANDUIT) WHERE POSSIBLE.

**LEGEND:**

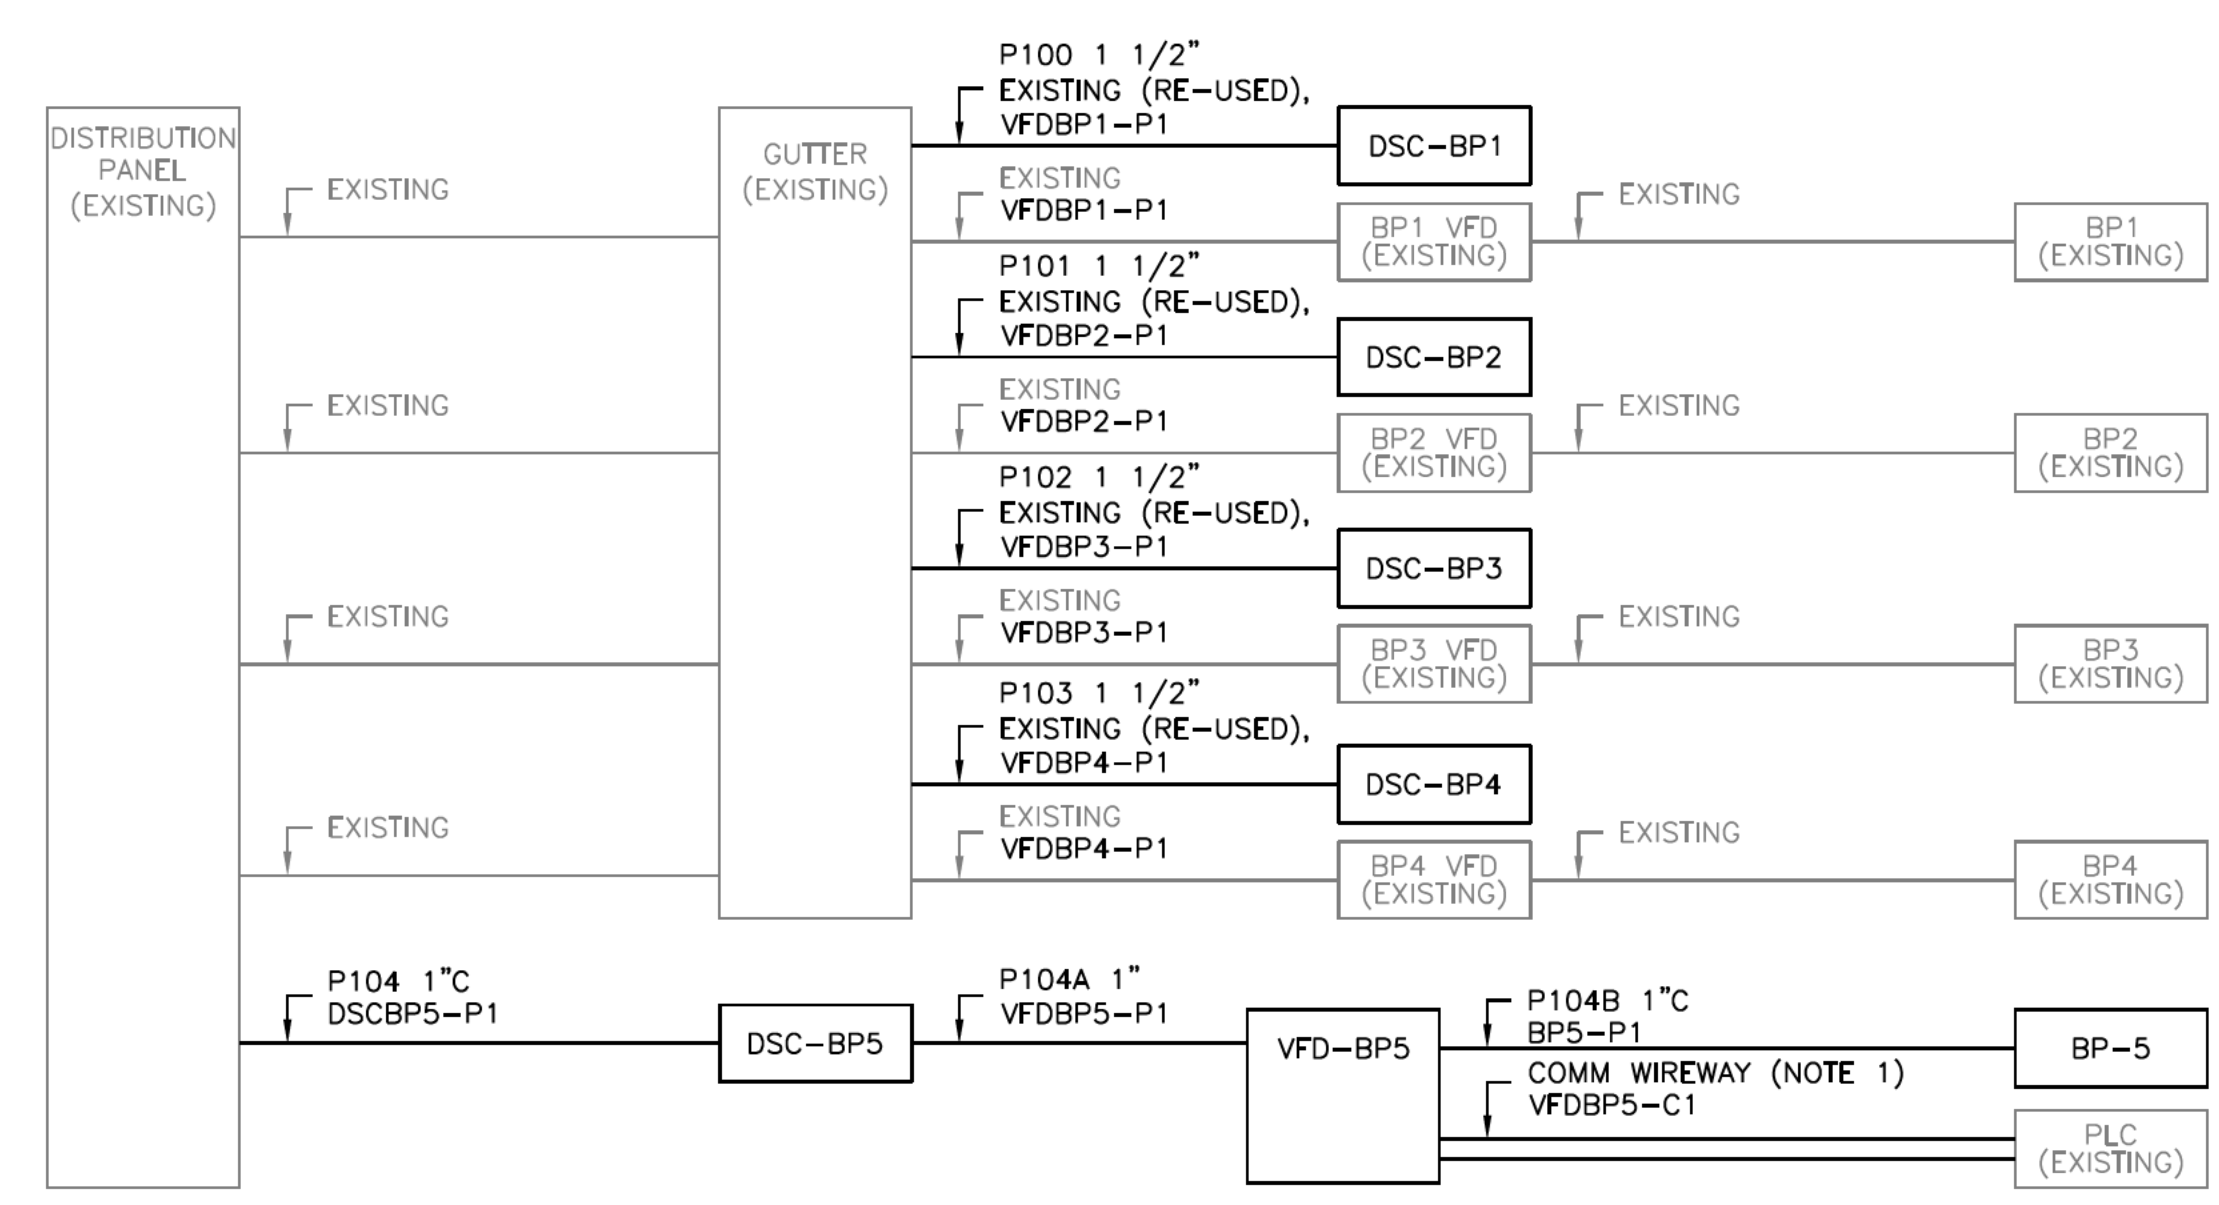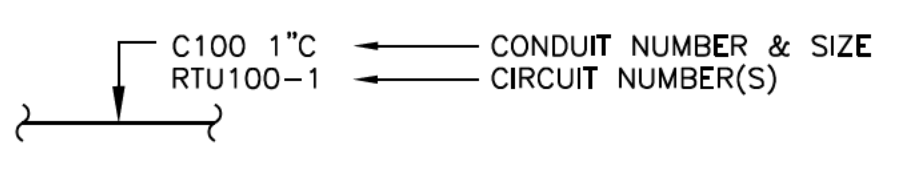

**A** BOOSTER STATION 4 CONDUIT BLOCK DIAGRAM

NO.	REVISIONS / SUBMISSIONS	DATE

**LAKE HAVASU CITY**  
**BOOSTER STATION 4 IMPROVEMENTS**

Designed by: DLN
Drawn by: JHA
Checked by: AGA
Date: 11/13/23
Dwg scale: AS NOTED

**CONDUIT BLOCK DIAGRAM**



EXPIRATION DATE: 12/31/24

Sheet Number:

**E-06**  
 Sheet 22 of 24







NO.	REVISIONS / SUBMISSIONS	DATE

**LAKE HAVASU CITY**  
**BOOSTER STATION 4 IMPROVEMENTS**

Designed by: DLN	Drawn by: JHA	Checked by: AGA	Date: 11/13/23	Dwg scale: AS NOTED
------------------	---------------	-----------------	----------------	---------------------

**P&ID SYMBOLS AND LEGEND**



EXPIRATION DATE: 12/31/24


Sheet Number:

**I-01**


Sheet 23 of 24



**LINE SYMBOLS**

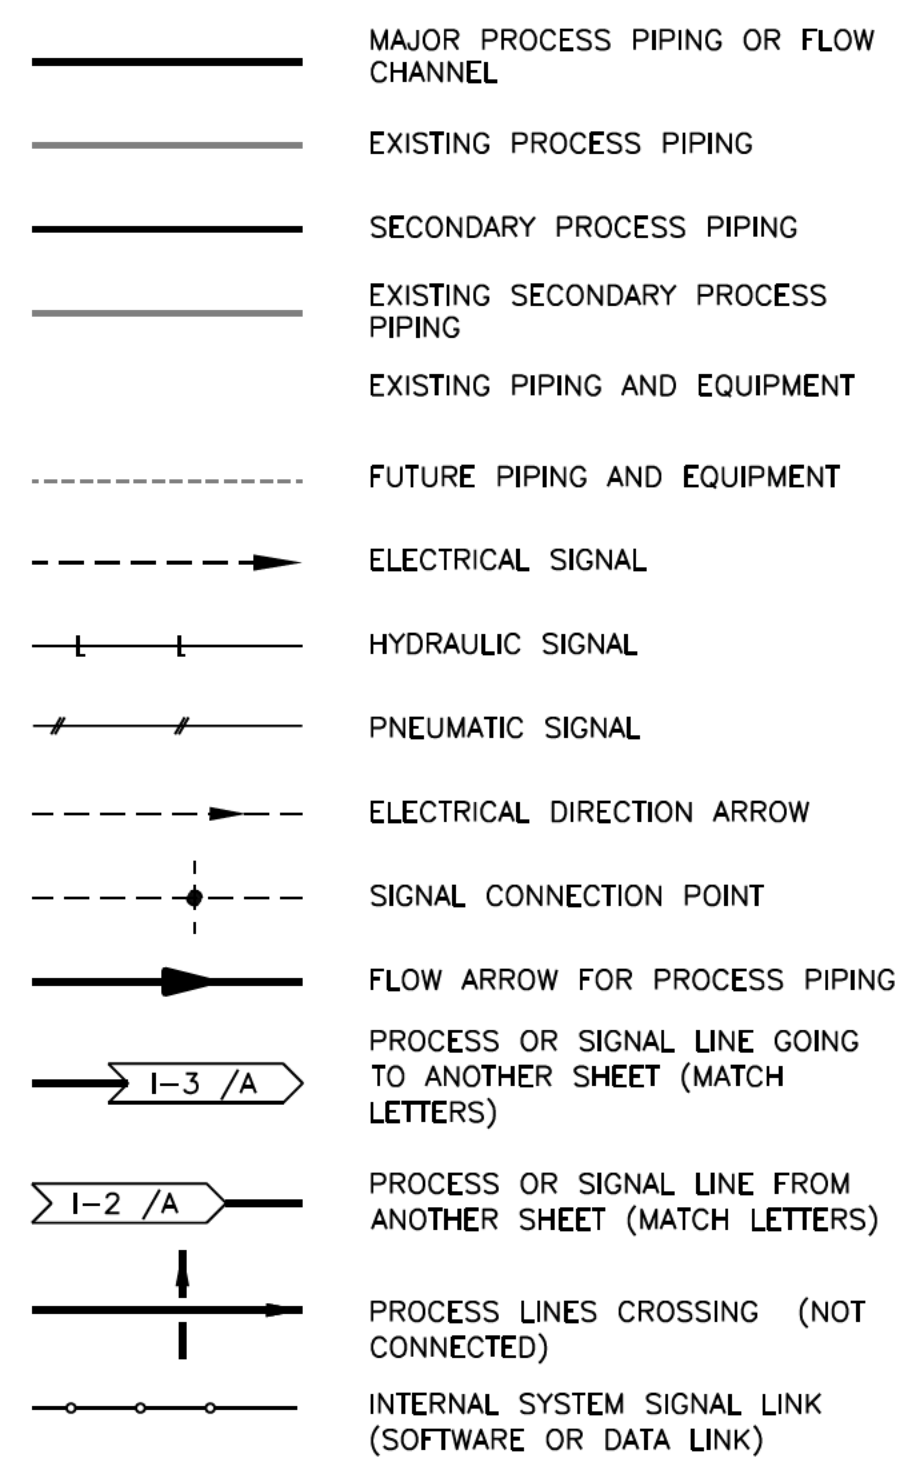

**TAG NUMBERS AND DESIGNATIONS**

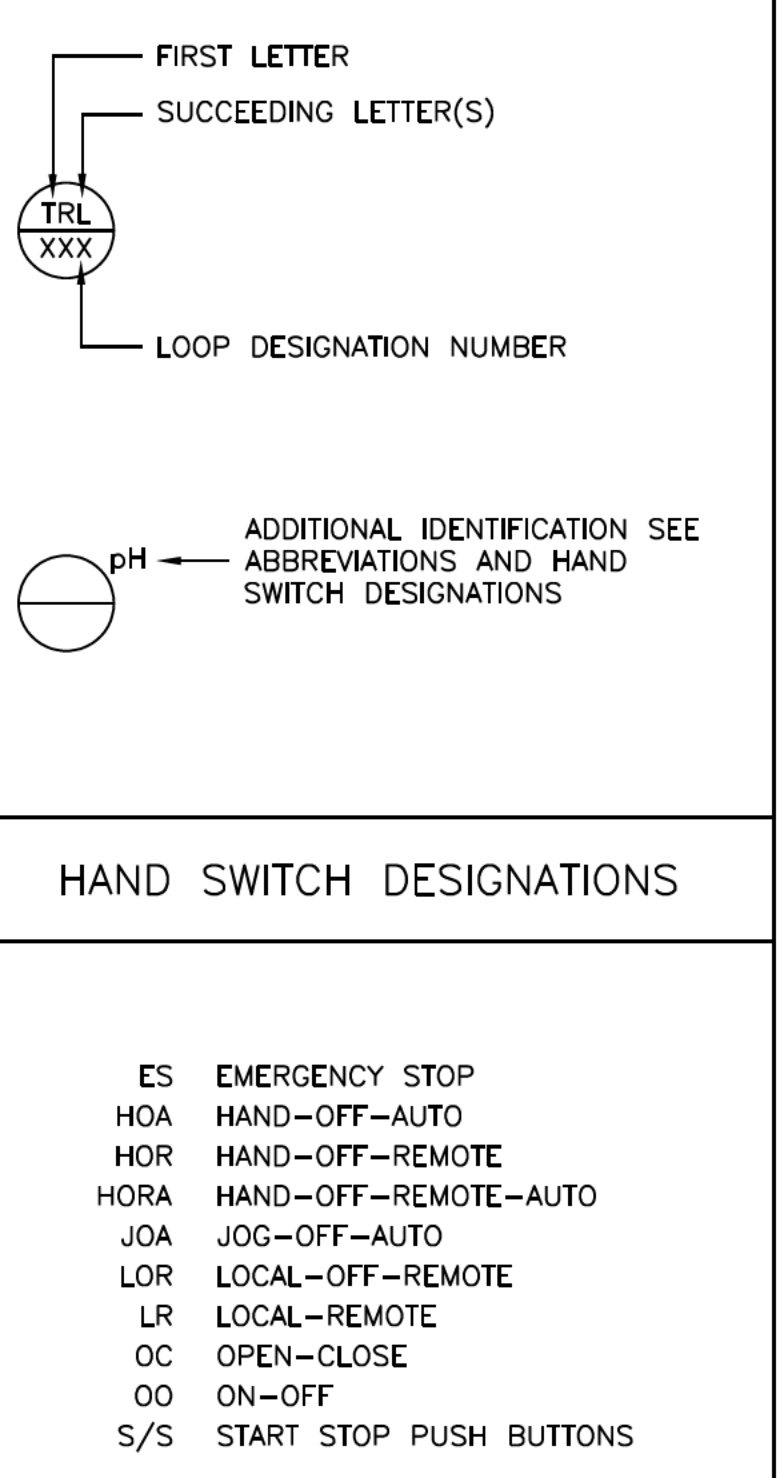


**P&ID ABBREVIATIONS**

A AMPERE	JB JUNCTION BOX	PRES PRESSURE
AFD ADJUSTABLE FREQUENCY DRIVE	L, LO LOW	PS PRESSURE SWITCH
AI ANALOG INPUT	LAN LOCAL AREA NETWORK	PSI POUNDS PER SQUARE INCH
AIC AMPS INTERRUPTING CAPACITY	LC LOOP CONTROLLER	PV PROCESS VARIABLE
ARV AIR RELIEF VALVE	LCP LOCAL CONTROL PANEL	RAS RETURN ACTIVATED SLUDGE
AO ANALOG OUTPUT	LOS LOCK-OFF-STOP	RAW RAW WATER
AS AIR SUPPLY	LOC/REMOTE	REM REMOTE
ATS AUTOMATIC TRANSFER SWITCH	LS LEVEL (i.e.. FLOAT) SWITCH	RF RADIO FREQUENCY
AUTO AUTOMATIC	M MOTOR	RIO REMOTE INPUT OUTPUT
CB CIRCUIT BREAKER	MA MANUAL/AUTO	RS RAW SEWAGE
CL2 CHLORINE	mA MILLIAMPERE	RSP RAW SEWAGE PUMP
CON CONTACTOR	MC MANUFACTURE CABLE	RST RESET
CU COPPER	MCC MOTOR CONTROL CENTER	RTD RESISTANCE TEMPERATURE DETECTOR
CV CONTROL VALVE	MCP MOTOR CIRCUIT PROTECTOR	RTU REMOTE TELEMETRY UNIT
DCS DISTRIBUTED CONTROL SYSTEM	MFR(S) MANUFACTURER(S)	RUNf RUN (FAST SPEED)
DI DISCRETE INPUT	MGD MILLION GALLONS PER DAY	RUNs RUN (SLOW SPEED)
DO DISSOLVED OXYGEN, DISCRETE OUTPUT	MGL MILLIGRAMS PER LITER	SB SLUDGE BLANKET
DP DIFFERENTIAL PRESSURE	MH MANHOLE	SEQ SERVICE ENTRANCE EQUIPMENT
DWG DRAWING	MLR MIXED LIQUOR RETURN	SES SERVICE ENTRANCE SECTION
EGO EMERGENCY GAS OFF	MO MOISTURE	SLC SINGLE LOOP CONTROLLER
ETM ELAPSED TIME METER	MOD MODULATED	STL START-LOCK-OFF-STOP
ETMf ELAPSED TIME METER (FAST SPEED)	MTU MASTER TELEMETRY UNIT	SO2 SULFUR DIOXIDE
ETMs ELAPSED TIME METER (SLOW SPEED)	NPW NON-POTABLE WATER	SOV SOLENOID OPERATED VALVE
EOL ELECTRONIC OVERLOAD	NS NITROGEN SUPPLY	SP SET POINT
EXIST EXISTING	NTU TURBIDITY	SPD SPEED
FA FOUL AIR	O/C OPEN / CLOSE	SPR SPARE
FC FAIL CLOSED	OCA OPEN-CLOSE-AUTO	SS START/STOP (MAINTAINED)
FE FINAL EFFLUENT	OCC OPEN-CLOSE-REMOTE	SSS SOLID STATE STARTER (SOFT START)
FR FORWARD-REVERSE	OIT OPERATOR INTERFACE TERMINAL	STR MOTOR STARTER
FS FLOAT SWITCH	OL OVERLOAD	TAH TEMPERATURE ALARM HIGH
FVNR FULL VOLTAGE NON-REVERSING	OO ON/OFF (MAINTAINED)	T/M TEMPERATURE AND/OR MOISTURE
FW FINISHED WATER	OOA ON-OFF-AUTO	TEMP TEMPERATURE
GND GROUND	OOR ON-OFF-REMOTE	TS TEMPERATURE SWITCH
GAL GALLONS	OSC OPEN-STOP-CLOSE	TSS TOTAL SUSPENDED SOLIDS
GPM GALLONS PER DAY	PAH PRESSURE ALARM HIGH	UG UNDERGROUND
GPH GALLONS PER HOUR	PER PERMISSIVE	USD UP/STOP/DOWN
GPM GALLONS PER MINUTE	PLC PROGRAMMABLE LOGIC CONTROLLER	V VOLT
H, HI HIGH	PNL PANEL	VFD VARIABLE FREQUENCY DRIVE
H2S HYDROGEN SULFIDE	PO PULSE OUTPUT	W WATER
HMI HUMAN MACHINE INTERFACE	POS POSITION	WAS WASTE ACTIVATED SLUDGE
HOA HAND-OFF-AUTO	POT POTENTIOMETER	WW WASTEWATER
IO CURRENT	PPG POUNDS PER GALLON	WMTR WASTEWATER TRANSMITTER
IO INPUT/OUTPUT	PPH POUNDS PER HOUR	ZS POSITION (i.e. LIMIT) SWITCH
IOE INTERNAL-OFF-EXTERNAL	PPM PARTS PER MILLION	
	PR PAIR	


**ISA INSTRUMENT IDENTIFICATION TABLE**

FIRST LETTERS		SUCCEEDING LETTERS		
MEASURED OR INITIATING VARIABLE	MODIFIER	READOUT OR PASSIVE FUNCTION	OUTPUT FUNCTION	MODIFIER
A ANALYZER		ALARM		AUTO
B BURNER, COMBUSTION				
C CONDUCTIVITY			CONTROL	CLOSED
D DENSITY	DIFFERENTIAL			
E VOLTAGE		ELEMENT		
F FLOW	RATIO			
G GAUGE		GLASS, VIEWING DEVICE		
H HAND				HIGH
I CURRENT		INDICATE		
J POWER	SCAN			
K TIME, TIME SCHED.	TIME RATE OF CHANGE		CONTROL STATION	
L LEVEL		LIGHT		LOW
M MOTION				MIDDLE
N INTRUSION				NORMAL
O TORQUE		ORIFICE, RESTRICTION		OPEN
P PRESSURE		POINT CONNECTION		STOP
Q QUANTITY	INTEGRATE, TOTALIZE			
R RADIATION		RECORD, OR PRINT		RUN OR REMOTE
S SPEED, FREQUENCY	SAFETY		SWITCH	START
T TEMPERATURE			TRANSMIT	
U MULTIVARIABLE		MULTIFUNCTION	MULTIFUNCTION	MULTIFUNCTION
V VIBRATION			VALVE, LOUVER	
W WEIGHT		WELL		
X MOTOR	X-AXIS	UNCLASSIFIED	UNCLASSIFIED	UNCLASSIFIED
Y EVENT, STATE, OR PRESENCE	Y-AXIS		RELAY, COMPUTE, CONVERT	
Z POSITION	Z-AXIS		DRIVER, ACTUATOR, FINAL CONTROL ELEMENT	


**SENSING, INDICATION, AND CONTROL SYMBOLS**

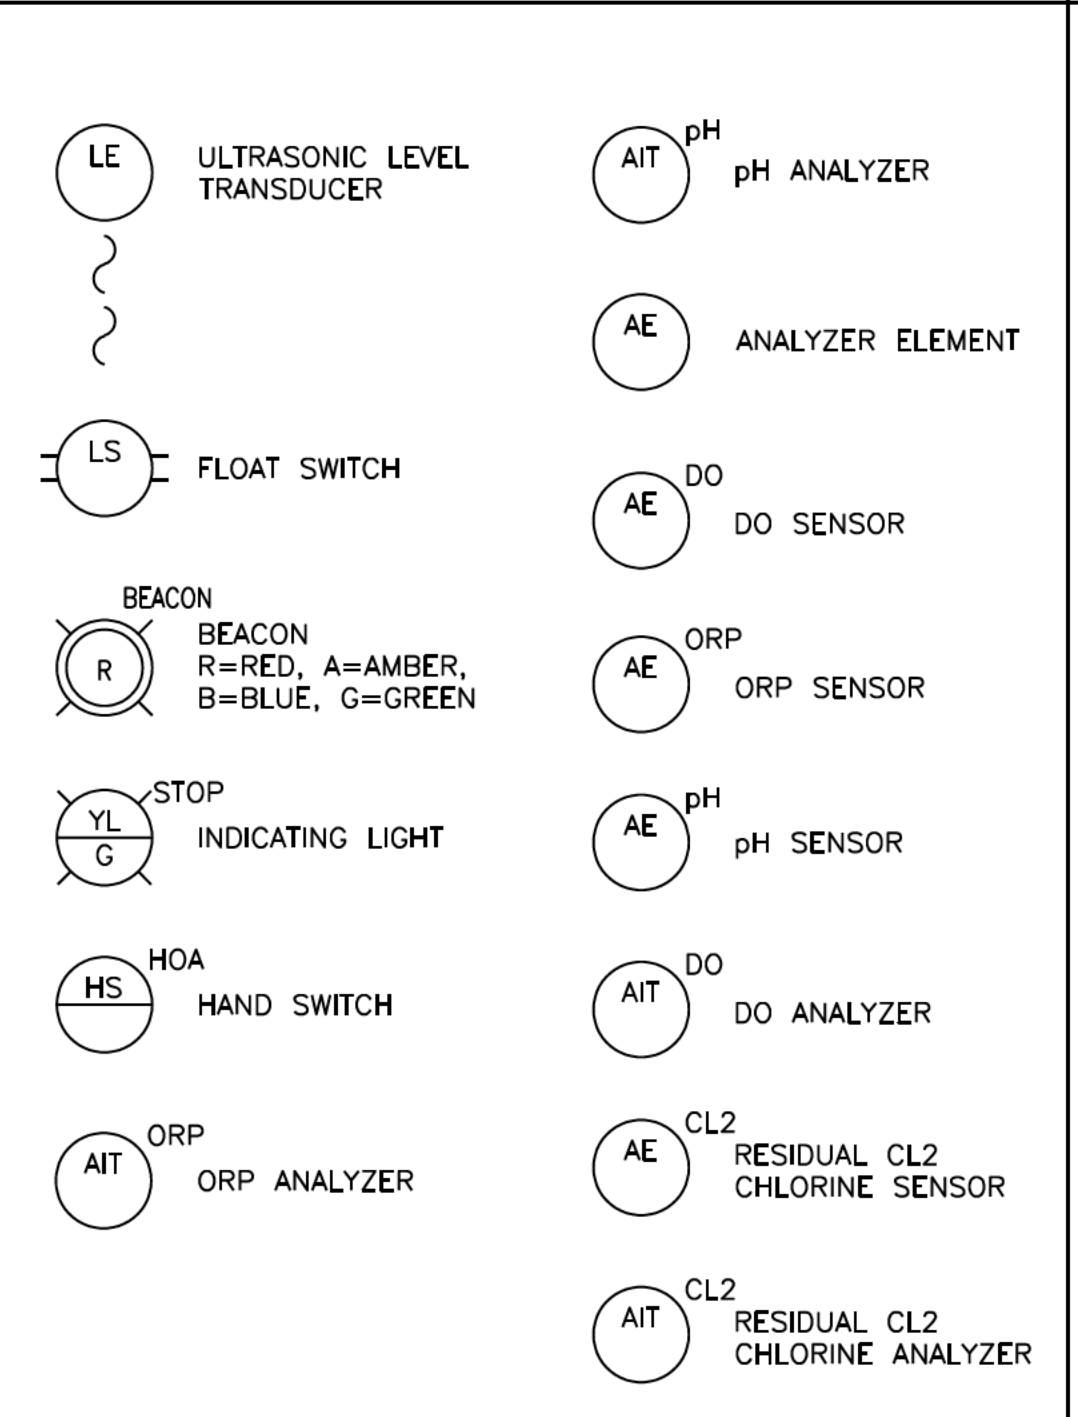


**P&ID INTERFACE SYMBOLS**

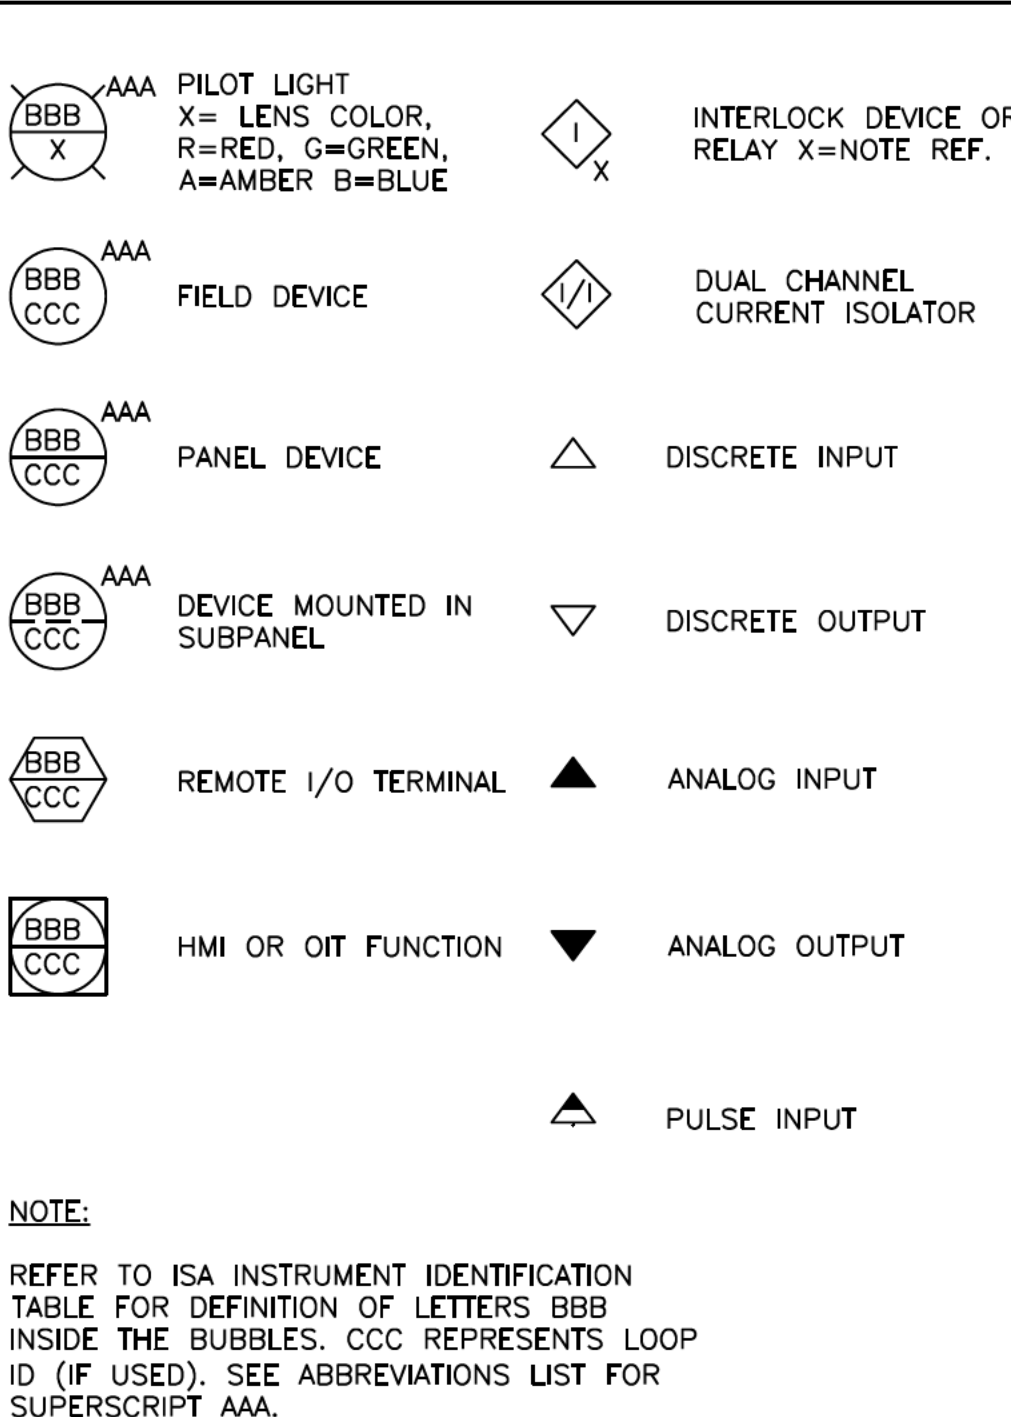


**P&ID EQUIPMENT AND PROCESS SYMBOLS**

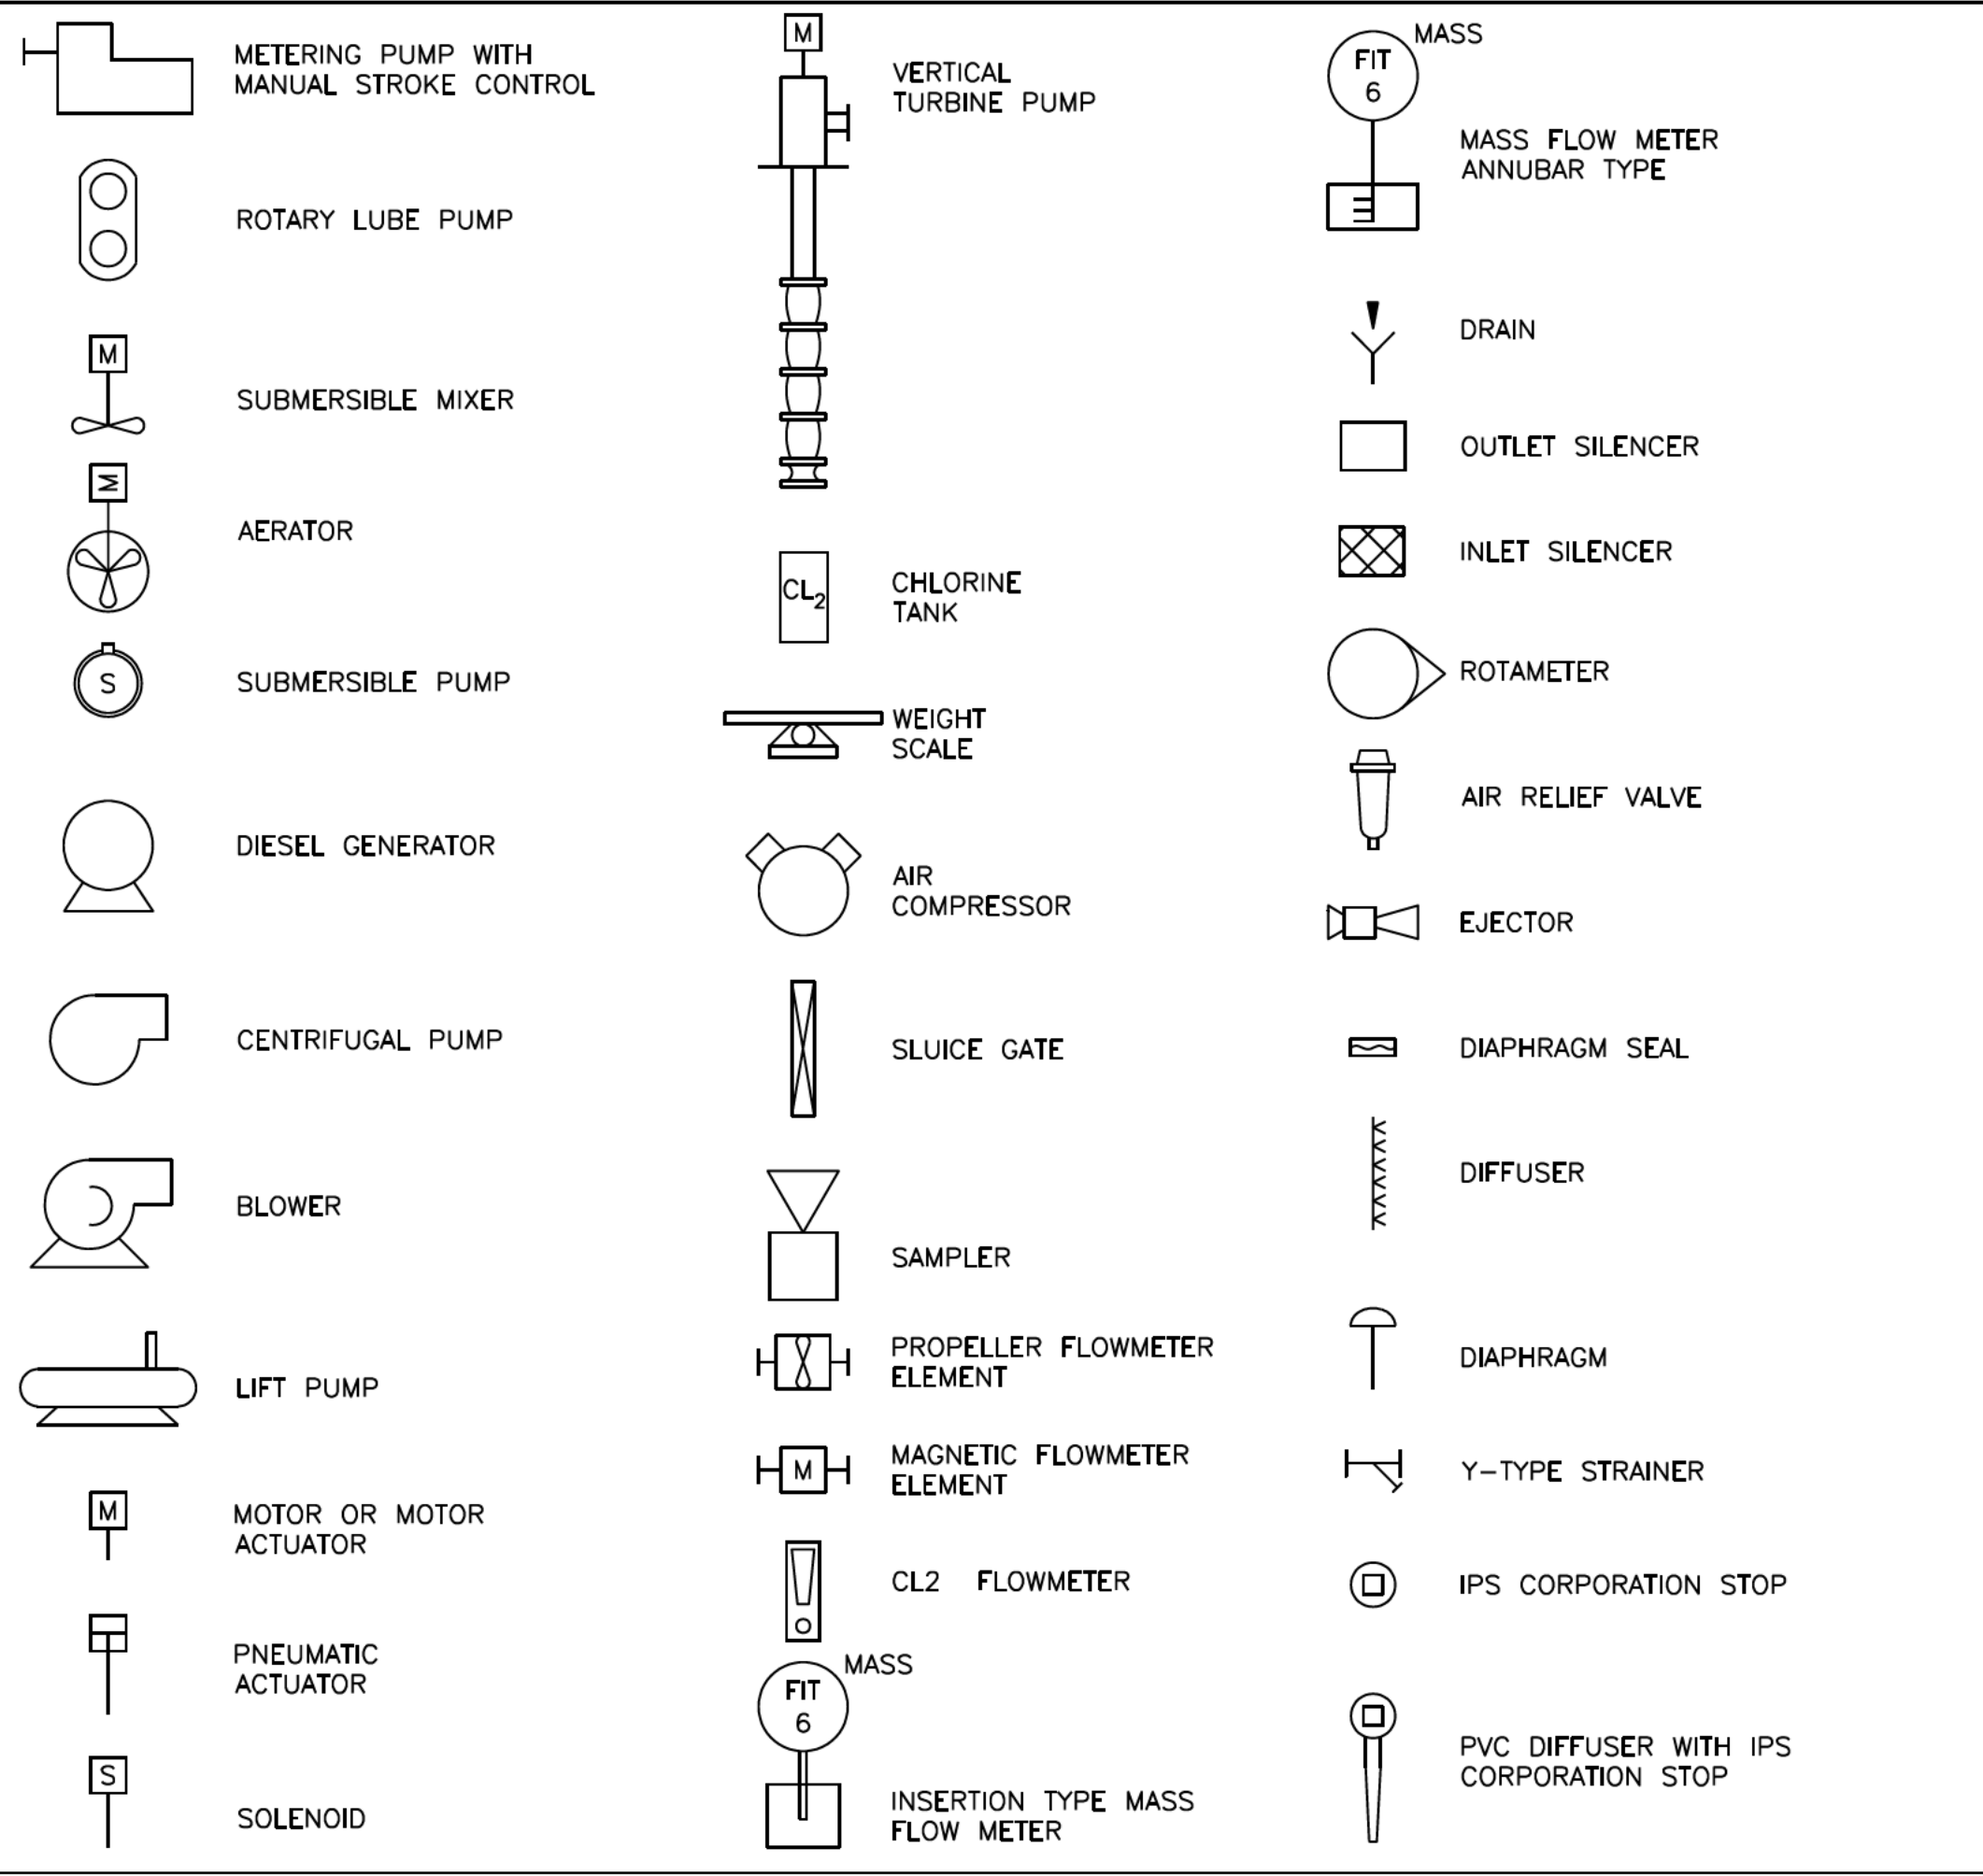

**P&ID VALVE SYMBOLS**

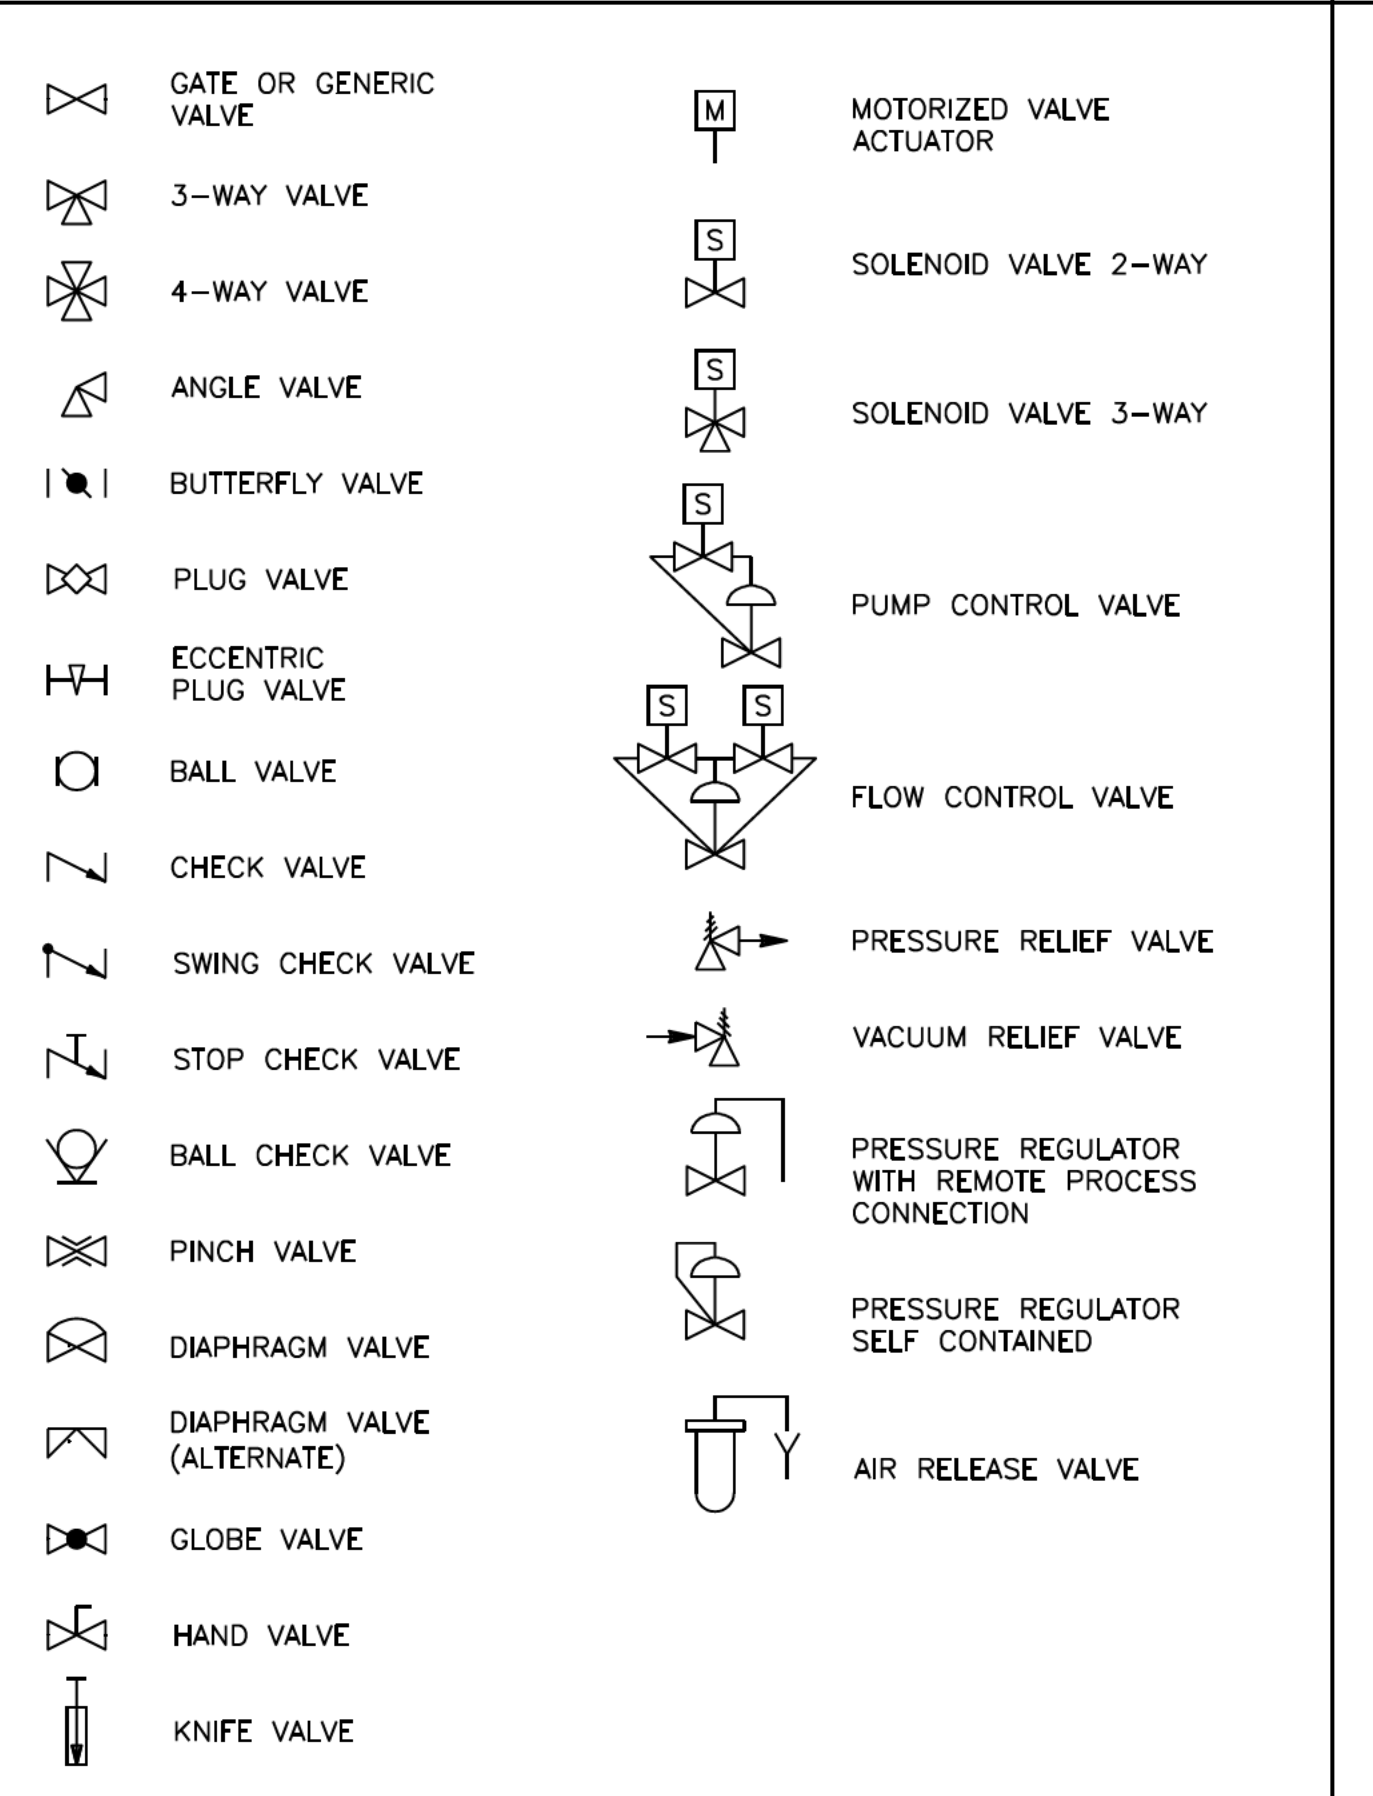



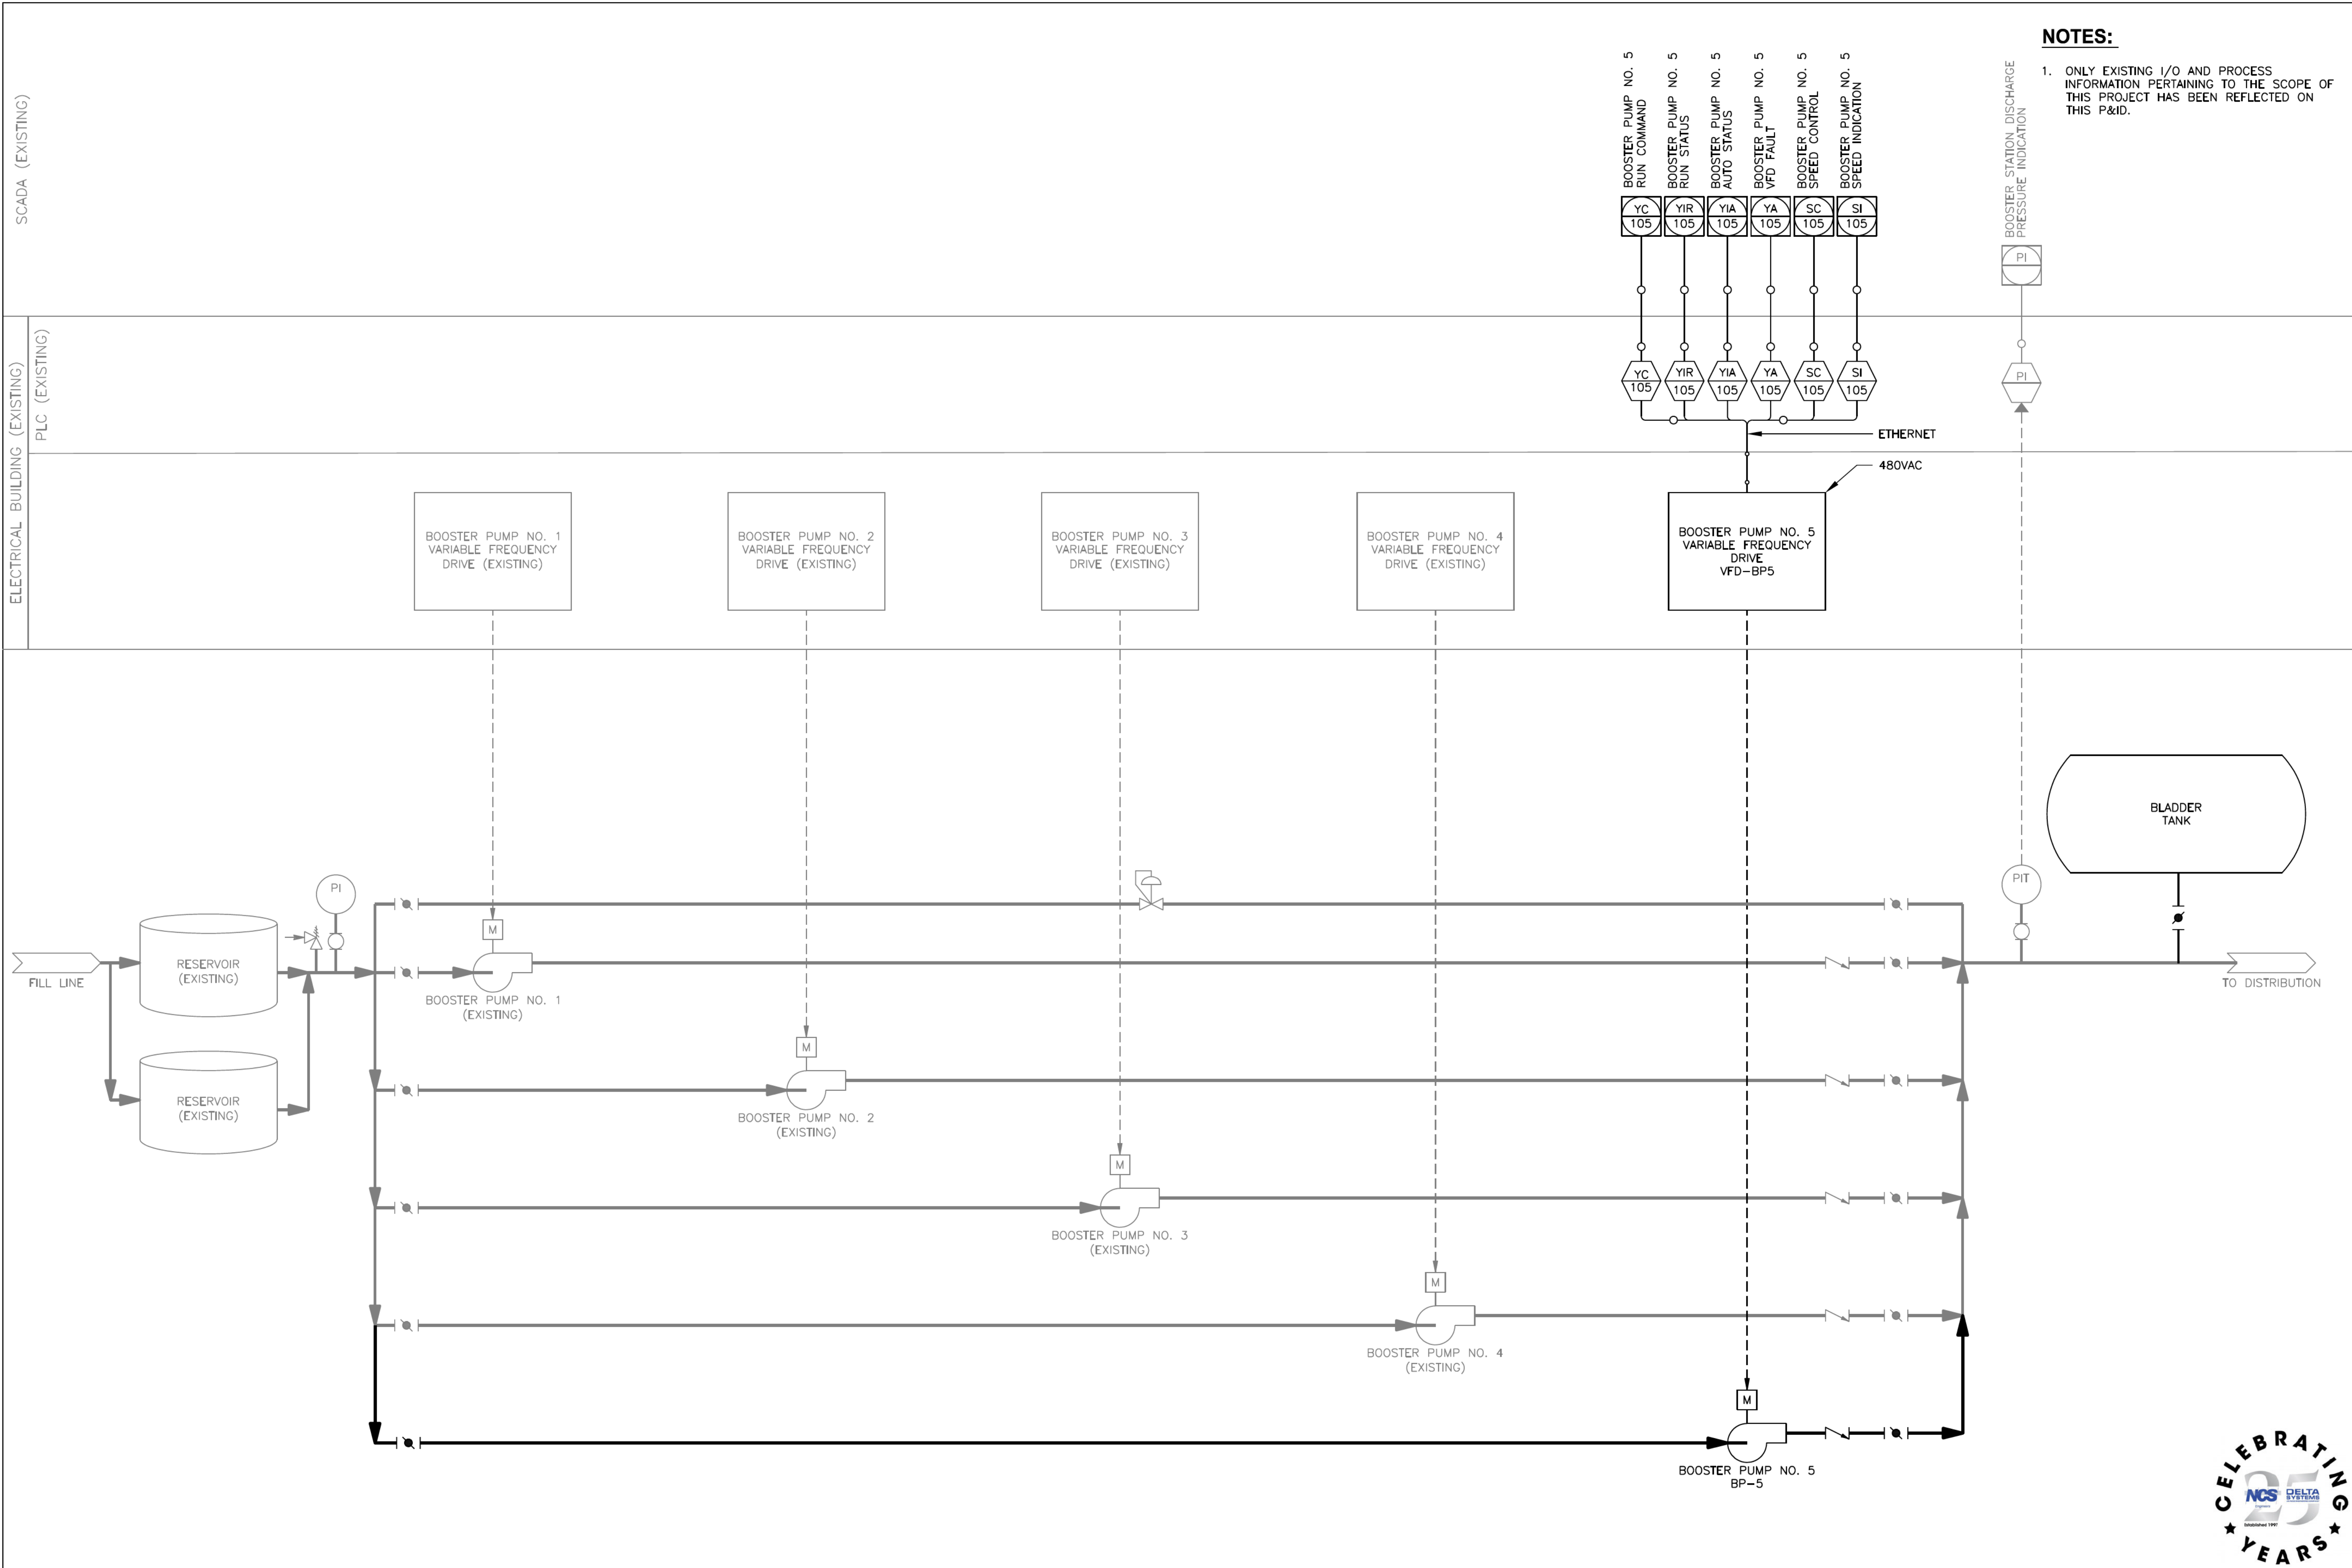

**NOTES:**  
 1. ONLY EXISTING I/O AND PROCESS INFORMATION PERTAINING TO THE SCOPE OF THIS PROJECT HAS BEEN REFLECTED ON THIS P&ID.



NO.	REVISIONS / SUBMISSIONS	DATE

**LAKE HAVASU CITY**  
**BOOSTER STATION 4 IMPROVEMENTS**

Designed by: DLN
Drawn by: JHA
Checked by: AGA
Date: 11/13/23
Dwg scale: AS NOTED

**P&ID**



EXPIRATION DATE: 12/31/24

Sheet Number:  
**I-02**  
 Sheet 24 of 24





## SECTION 0310

**BID SCHEDULE - BOOSTER STATION 4 IMPROVEMENTS, B24-PW-108029-500433**

<b>ITEM NO.</b>	<b>DESCRIPTION</b>	<b>EST QTY</b>	<b>UNIT OF MEASURE</b>	<b>UNIT PRICE (*1) (WORD)</b>	<b>UNIT PRICE (FIGURE)</b>	<b>ITEM TOTAL (*2) COSTS</b>
<b><u>BASE BID</u></b>						
1	Mobilization/Demobilization, Bonds, Permitting and Insurance	1	L.S.	_____	\$ _____	\$ _____
2	All demolition work including piping, mechanical, electrical and civil work at BPS 4	1	L.S.	_____	\$ _____	\$ _____
3	All mechanical work including piping, pumps, valves, meters, tanks, and appurtenances at BPS 4	1	L.S.	_____	\$ _____	\$ _____
4	All civil/site, fencing, grading and concrete works at BPS 4	1	L.S.	_____	\$ _____	\$ _____
5	All work associated with Cherry Tree Lane Connection	1	L.S.	_____	\$ _____	\$ _____
6	Metal Shade Canopy	1	L.S.	_____	\$ _____	\$ _____
7	Painting and Coating	1	L.S.	_____	\$ _____	\$ _____
8	All electrical and instrumentation work	1	L.S.	_____	\$ _____	\$ _____
9	Force Account	1	L.S.	<u>Fifty Thousand Dollars</u>	<u>\$50,000.00</u>	<u>\$50,000.00</u>
<b>TOTAL BID(*3) + FORCE ACCOUNT</b>				_____	\$ _____	\$ _____

Above line items and totals shall include all work shown on the plans and specified herein, including taxes, insurance and bonding.

\*1 The "Unit Price" column shall indicate unit or lump sum prices for each bid item and shall be indicated in written and numerical form.

\*2 The "Item Total Costs" column shall indicate the extension of the unit prices, which is obtained by multiplying the "Estimated Quantity" column by the "Unit Price" column.

\*3 The "Bid Total" amount shall be the sum of all costs listed in the "Item Total Costs" column.